

LM-79-08 Test Report

For

RAB LIGHTING INC

(Brand Name : RAB)

170 Ludlow Ave , PO BOX 970, Northvale, NJ 07647-2305 USA

Model name (s) :

R2STLB

Report Type: Testing and Report According to IES LM-79-2008

Type of Luminaire: Downlights

Report Date: 2024-09-05

1.1 Rated Values:	
Rated Voltage / Frequency	120V, 60HZ
Nominal Power	9W
Rated Initial Lamp Lumen	600lm (5000k)
Declared CCT	2700k/3000k/3500k/4000k/5000k

1.2 Test Specifications:

Test item	<ol style="list-style-type: none"> 1. Total Luminous Flux 2. Luminous Distribution Intensity 3. Luminous Efficacy 4. Correlated Color Temperature 5. Color Rendering Index 6. Chromaticity Coordinate 7. Electrical Parameters
Reference Standard	<ol style="list-style-type: none"> 1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products 2. ANSI C78.377-2015 Specifications for the Chromaticity of Solid State Lighting Products 3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources 4. CIE 15-2004 Technical Report Colorimetry 5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source 6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems
Reference Work Instruction	QD25

1.3 Test Methods

<p>1) Photometric and Light Distribution Measurement – Goniophotometer Method:</p> <p>Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25°C ±1°C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1°vertical intervals and 22.5°horizontal intervals.</p>
<p>2) Chromaticity Measurement – Sphere-Spectroradiometer Method:</p> <p>Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25°C ±1°C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.</p>
<p>3) Electrical Measurements:</p> <p>Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25°C±1°C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.</p>

2.1.1 Electrical, Photometric and Chromaticity Measurements

Test date	2024-09-05	Test Ambient:	25.3
Test Orientation	As intended	Stabilization Time (min)	15
Model Number	R2STLB	CCT Setting	2700k

Electrical Measurement:

Sampel No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
#1	120.7	60	0.076	9.03	0.979


Chromaticity Measurement – Sphere-Spectroradiometer Method:

Parameter	Result		
Test Voltage (V)	120.7		
Frequency (Hz)	60		
CCT (K)	2794		
Duv	0.00101		
Chromaticity (x, y)	x=0.4540, y=0.4119		
Chromaticity (u', v')	u' =0.2582, v' =0.5270		
Color Rendering Index (CRI)	94.4		
R9	68		
Special Color Rendering Indices			
R1	97	R9	68
R2	99	R10	99
R3	97	R11	97
R4	95	R12	86
R5	96	R13	98
R6	96	R14	98
R7	91	R15	92
R8	84	--	--


Photometric Measurement – Goniophotometer Method:



Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
Total Luminous (lm)	519.164
Luminous Efficacy (lm/W)	57.50
Beam Angle (°)	34.8
Center Beam Candle Power (cd)	1347

Spectral Power Distribution & Chromaticity Diagram

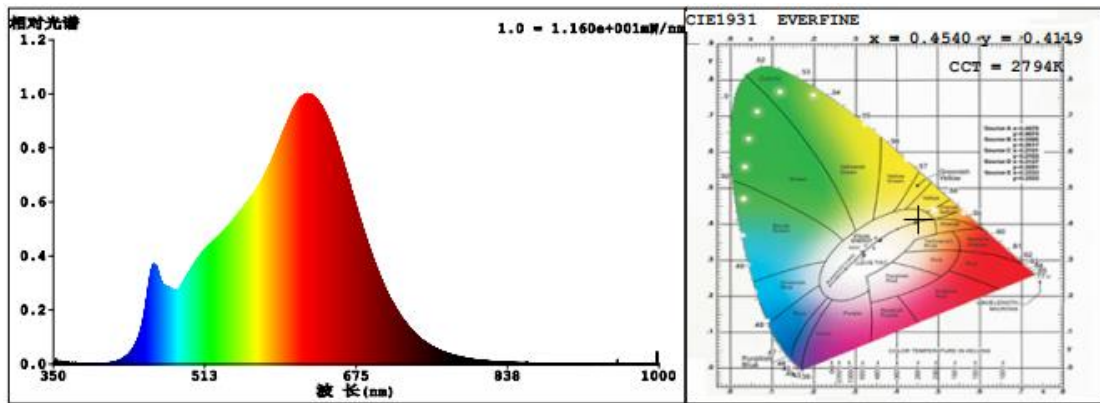

TM30

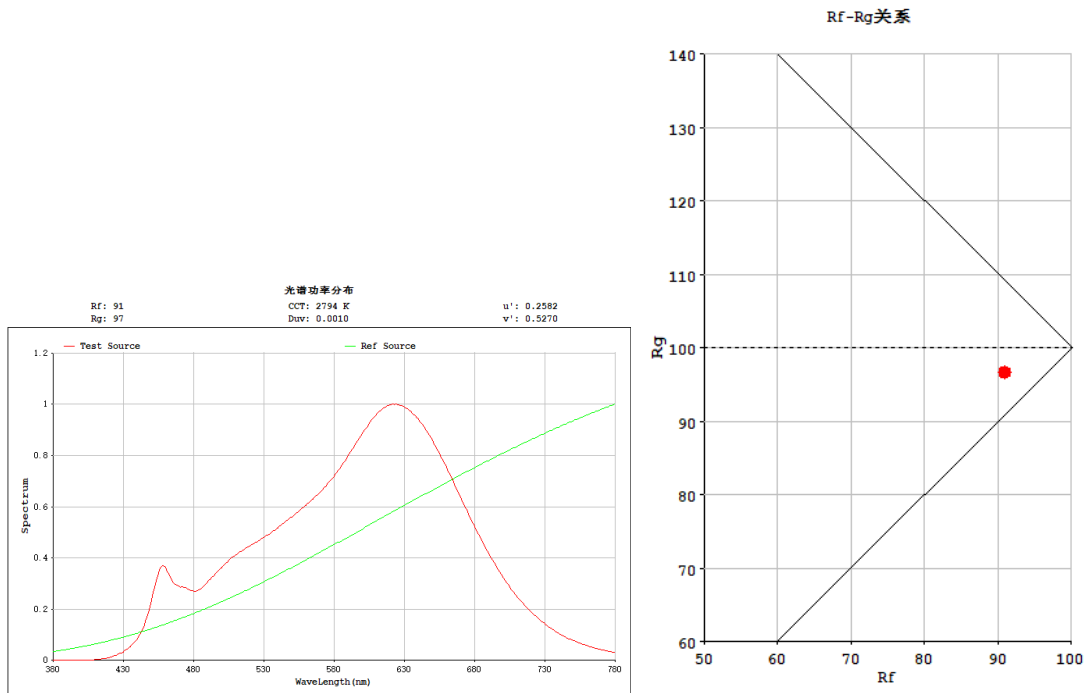

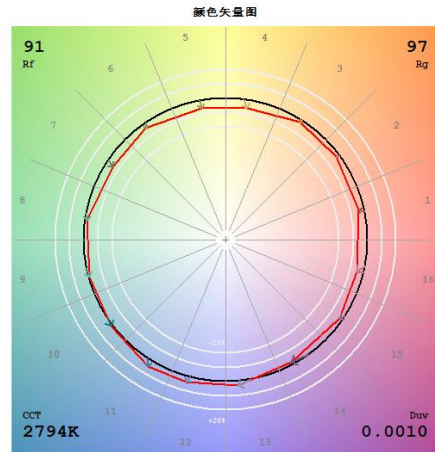
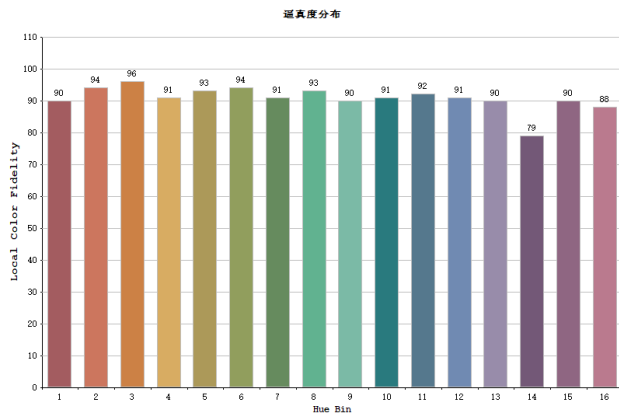


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	463.4	89.25%
0-40	500.6	96.42%
0-60	518.9	99.94%
60-90	0.2	0.04%
70-100	0.0	0.00%
90-120	0.0	0.00%
0-90	519.2	100.00%
90-180	0.0	0.00%
0-180	519.2	100.00%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	117.40	22.61%	90-100	0	0%
10-20	223.7	43.09%	100-110	0	0%
20-30	122.30	23.56%	110-120	0	0%
30-40	37.17	7.16%	120-130	0	0%
40-50	14.50	2.79%	130-140	0	0%
50-60	3.852	0.74%	140-150	0	0%
60-70	0.2307	0.04%	150-160	0	0%
70-80	0.0000	0.00%	160-170	0	0%
80-90	0.0000	0.00%	170-180	0	0%

Photometric Data

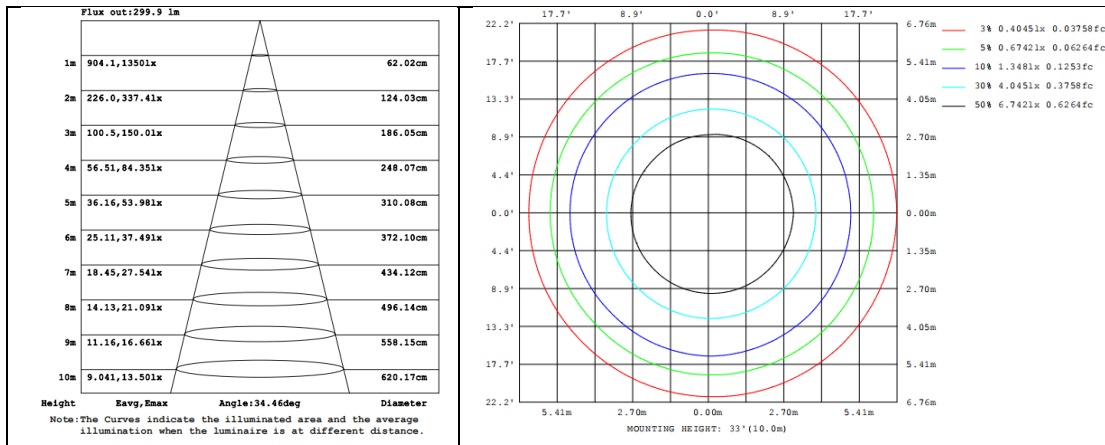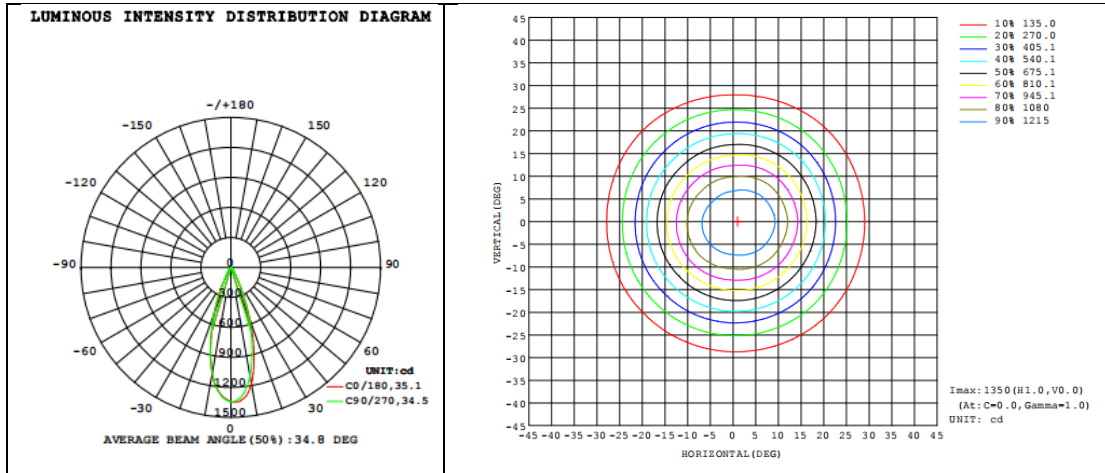

2.1.2 Electrical, Photometric and Chromaticity Measurements

Test date	2024-09-05	Test Ambient:	25.3
Test Orientation	As intended	Stabilization Time (min)	15
Model Number	R2STLB	CCT Setting	3000k

Electrical Measurement:

Sampel No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
#1	120.7	60	0.075	8.84	0.979

Chromaticity Measurement – Sphere-Spectroradiometer Method:


Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
CCT (K)	3091
Duv	-0.000783
Chromaticity (x, y)	x=0.4296, y=0.3995
Chromaticity (u', v')	u' =0.2478, v' =0.5185
Color Rendering Index (CRI)	94.2
R9	75

Special Color Rendering Indices			
R1	98	R9	75
R2	98	R10	96
R3	96	R11	97
R4	94	R12	82
R5	97	R13	99
R6	94	R14	98
R7	91	R15	94
R8	87	--	--


Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
Total Luminous (lm)	562.419
Luminous Efficacy (lm/W)	63.59
Beam Angle (°)	34.8
Center Beam Candle Power (cd)	1462

Spectral Power Distribution & Chromaticity Diagram

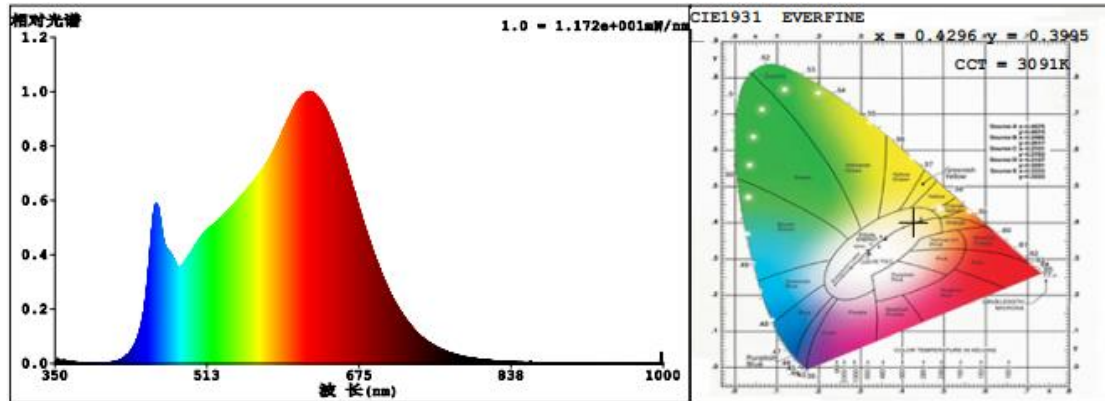

TM30

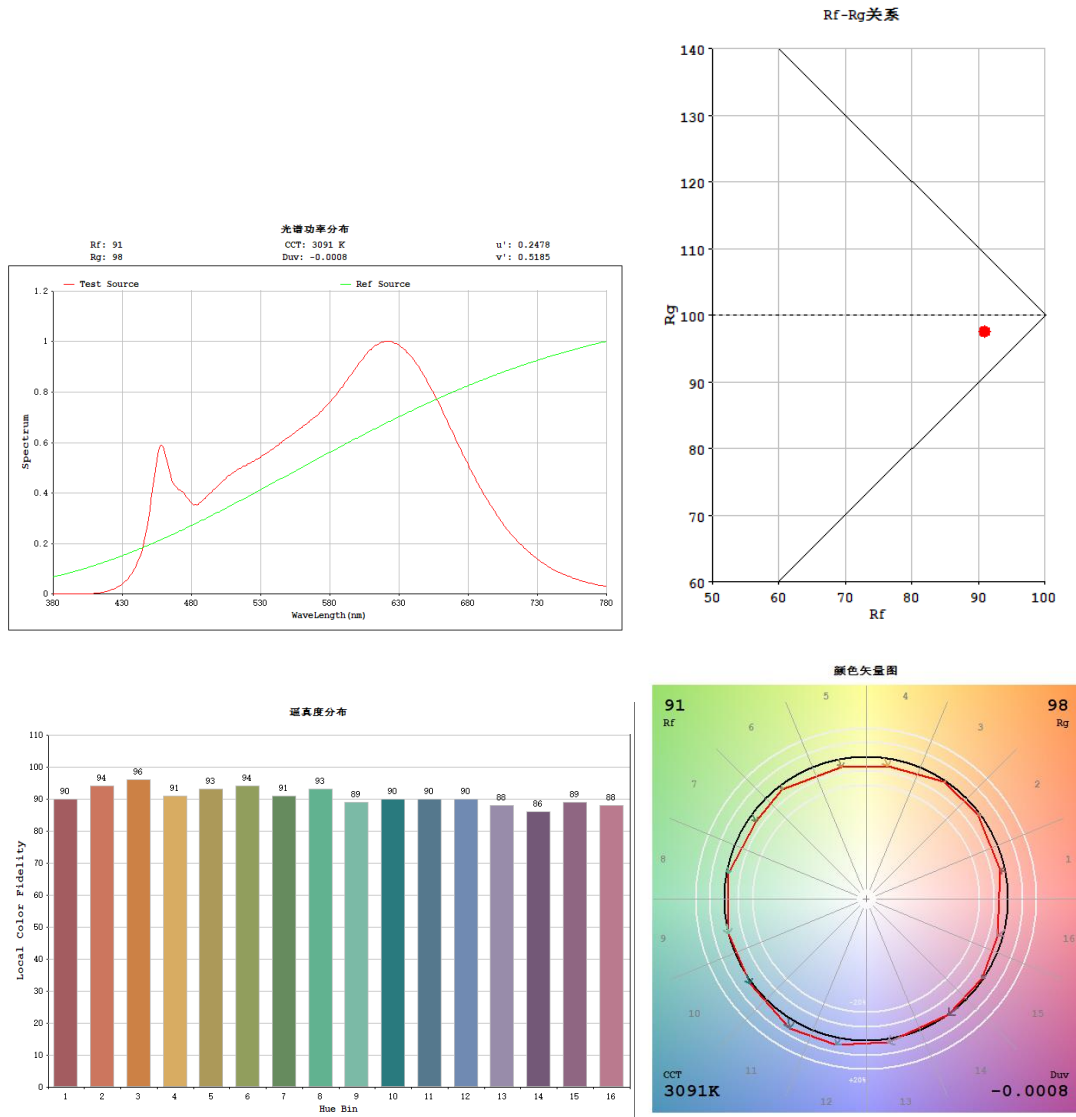


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	501.8	89.22%
0-40	542.2	96.41%
0-60	562.2	99.96%
60-90	0.3	0.05%
70-100	0.0	0.00%
90-120	0.0	0.00%
0-90	562.4	100.00%
90-180	0.0	0.00%
0-180	562.4	100.00%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	126.90	22.56%	90-100	0	0%
10-20	242.2	43.07%	100-110	0	0%
20-30	132.80	23.61%	110-120	0	0%
30-40	40.39	7.18%	120-130	0	0%
40-50	15.74	2.80%	130-140	0	0%
50-60	4.186	0.74%	140-150	0	0%
60-70	0.2575	0.05%	150-160	0	0%
70-80	0.0000	0.00%	160-170	0	0%
80-90	0.0000	0.00%	170-180	0	0%

Photometric Data

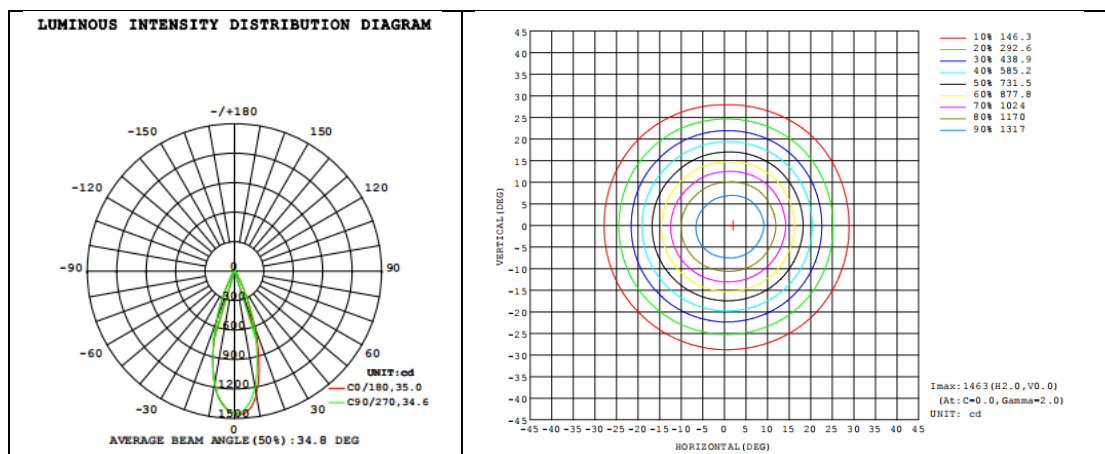

2.1.3 Electrical, Photometric and Chromaticity Measurements

Test date	2024-09-05	Test Ambient:	25.3
Test Orientation	As intended	Stabilization Time (min)	15
Model Number	R2STLB	CCT Setting	3500k

Electrical Measurement:

Sampel No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
#1	120.7	60	0.072	8.51	0.977

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
CCT (K)	3560
Duv	-0.00151
Chromaticity (x, y)	x=0.4005, y=0.3849
Chromaticity (u', v')	u' =0.2350, v' =0.5081
Color Rendering Index (CRI)	94.2
R9	79

Special Color Rendering Indices			
R1	98	R9	79
R2	97	R10	95
R3	95	R11	96
R4	94	R12	78
R5	96	R13	99
R6	94	R14	98
R7	91	R15	95
R8	88	--	--


Photometric Measurement – Goniophotometer Method:



Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
Total Luminous (lm)	610.265
Luminous Efficacy (lm/W)	71.70
Beam Angle (°)	35.0
Center Beam Candle Power (cd)	1574

Spectral Power Distribution & Chromaticity Diagram

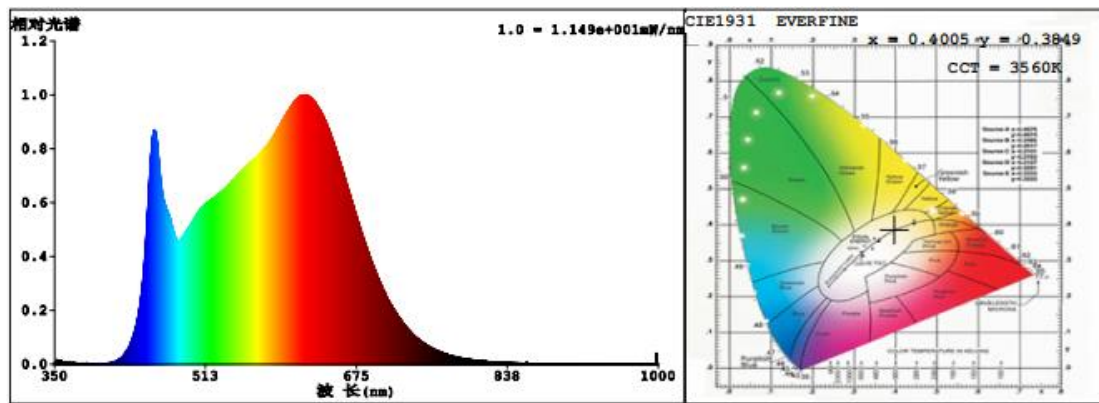

TM30

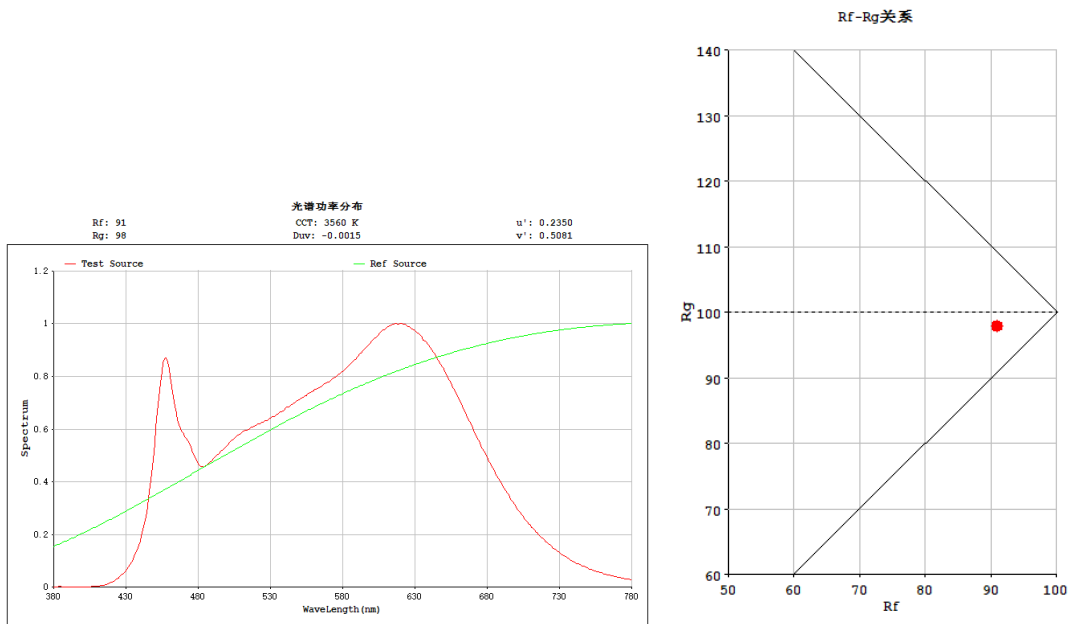

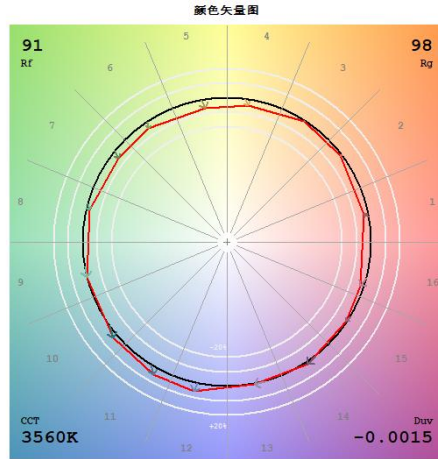
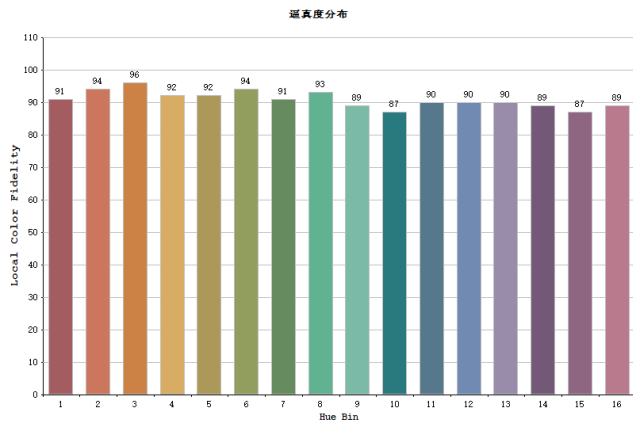


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	544.3	89.19%
0-40	588.3	96.40%
0-60	610.0	99.95%
60-90	0.3	0.05%
70-100	0.0	0.00%
90-120	0.0	0.00%
0-90	610.3	100.00%
90-180	0.0	0.00%
0-180	610.3	100.00%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	137.30	22.50%	90-100	0	0%
10-20	262.5	43.01%	100-110	0	0%
20-30	144.50	23.68%	110-120	0	0%
30-40	44.01	7.21%	120-130	0	0%
40-50	17.13	2.81%	130-140	0	0%
50-60	4.559	0.75%	140-150	0	0%
60-70	0.2875	0.05%	150-160	0	0%
70-80	0.0000	0.00%	160-170	0	0%
80-90	0.0000	0.00%	170-180	0	0%

Photometric Data

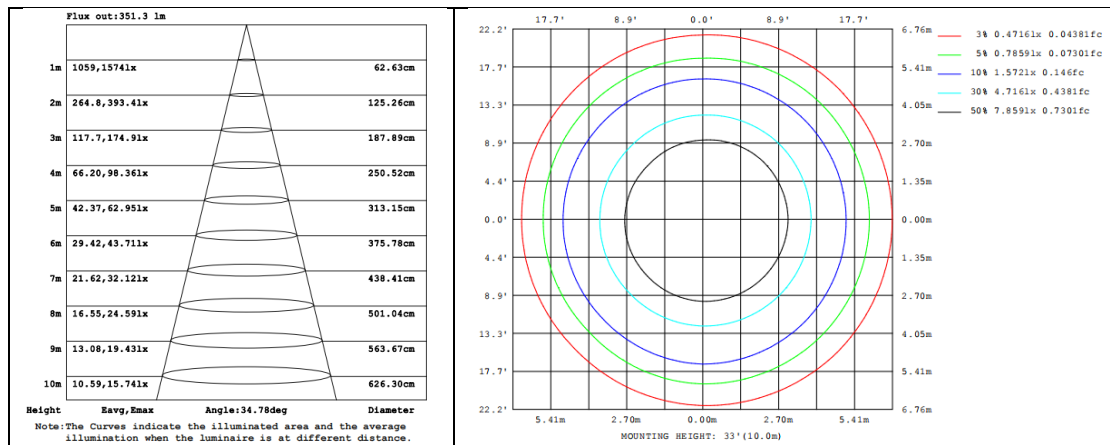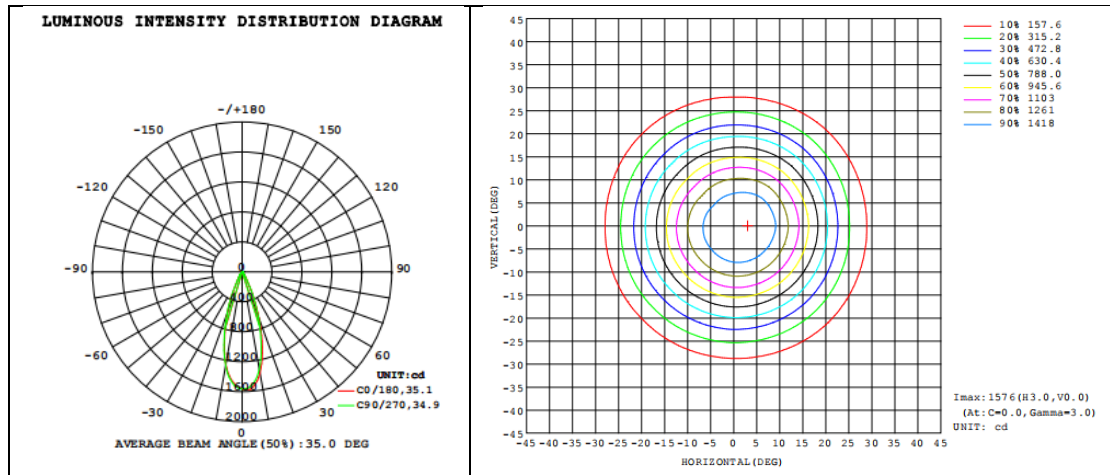

2.1.4 Electrical, Photometric and Chromaticity Measurements

Test date	2024-09-05	Test Ambient:	25.3
Test Orientation	As intended	Stabilization Time (min)	15
Model Number	R2STLB	CCT Setting	4000k

Electrical Measurement:

Sampel No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
#1	120.7	60	0.073	8.61	0.977

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
CCT (K)	4065
Duv	-0.000784
Chromaticity (x, y)	x=0.3771, y=0.3730
Chromaticity (u', v')	u' =0.2244, v' =0.4994
Color Rendering Index (CRI)	94.0
R9	79

Special Color Rendering Indices			
R1	97	R9	79
R2	98	R10	97
R3	96	R11	95
R4	92	R12	75
R5	95	R13	99
R6	95	R14	98
R7	91	R15	95
R8	88	--	--



Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
Total Luminous (lm)	628.586
Luminous Efficacy (lm/W)	73.02
Beam Angle (°)	35.0
Center Beam Candle Power (cd)	1615

Spectral Power Distribution & Chromaticity Diagram

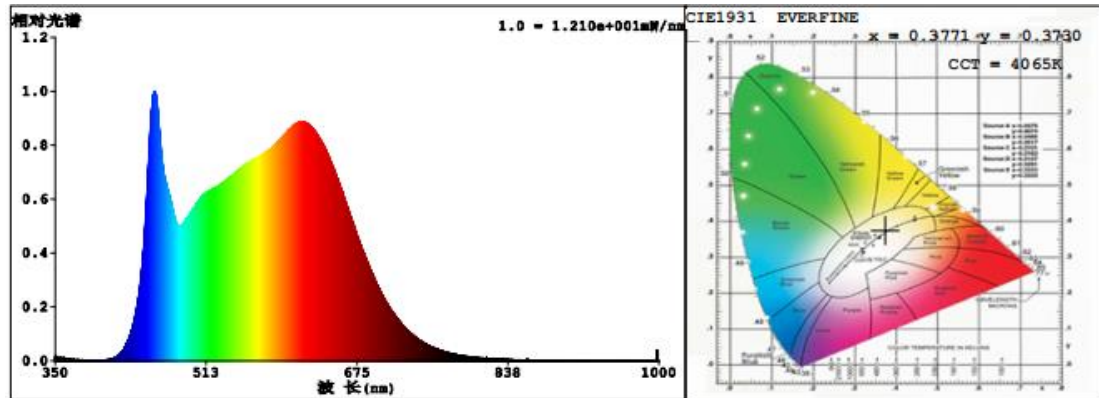

TM30

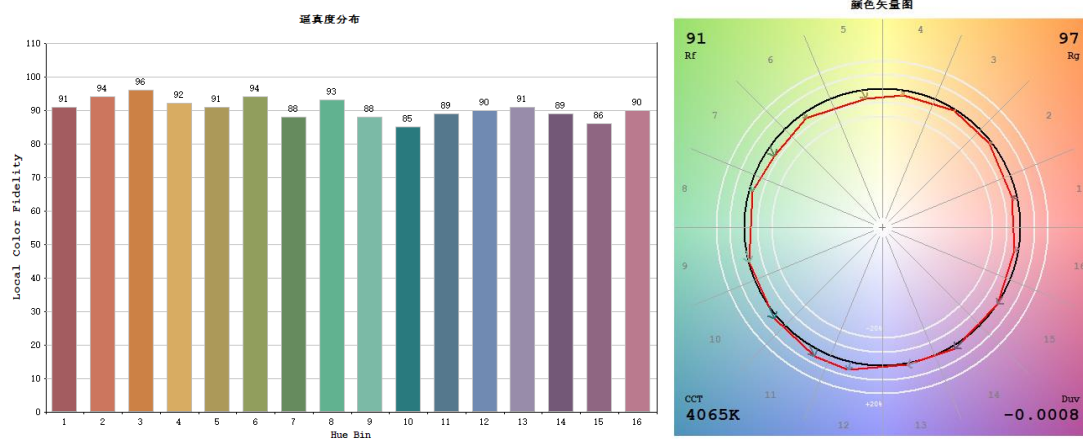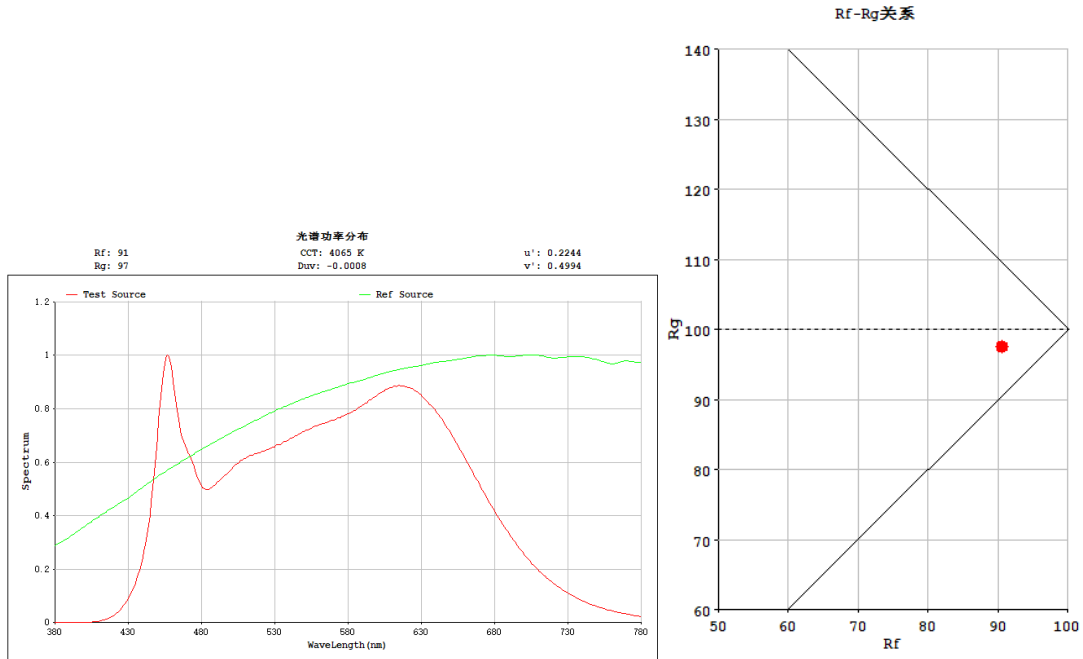


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	560.4	89.15%
0-40	605.9	96.39%
0-60	628.3	99.95%
60-90	0.3	0.05%
70-100	0.0	0.00%
90-120	0.0	0.00%
0-90	628.6	100.00%
90-180	0.0	0.00%
0-180	628.6	100.00%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	141.00	22.43%	90-100	0	0%
10-20	270.1	42.97%	100-110	0	0%
20-30	149.30	23.75%	110-120	0	0%
30-40	45.46	7.23%	120-130	0	0%
40-50	17.69	2.81%	130-140	0	0%
50-60	4.704	0.75%	140-150	0	0%
60-70	0.2997	0.05%	150-160	0	0%
70-80	0.0000	0.00%	160-170	0	0%
80-90	0.0000	0.00%	170-180	0	0%

Photometric Data

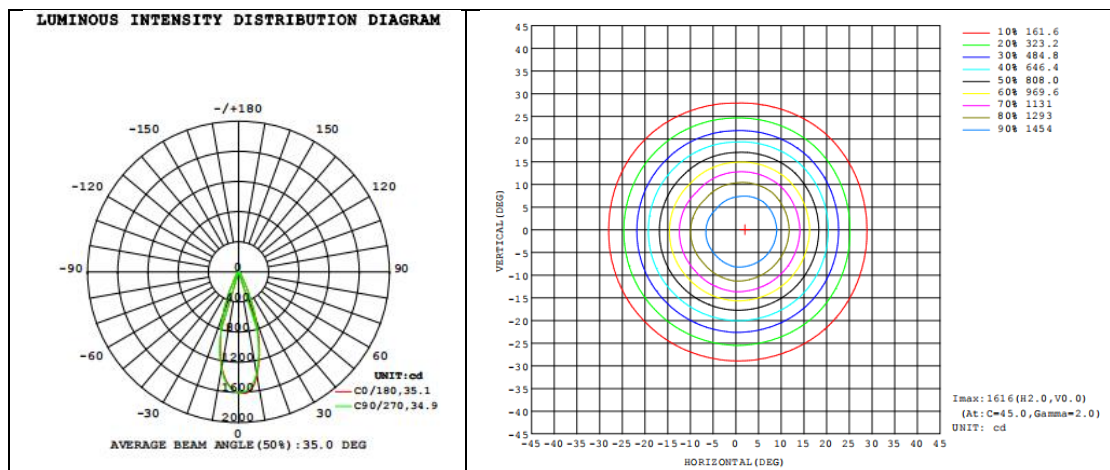

2.1.5 Electrical, Photometric and Chromaticity Measurements

Test date	2024-09-05	Test Ambient:	25.3
Test Orientation	As intended	Stabilization Time (min)	15
Model Number	R2STLB	CCT Setting	5000k

Electrical Measurement:

Sampel No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
#1	120.7	60	0.076	9.01	0.979

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
CCT (K)	5006
Duv	0.00253
Chromaticity (x, y)	x=0.3454, y=0.3569
Chromaticity (u', v')	u' =0.2096, v' =0.4873
Color Rendering Index (CRI)	93.2
R9	65

Special Color Rendering Indices			
R1	94	R9	65
R2	99	R10	98
R3	97	R11	92
R4	91	R12	76
R5	93	R13	97
R6	96	R14	99
R7	91	R15	92
R8	85	--	--


Photometric Measurement – Goniophotometer Method:



Parameter	Result
Test Voltage (V)	120.7
Frequency (Hz)	60
Total Luminous (lm)	610.722
Luminous Efficacy (lm/W)	67.80
Beam Angle (°)	35.1
Center Beam Candle Power (cd)	1561

Spectral Power Distribution & Chromaticity Diagram

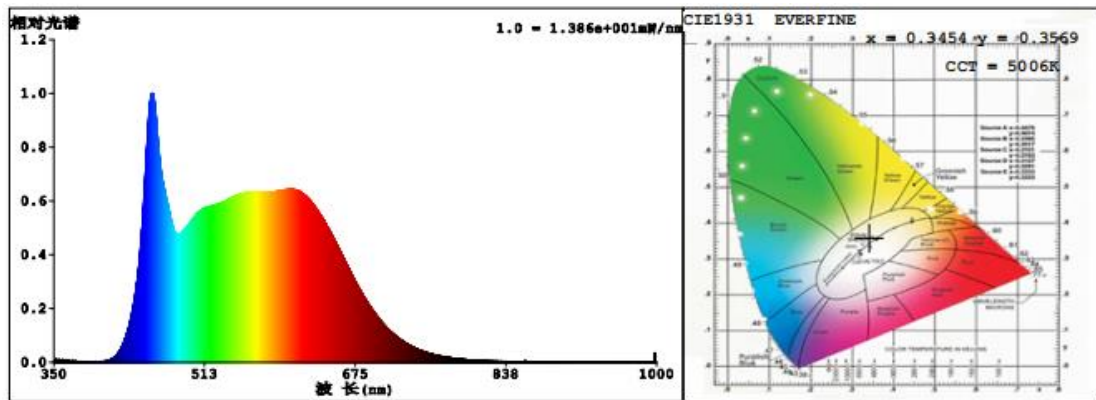

TM30

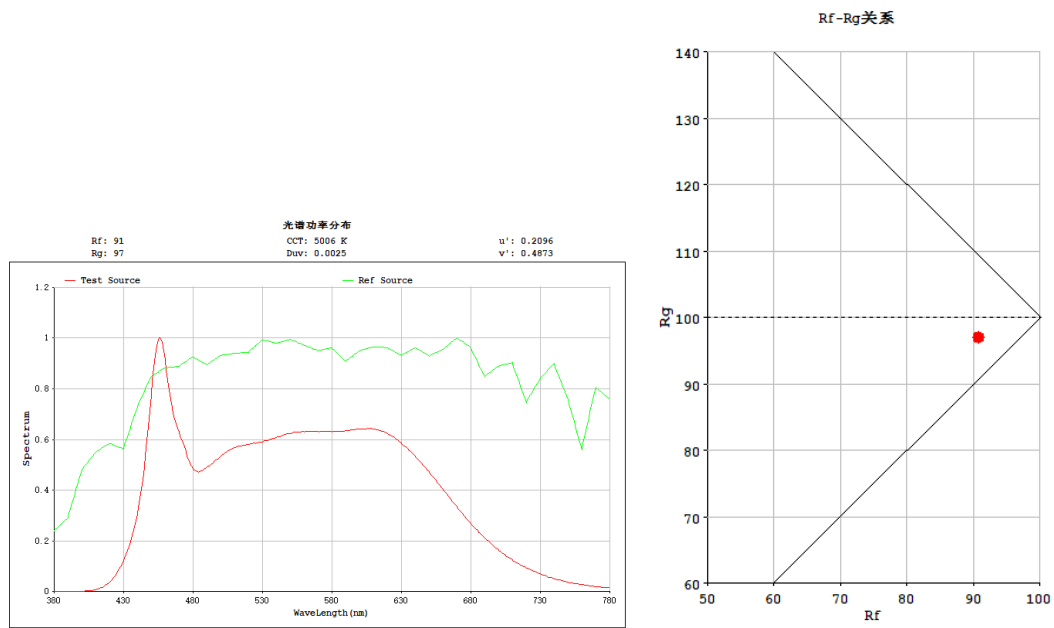

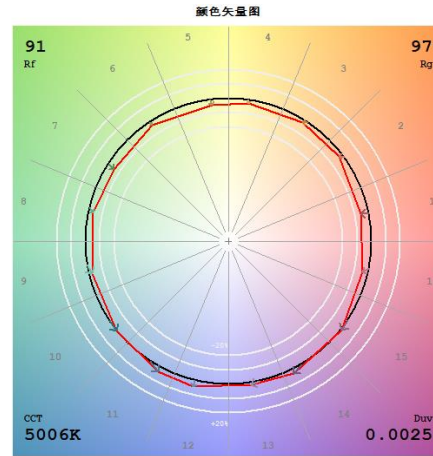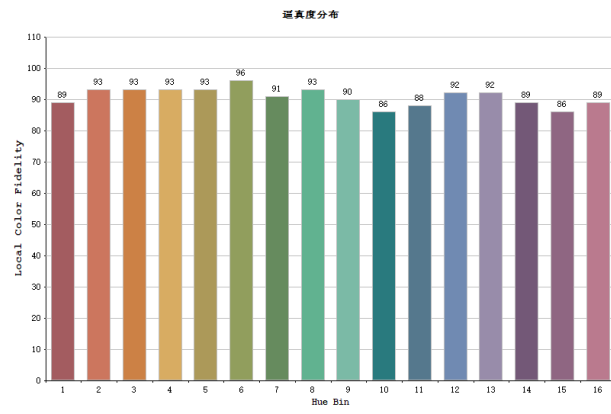

Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	544.0	89.08%
0-40	588.5	96.36%
0-60	610.4	99.95%
60-90	0.3	0.05%
70-100	0.0	0.00%
90-120	0.0	0.00%
0-90	610.7	100.00%
90-180	0.0	0.00%
0-180	610.7	100.00%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	136.40	22.34%	90-100	0	0%
10-20	261.8	42.87%	100-110	0	0%
20-30	145.90	23.89%	110-120	0	0%
30-40	44.49	7.29%	120-130	0	0%
40-50	17.29	2.83%	130-140	0	0%
50-60	4.612	0.76%	140-150	0	0%
60-70	0.2960	0.05%	150-160	0	0%
70-80	0.0000	0.00%	160-170	0	0%
80-90	0.0000	0.00%	170-180	0	0%

Photometric Data

