

# Photometric Test Report

## Relevant Standards

- IES LM-79-2008
- ANSI C82.77:2017

## Prepared For RAB Lighting Inc.

Room 6A33, No.1388, Wuzhong road, Shanghai, China

Xiao Xiang, 15921313292, Gary.Xiao@rabweb.com

## Prepared By

Deliver Co., Ltd.

Block 11, 78 Keling Road, SSTP, Suzhou, China

0512-66801950, kevin.jia@szdeliver.com

## Project Number

DLF2111105

## Report Number

DLF2111105-3a


## Test Date

2021/11/8

## Issue Date


2021/11/11

### Prepared By



Wangzun Zhu

### Approved By



Kevin Jia

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Deliver Co., Ltd.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP.

## 1.0 Test Summary

DLC Technical Requirements v5.1

Outdoor - Pole/Arm-Mounted Area and Roadway Luminaires				
Requirement Category	Test Method	Requirements		Test value
Luminaire Output (lm) (Goniophotometer - Section 4.2)	IES LM-79-2008	1000		37708
Minimum Luminaire Efficacy (lm/W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Standard 105	Premium 120	140.9
Power (Input Wattage) (W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		267.7
Total Harmonic Distortion (A%) (THD & PF - section 4.3)	ANSI C82.77:2014	20.00%	120V	1.89%
		20.00%	277V	4.38%
Power Factor (THD & PF - section 4.3)	ANSI C82.77:2014	0.9	120V	0.999
		0.9	277V	0.966
Allowable CCTs* (K) (Integrating Sphere - Section 4.1)	IES LM-79-2008	7 step	5029±355	5008
		4 step	5029±220	
Minimum CRI (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥70		84
Minimum R9 (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥-40		12
Minimum Rf (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥70		83
Minimum Rg (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥89		93
Minimum IES Rcs,h1 (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	-18% ≤ IES Rcs,h1 ≤ +23%		-12%
Zonal Lumen Requirement (0°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	100%		100.00%
Zonal Lumen Requirement (80°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	≤10%		1.35%
Input Voltage (V)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		120
(Goniophotometer - Section 4.2)		Non-Worst Case		277
Input Current (A)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		2.234
(Goniophotometer - Section 4.2)		Non-Worst Case		0.964
Power (Input Wattage - W)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		267.7
(Goniophotometer - Section 4.2)		Non-Worst Case		257.9

## 2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2021/11/8	ALEDL4T	C1
2	Goniophotometer Test	2021/11/8	ALEDL4T	C1
3	THD and PF Test	2021/11/8	ALEDL4T	C1

### Remark(If any)

1、 This report shall not be used by the client to claim product endorsement by NVLAP, NIST or any agency of the US government.

2、 The results reported herein have been performed in accordance with the laboratory's terms of accreditation. This report shall not be reproduced except in full without the written approval of the Laboratory. The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the product(s) has met the criteria for certification.


## 3.0 Production Description

**Luminaire Description:** ALEDL4T

**Description:** 260W/36,000 lm @ 5000K

**Electrical Specification:** 120V-277V,50/60HZ

### Photos of Luminaire Characteristics

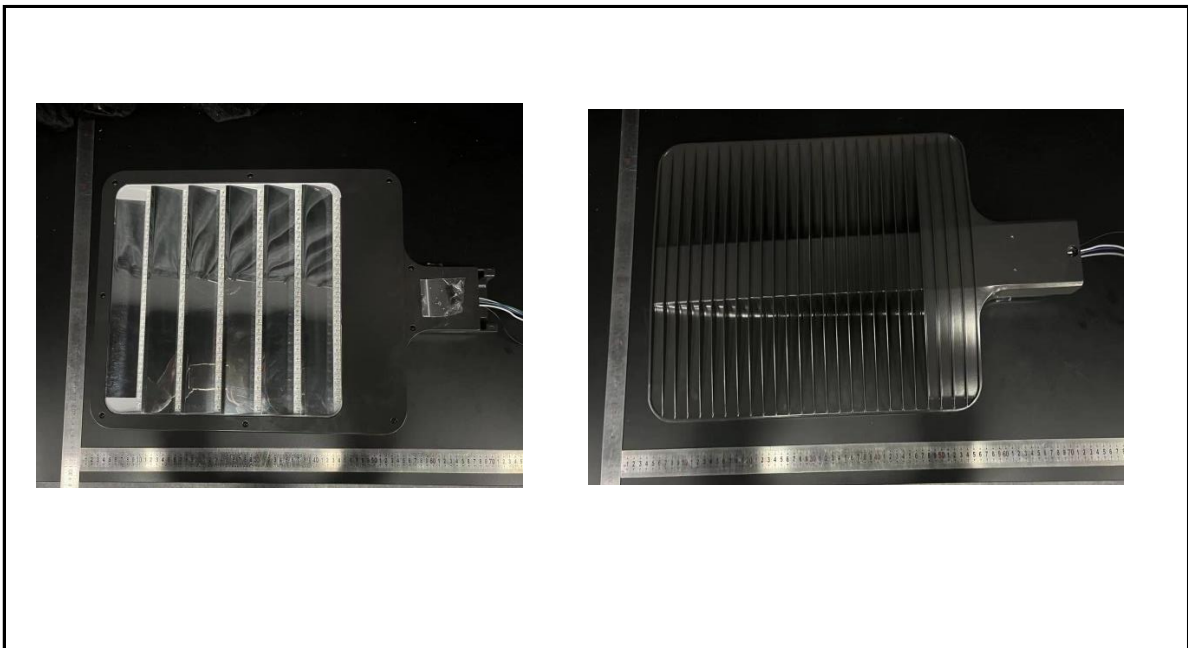

## 4.0 LM-79 Measurement and Test Results

### 4.1 Integrating Sphere Test

Model No.	ALEDL4T	Sample ID.	C1
Operate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	56.0

#### Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at  $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ .

The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within  $\pm 0.2$  percent under load.

The sample was measured using  $4\pi$  geometry and operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

#### Test Result

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
120.00	60	2.222	266.4	0.999
277.01	60	0.962	257.3	0.966


#### Test Result

CCT (K)	CRI	R9	Duv
5008	84	12	0.0012

Rf	Rg	IES Rcs,h1
83	93	-12%

## 4.1 Integrating Sphere Test

### Results

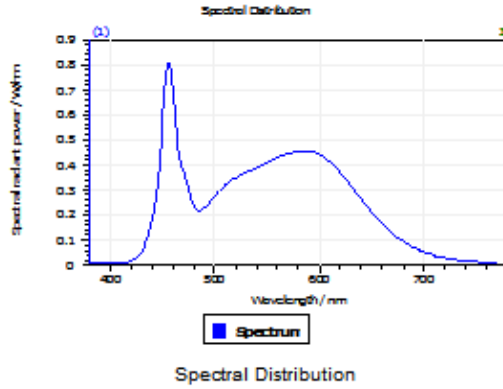

#### Spectral values


DominantWavelength 571.47 nm  
Purity 0.098  
PeakWavelength 456.03 nm  
Radiant Power 89.5 W  
Width50%:

#### Color Coordinates

Correlated Color Temporal 5008 K  
x: 0.3451 u: 0.2105 u': 0.2105  
y: 0.3539 v: 0.3239 v': 0.4858







CRI01	83.4	CRI09	12.4
CRI02	92.9	CRI10	81.7
CRI03	94.8	CRI11	80.0
CRI04	80.9	CRI12	62.2
CRI05	83.3	CRI13	86.6
CRI06	87.9	CRI14	97.9
CRI07	85.0	CRI15	78.3
CRI08	66.4	CRI16	73.8

ResultsCRI 84.3

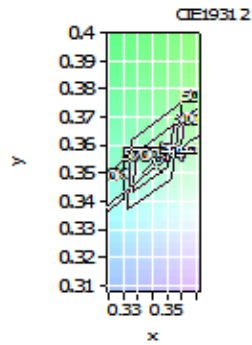

PlanckDistance 1.2E-003

### 4.1 Integrating Sphere Test

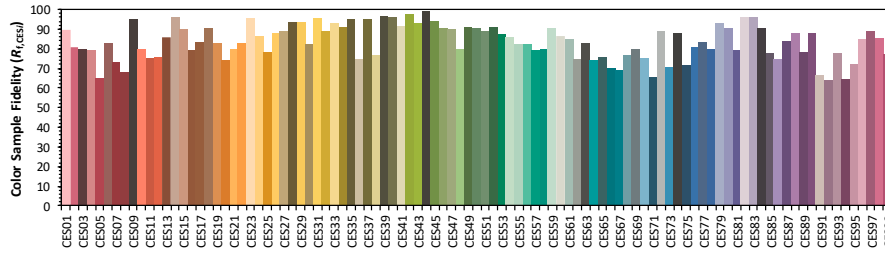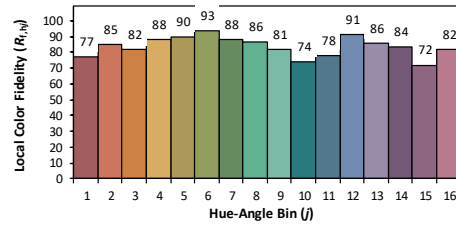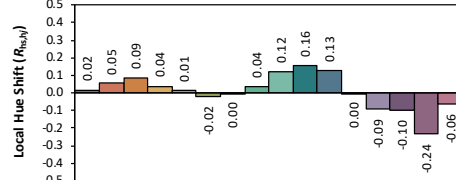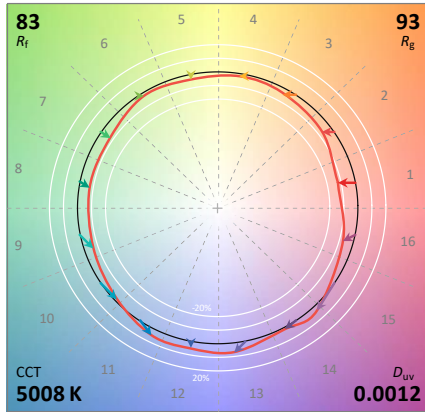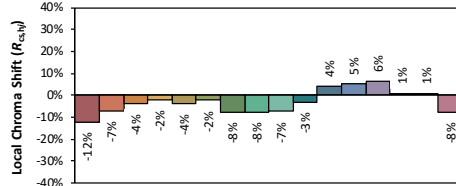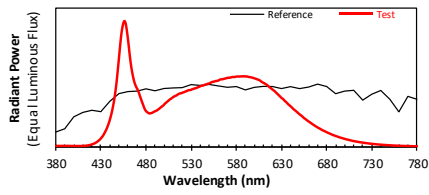

**Notes:** This is a recommended method for displaying ANSI/IES TM-30-18 information.

$x$  0.3451  
 $y$  0.3539  
 $u'$  0.2105  
 $v'$  0.4858

CIE 13.3-1995 (CRI)	
$R_a$	84
$R_g$	13

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.0

## 4.0 LM-79 Measurement and Test Results

### 4.2 Goniophotometer Test

Model No.	ALEDL4T	Sample ID.	C1
Operate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	54.0

#### Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using a type C goniophotometer and software.

The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ±0.2 percent under load.

The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 0.5° vertical intervals and 10° horizontal intervals.

#### Test Conditions

Condition	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
WORST CASE	119.98	60	2.234	267.7	0.999
NON-WROST CASE	277.03	60	0.964	257.9	0.966


#### Test Result

Flux (lm)	Field Angle(10%)		Beam Angle(50%)		Luminous Efficacy (lm/W)
	C0-180	C90-270	C0-180	C90-270	
37708	99.5	148.7	41.0	136.7	140.9


Zonal Lumen Requirement (0°-90°)	Zonal Lumen Requirement (80°-90°)	BUG rating
100.00%	1.35%	B3-U0-G5

## 4.2 Goniophotometer Test

### Light Distribution Curve

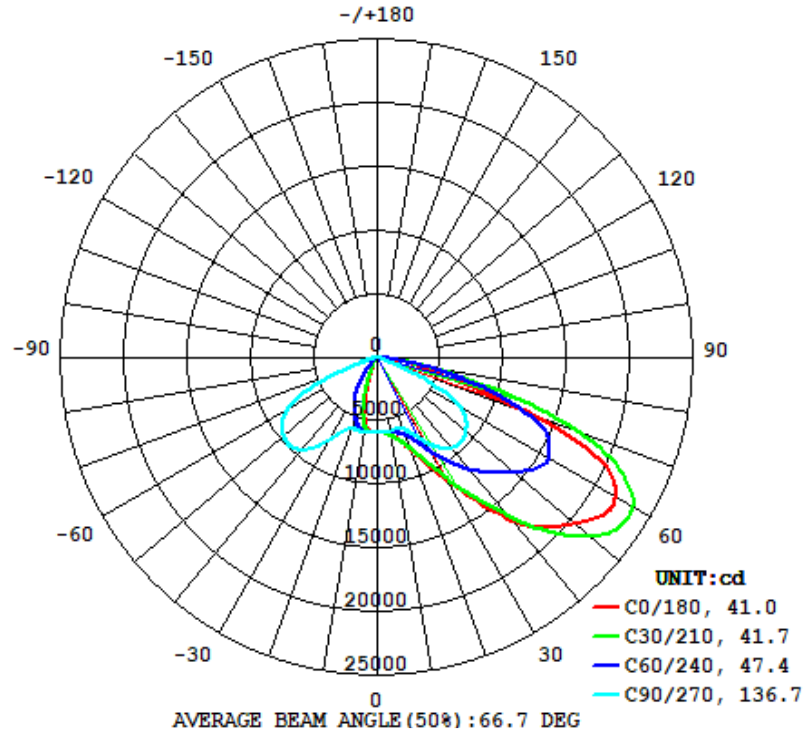

### Isolux Plot

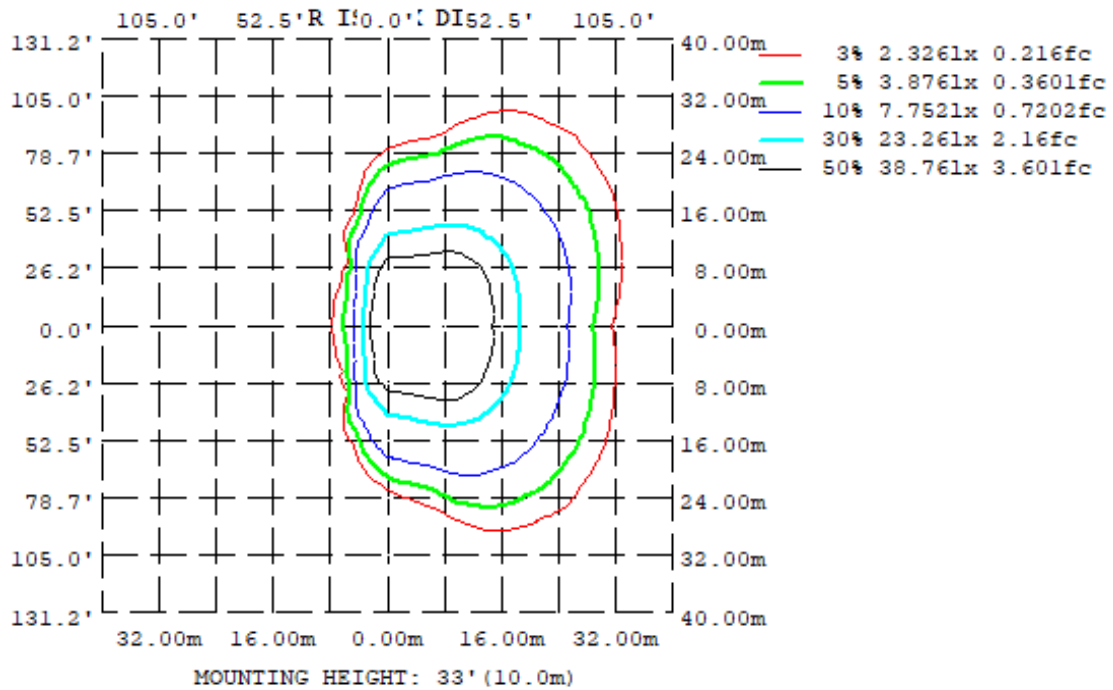



## 4.2 Goniophotometer Test


### Zonal Lumen Summary

γ	C0	C45	C90	C135	C180	C225	C270	C315
10	621.9	618.3	594.9	580.9	535.4	583.9	606.4	615.0
20	762.7	702.5	599.9	397.9	211.0	389.9	598.4	697.1
30	1111	965.1	770.3	161.1	65.32	145.6	739.5	927.6
40	1680	1385	930.9	60.89	39.79	62.53	953.4	1337
50	2031	1892	921.5	36.88	14.74	38.87	966.4	1846
60	2180	2108	737.2	14.17	6.556	15.36	821.2	2171
70	1251	1628	135.7	8.206	4.447	8.719	268.1	1827
80	210.4	416.6	28.70	4.238	2.501	4.753	33.08	616.6
90	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0
DEG	LUMINOUS INTENSITY:*10cd							

	Zonal (lm)		Total (lm)	Percent
0-10	569.61	0 - 10	569.61	1.51%
10-20	1612.47	0 - 20	2182.08	5.79%
20-30	2634.02	0 - 30	4816.10	12.77%
30-40	4470.74	0 - 40	9286.84	24.63%
40-50	6807.48	0 - 50	16094.32	42.68%
50-60	8658.77	0 - 60	24753.09	65.64%
60-70	8387.93	0 - 70	33141.02	87.89%
70-80	4056.96	0 - 80	37197.98	98.65%
80-90	510.44	0 - 90	37708.42	100.00%
90-100	0.00	0 - 100	37708.42	100.00%
100-110	0.00	0 - 110	37708.42	100.00%
110-120	0.00	0 - 120	37708.42	100.00%
120-130	0.00	0 - 130	37708.42	100.00%
130-140	0.00	0 - 140	37708.42	100.00%
140-150	0.00	0 - 150	37708.42	100.00%
150-160	0.00	0 - 160	37708.42	100.00%
160-170	0.00	0 - 170	37708.42	100.00%
170-180	0.00	0 - 180	37708.42	100.00%


## 4.2 Goniophotometer Test

LCS/BUG

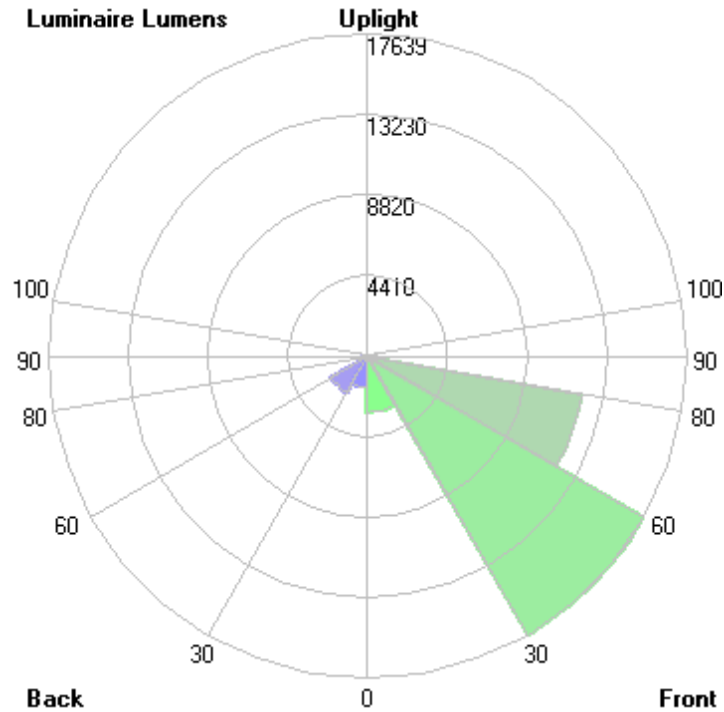


	Lumens	% Lamp	% Luminaire
FL - Front-Low (0-30)	3076.6	N.A.	8.2
FM - Front-Medium (30-60)	17639.4	N.A.	46.8
FH - Front-High (60-80)	12048.6	N.A.	32.0
FVH - Front-Very High (80-90)	491.2	N.A.	1.3
BL - Back-Low (0-30)	1739.5	N.A.	4.6
BM - Back-Medium (30-60)	2297.5	N.A.	6.1
BH - Back-High (60-80)	396.3	N.A.	1.1
BVH - Back-Very High (80-90)	19.3	N.A.	0.1
UL - Uplight-Low (90-100)	0.0	N.A.	0.0
UH - Uplight-High (100-180)	0.0	N.A.	0.0
<b>Total</b>	<b>37708.4</b>	<b>N.A.</b>	<b>100.0</b>
<b>BUG Rating</b>	<b>B3-U0-G5</b>		

Coefficients of Utilization

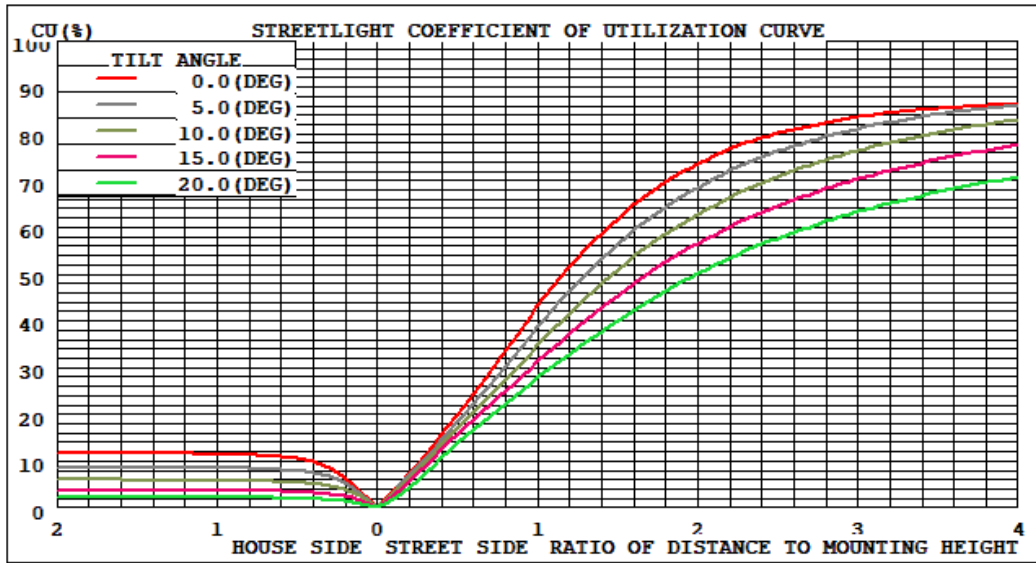

Isolines

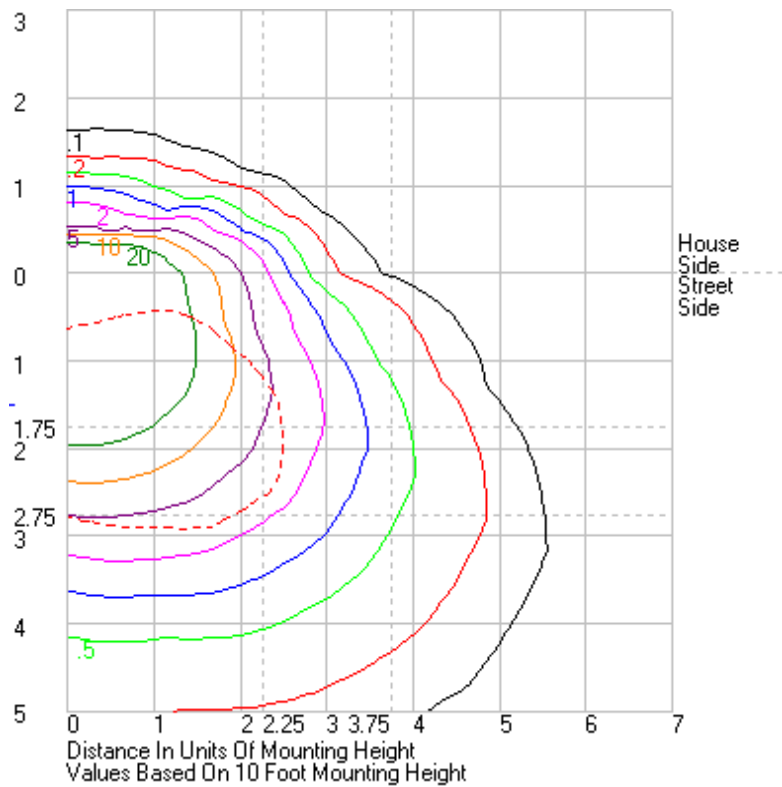

## 4.2 Goniophotometer Test

	0	15	30	45	60	75	90	105	120	135	150	165	180	195	210	225	240	255	270	285	300	315	330	345	360
0	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84	5936.84
1	5921.15	5920.62	5921.03	5922.4	5925.35	5928.58	5931.96	5936.05	5939.67	5941.58	5944.12	5945.23	5958.72	5956.04	5952.34	5947.21	5942.15	5935.12	5928.82	5922.78	5916.61	5910.94	5908.51	5906.69	5921.15
2	5917.82	5919.13	5921.61	5923.57	5927.23	5932.7	5939.94	5948.49	5957.16	5962.96	5968.34	5969.62	5983.7	5980.56	5975.6	5968.28	5959.28	5947.92	5935.73	5924.32	5913.66	5906.53	5902.69	5901.56	5917.82
3	5921.32	5923.78	5928.51	5933.82	5937.9	5941.87	5950.42	5962.85	5974.99	5982.31	5982.94	5979.56	5991.83	5990.5	5990.77	5989.74	5980.02	5965.06	5948.66	5932.15	5919.3	5909.74	5903.62	5902.7	5921.32
4	5933.6	5938.17	5944.76	5948.54	5951.04	5951.97	5960.63	5976.09	5991.48	5991.34	5985.75	5977.86	5988.58	5988.83	5994.52	6001.16	6001.4	5984.76	5964.64	5944.76	5930.2	5918.64	5912.96	5911.44	5933.6
5	5960.28	5967.2	5973.03	5970.62	5967.3	5963.06	5969.32	5986.64	6001.11	5992.75	5977.48	5957.51	5962.1	5968.09	5988.82	6006.54	6017.01	6006.1	5981.98	5961.57	5946.32	5935.23	5932.02	5934.52	5960.28
6	5994.71	6006.49	6014.45	6002.93	5986.21	5973.27	5974.83	5994.38	6001.13	5984.97	5946.86	5910.09	5909.8	5921.58	5960.18	6004.89	6028.1	6026.74	6002.02	5981.56	5969.25	5962	5964.37	5967.49	5994.71
7	6032.36	6050.21	6062.63	6043.9	6006.1	5981.22	5975.83	5999.42	5997.81	5962.02	5901.09	5846.62	5837.57	5860.6	5914.52	5986.13	6034.12	6045.29	6021.73	6004.11	5997.2	5999.66	6002.76	6004.05	6032.36
8	6082.05	6103.87	6113.8	6089.83	6030.88	5984.57	5970.92	5997.62	5987.8	5922.72	5835.96	5741.58	5717.02	5751.72	5851.48	5952.27	6035.33	6061.66	6039.86	6027.07	6029.83	6045.7	6045.14	6047.19	6082.05
9	6145.69	6171.71	6175.8	6134.35	6055.18	5984.86	5962.21	5988.47	5968.67	5874.15	5730.25	5595.32	5561.34	5605.89	5742.67	5907.25	6028.16	6073.65	6056.15	6049.02	6066.5	6097.57	6099.25	6106.32	6145.69
10	6218.98	6251.15	6247.29	6182.97	6079.77	5981.58	5948.58	5974.56	5937.96	5809.19	5601.41	5417.01	5353.6	5422.56	5605.39	5838.8	6007.12	6077.16	6063.68	6065.4	6106.14	6149.65	6166.62	6177.08	6218.98
11	6301.5	6338.07	6332.19	6240.11	6103.75	5972.52	5929.61	5952.22	5893.77	5714.67	5434.32	5178.77	5094.52	5178.79	5437.86	5741.37	5974.59	6072.13	6065.36	6075.84	6145.47	6211.65	6249.06	6258.04	6301.5
12	6392.45	6433.46	6422.48	6302.74	6124.99	5966.51	5913.22	5931.19	5846	5596.93	5232.28	4919.71	4813.83	4917.25	5222.71	5623.32	5931.96	6060.54	6061.04	6082.17	6181.22	6278.6	6337.84	6348.43	6392.45
13	6497.06	6542.49	6525.2	6372.32	6144.89	5959.6	5892.68	5910.14	5792.06	5464.93	5001	4628.57	4505.8	4618.82	4978.69	5485.9	5879.64	6044.21	6051.43	6084.62	6215.46	6353.24	6434.75	6453.01	6497.06
14	6611.92	6663.67	6635.68	6444.52	6169.96	5955.75	5881.64	5891.21	5729.91	5298.37	4742.03	4319.44	4177.09	4305.08	4712.63	5312.26	5808.97	6022.91	6034.97	6084.15	6250.04	6433.16	6537.33	6557.92	6611.92
15	6730.56	6789.4	6753.15	6516.54	6199.45	5959.91	5874.76	5879.34	5659.71	5112.58	4473.2	4000.4	3838.25	3978.24	4436.83	5108.21	5722.21	5995.02	6017.61	6082.24	6284.34	6510.99	6639.9	6662.99	6730.56
16	6868.75	6928.65	6880.63	6595.29	6238.04	5968.26	5872.02	5871.08	5578.47	4904.69	4178.79	3657.06	3491.21	3639.88	4138.23	4896.82	5620.57	5966.01	6000.47	6078.03	6319.41	6575.49	6760.34	6794.43	6868.75
17	7026.99	7086.82	7014.16	6685.04	6287.16	5986.41	5882.04	5870.87	5495.61	4690.28	3876.17	3328.59	3142.73	3301.49	3831.76	4660.92	5514.08	5937.53	5984.84	6076.45	6357.58	6641.01	6897.49	6944.38	7026.99
18	7205.5	7270.63	7165.45	6781.93	6346.15	6015.12	5903.2	5880.27	5416.79	4464.72	3568.38	2991.18	2790.46	2960.81	3519.16	4414.78	5395.03	5909.35	5973.21	6076.41	6399.15	6752.51	7048.07	7126.21	7205.5
19	7404.66	7471.24	7337.83	6896.53	6417.04	6062.04	5942.42	5902.46	5327.46	4224.06	3261.45	2641.67	2440.88	2616.32	3205.2	4160.22	5260.94	5885.51	5970.9	6084.65	6444.81	6855.41	7218.35	7322.43	7404.66
20	7626.82	7694.96	7530.86	7025.19	6503.04	6122.43	5998.74	5935.78	5225.61	3979.02	2949.65	2308.22	2109.8	2283.7	2886.57	3899	5111.73	5874.19	5983.99	6106.9	6500.82	6971.24	7410.72	7536.68	7626.82
21	7864.32	7942.27	7754.07	7178.64	6610.62	6212.98	6083.46	5996.19	5122.68	3733.5	2638.09	1990.69	1800.76	1966.7	2572.66	3629.45	4958.06	5876.58	6014.69	6146.28	6569.89	7103.25	7617	7781.42	7864.32
22	8113.71	8204.06	7995.73	7357.17	6734.69	6321.66	6182.34	6067.32	5014.82	3484.05	2340.27	1700.86	1535.64	1686.36	2267.84	3363.91	4805.25	5891.23	6065.81	6200.76	6638.95	7245.89	7849.27	8028.24	8113.71
23	8388.87	8491	8273.48	7568.3	6890.67	6451.71	6309.42	6153.54	4903.97	3239.86	2043.69	1431.26	1287.51	1440.04	1971.96	3099.22	4647.25	5917.24	6141.26	6281.2	6727.19	7422.66	8098.95	8298.33	8388.87
24	8691.48	8803.17	8566.23	7803.78	7066.97	6618.85	6465.17	6268.53	4799	2994.46	1778.15	1192.99	1067.24	1194.39	1713.06	2834.16	4484.3	5957.28	6244.17	6386.81	6856.26	7618.32	8373.34	8594.7	8691.48
25	9034.3	9149.61	8885.84	8058.49	7269.29	6785.78	6624.87	6370.72	4670.25	2744.48	1539.14	1008.06	917.38	1016.31	1491.49	2571.5	4326.9	6012.07	6376.82	6520.12	7008.46	7838.78	8661.96	8926.36	9034.3
26	9403.02	9545.4	9238.41	8350.78	7499.09	6996.08	6832.8	6506.4	4550.08	2505.96	1312.35	870.54	812.73	880.82	1269.91	2319.35	4165.34	6077.35	6535.13	6679.14	7192.19	8072.91	8977.17	9285.54	9403.02
27	9798.42	9957.76	9617.04	8643.43	7736.94	7216.25	7040.63	6634.44	4417.3	2261.84	1120.06	780.64	746.86	794.09	1078.84	2071.81	3998.43	6152.43	6720.75	6863.78	7396.53	8345.86	9322.74	9693.54	9798.42
28	10203.8	10394.2	10020.2	8957.31	7994.87	7440.46	7250.96	6751.79	4265.52	2031.24	972.51	722.3	708.75	737.57	935.14	1846.44	3835.78	6236.01	6926.71	7072.65	7627.14	8633.29	9695.84	10115.3	10203.8
29	10642.8	10843.7	10444.6	9298.56	8272.17	7698.61	7492.23	6888.31	4128.05	1821.33	848.91	686.49	681.4	706.36	832.62	1637.45	3671.26	6322.5	7153.17	7300.27	7884.29	8942.13	10111.7	10550.4	10642.8
30	11113	11325.2	10888.8	9650.93	8552.66	7930.96	7702.62	6986.69	3959.44	1611.04	766.53	660.09	653.19	678.43	766.31	1455.76	3499.87	6410.05	7395.16	7548.47	8152.64	9276.16	10536	11014.5	11113
31	11591.1	11827.1	11336.9	10027	8858.15	8176.62	7926.01	7087.02	3793.99	1416.71	711.56	635.91	624.6	649.52	721.03	1274.08	3330.22	6488.53	7643.48	7809.81	8440.34	9619.64	10976	11503.8	11591.1
32	12094.9	12361.8	11807.8	10401.3	9160.84	8426.59	8155.2	7173.51	3626.67	1229.84	673.89	611.73	598.64	621.92	692.1	1110.05	3148.65	6550.6	7893.51	8072.28	8747.61	9991.13	11433	12018	12094.9
33	12624.7	12917.5	12290.7	10795.2	9459.01	8657.56	8348.6	7222.41	3427.92	1072.58	650.63	588.05	573.21	596.71	666.43	971.05	2958.64	6599.46	8146.46	8342.68	9058.73	10373.3	11913.4	12555.5	12624.7
34	13173.7	13490.3	12789.3	11205.8	9774.81	8899.92	8558.38	7269.6	3241.21	935.79	627.45	564.26	548.49	572.48	641.5	861.84	2768.65	6630.62	8385.2	8605.16	9374.82	10767.3	12408.5	13114.4	13173.7
35	13739.2	14063.2	13317.5	11611.9	10079.3	9122.56	8726.32	7274.77	3023.82	821.58	604.23	540.15	523.65	547.83	618.34	787.95	2570.19	6647.42	8620.6	8862.88	9693.14	11180	12917.6	13681.4	13739.2
36	14304.7	14665.3	13851.5	12033.5	10399.3	9329.61	8882.03	7256.16	2812.93	747.19	582.03	516.39	499.14	523.44	595.16	732.91	2367	6647.55	8844.98	9119.69	10013.2	11599.3	13449.2	14290.8	14304.7
37	14923.8	15309	14385.6	12483.7	10712.1	9535.17	9024.01	7227.86	2597.47	690.8	559.33	491.88	474.1	499.05	572.07	696.78	2172.42	6626.2	9052.75	9364.17	10328.1	12026.6	13993.5	14922.2	14923.8
38	15548.6	15974.1	14961.7	12922.9	11008.7	9707.2	9128.66	7154.22	2370.72	658.81	535.99	467.97	449.1	474.66	548.73	672.19	1980.22	658							







161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

## 4.0 LM-79 Measurement and Test Results

### 4.3 THD and PF Test

Model No.	ALEDL4T	Sample ID.	C1
Temperature (°C)	25.3	Humidity (%RH)	56.0

#### Test Method

The samples were tested according to the ANSI C82.77:2002.  
 The total harmonic distortion shall be measured to the 40th order.  
 The ambient temperature condition was maintained at 25° C ± 1° C. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion were calculated.

#### Test Results

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	THD
120.00	60	2.222	266.4	0.999	1.89%
277.01	60	0.962	257.3	0.966	4.38%

## 5.0 Equipment Information

Test Equipment			
Equipment ID	Equipment Name	Last Calibration Date	Calibration Due Date
DLF107	Integrating Sphere System	2020/12/26	2021/12/25
DLF108	Auxiliary Lamp	2020/12/26	2021/12/25
DLF122	Measurement Standard Lamp Standard Lamp Type: 220 V, 0.4720 A, Tungsten, Omni-derectional	2020/12/26	2021/12/25
DLF116	AC Power Source	2020/12/26	2021/12/25
DLF113	Power Meter	2020/12/26	2021/12/25
DLF112	Temperature Recorder	2020/12/26	2021/12/25
DLF114	Temperature & Humidity Datalogger	2020/12/26	2021/12/25
DLF101	Goniophotometer	2020/12/26	2021/12/25
DLF125	Standard Lamp Standard Lamp Type: 76.58 V, 6.7875 A, Tungsten, Omni-derectional	2020/12/26	2021/12/25
DLF104	AC Power Source	2020/12/26	2021/12/25
DLF507	DC Power Source	2020/12/26	2021/12/25
DLF102	Power Meter	2020/12/26	2021/12/25
DLF111	Temperature & Humidity Datalogger	2020/12/26	2021/12/25
DLF119	Power Meter	2020/12/26	2021/12/25
DLF031	Temperature data logger	2020/12/26	2021/12/25
DLF022	Digital power meter	2020/12/26	2021/12/25
DLF003	Temperature & Humidity Datalogger	2020/12/26	2021/12/25

\*\*\*\*\* End of Test Report\*\*\*\*\*