

Photometric Test Report

Relevant Standards

- ☒ IES LM-79-2008
- ☒ ANSI C82.77:2017

Prepared For

RAB Lighting Inc.

Room 6A33, No.1388, Wuzhong road, Shanghai, China

Xiao Xiang, 15921313292, Gary.Xiao@rabweb.com

Prepared By

Deliver Co., Ltd.

Block 11, 78 Keling Road, SSTP, Suzhou, China

0512-66801950, kevin.jia@szdeliver.com

Project Number

DLF2301106

Report Number

DLF2301106-46a

Test Date

2023/2/6

Issue Date

2023/2/7

Prepared By



Wangzun Zhu

Approved By



Kevin Jia

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Deliver Co., Ltd.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP.

1.0 Test Summary

DLC Technical Requirements v5.1

Outdoor - Pole/Arm-Mounted Area and Roadway Luminaires				
Requirement Category	Test Method	Requirements		Test value
Luminaire Output (lm) (Goniophotometer - Section 4.2)	IES LM-79-2008	1000		19524
Minimum Luminaire Efficacy (lm/W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Standard 105	Premium 120	132.5
Power (Input Wattage) (W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		147.3
Total Harmonic Distortion (A%) (THD & PF - section 4.3)	ANSI C82.77:2014	20.00%	120V	3.59%
		20.00%	277V	8.04%
Power Factor (THD & PF - section 4.3)	ANSI C82.77:2014	0.9	120V	1.000
		0.9	277V	0.956
Allowable CCTs* (K) (Integrating Sphere - Section 4.1)	IES LM-79-2008	7 step	3045±175	2933
		4 step	3045±100	
Minimum CRI (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥70		82
Minimum R9 (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥-40		4
Minimum Rf (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥70		84
Minimum Rg (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥89		94
Minimum IES Rcs,h1 (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	-18%≤IES Rcs,h1≤+23%		-12%
Zonal Lumen Requirement (0°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	100%		100.00%
Zonal Lumen Requirement (80°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	≤10%		1.09%
Input Voltage (V)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		120
(Goniophotometer - Section 4.2)		Non-Worst Case		277
Input Current (A)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		1.228
(Goniophotometer - Section 4.2)		Non-Worst Case		0.544
Power (Input Wattage - W)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		147.3
(Goniophotometer - Section 4.2)		Non-Worst Case		144.0

2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2023/2/6	ALEDM3TY	AT1
2	Goniophotometer Test	2023/2/6	ALEDM3TY	AT1
3	THD and PF Test	2023/2/6	ALEDM3TY	AT1

Remark(If any)

- 1、 This report shall not be used by the client to claim product endorsement by NVLAP, NIST or any agency of the US government.
- 2、 The results reported herein have been performed in accordance with the laboratory's terms of accreditation. This report shall not be reproduced except in full without the written approval of the Laboratory. The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the product(s) has met the criteria for certification.


3.0 Production Description

Luminaire Description: ALEDM3TY

Description: 150W @ 3000K

Electrical Specification: 120V-277V,50/60HZ

Photos of Luminaire Characteristics

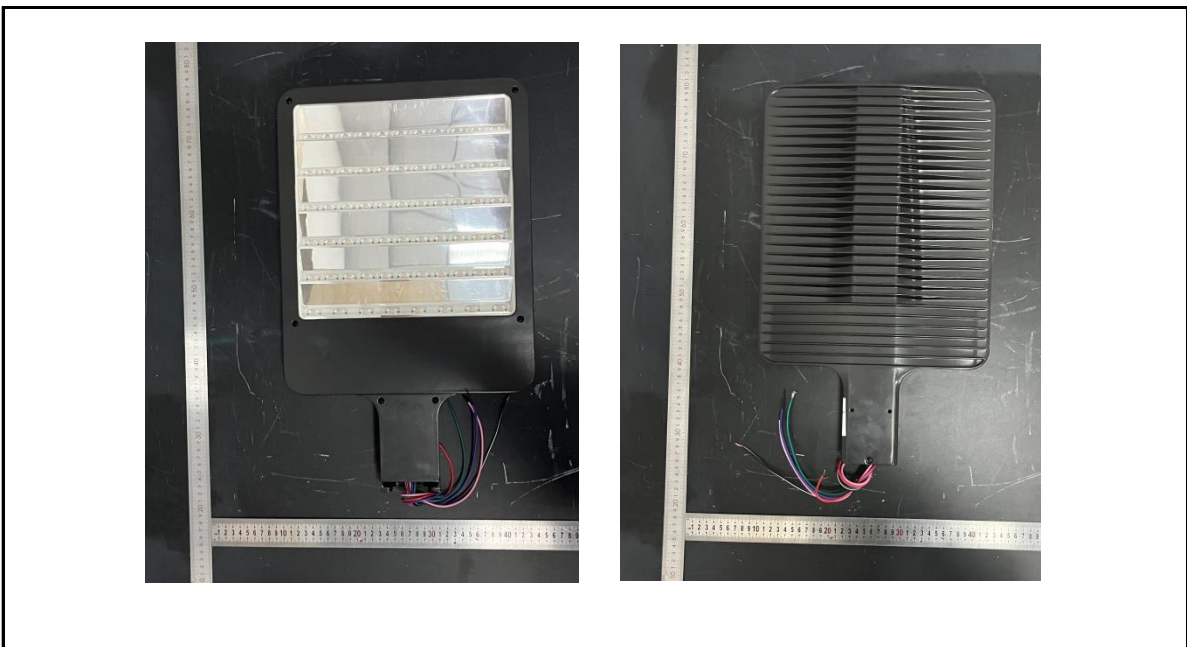

4.0 LM-79 Measurement and Test Results

4.1 Integrating Sphere Test

Model No.	ALEDM3TY	Sample ID.	AT1
Opreate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric paramters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The sample was measured using 4π geometry and operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

Test Result

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
120.07	60	1.223	146.9	1.000
277.11	60	0.542	143.6	0.956


Test Result

CCT (K)	CRI	R9	Duv
2933	82	4	0.0012

Rf	Rg	IES Rcs,h1
84	94	-12%

4.1 Integrating Sphere Test

Results

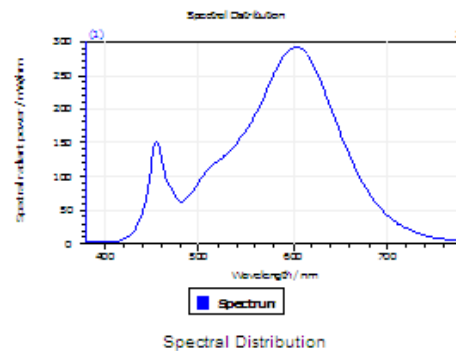


Spectral values

DominantWavelength 583.53 nm
Purity 0.528
PeakWavelength 603.03 nm
Radiant Power 42.35 W
Width50%:

Color Coordinates

Correlated Color Temperat 2933 K
x: 0.4401 u: 0.2534 u': 0.2534
y: 0.4022 v: 0.3474 v': 0.5211
CRI01 80.7 CRI09 4.1
CRI02 92.4 CRI10 82.9
CRI03 94.1 CRI11 77.8
CRI04 78.8 CRI12 73.3
CRI05 81.3 CRI13 83.6
CRI06 91.0 CRI14 97.5
CRI07 80.6 CRI15 73.2
CRI08 56.4 CRI16 69.9
ResultsCRI 81.9

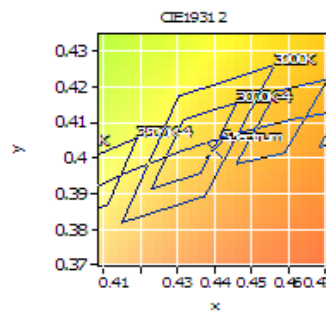

PlandDistance 1.2E-003

4.1 Integrating Sphere Test


IES TM-30-18 Color Rendition Report

Source: DLF2301106-46a

Manufacturer: RAB Lighting Inc.

Date: 2023/2/6

Model: ALEDM3TY

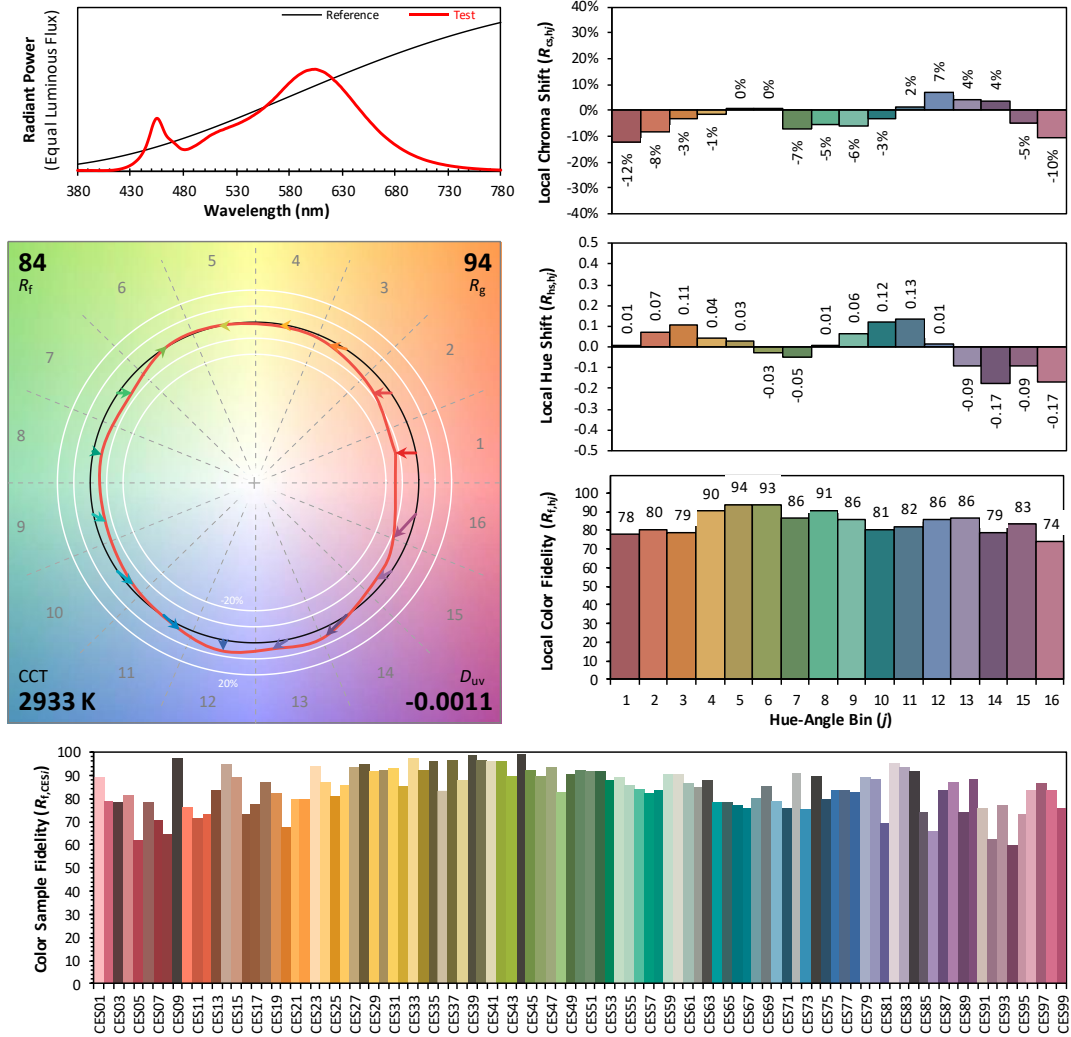

Notes: This is a recommended method for displaying IES TM-30-18 information.

x 0.4401
 y 0.4022
 u' 0.2534
 v' 0.5211

CIE 13.3-1995
 (CRI)

R_a 82
 R_9 6

4.0 LM-79 Measurement and Test Results

4.2 Goniophotometer Test

Model No.	ALEDM3TY	Sample ID.	AT1
Opreate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	54.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric paramters were measured using a type C goniophotometer and software.

The ambient temperature shall be maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$, measured at a point not more than 1 m from the sample and at the same height as the sample.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 0.5° vertical intervals and 10° horizontal intervals.

Test Conditions

Condition	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
WORST CASE	120.00	60	1.228	147.3	1.000
NON-WROST CASE	277.00	60	0.544	144.0	0.956


Test Result

Flux (lm)	Field Angle(10%)		Beam Angle(50%)		Luminous Efficacy (lm/W)
	C0-180	C90-270	C0-180	C90-270	
19524	91.2	164.2	37.0	152.5	132.5


Zonal Lumen Requirement (0° - 90°)	Zonal Lumen Requirement (80° - 90°)	BUG rating
100.00%	1.09%	B2-U0-G3

4.2 Goniophotometer Test

Light Distrubtion Curve

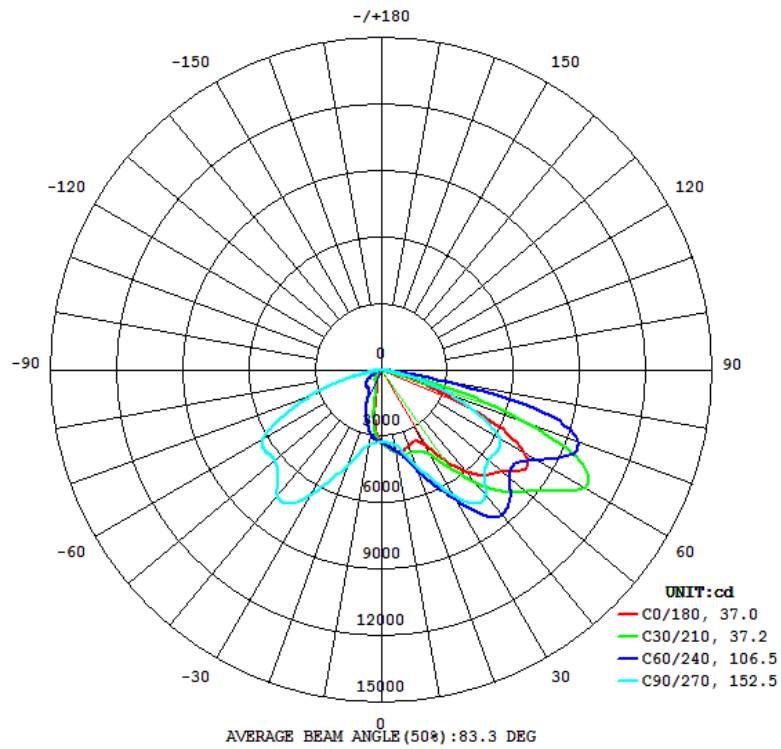

Isolux Plot

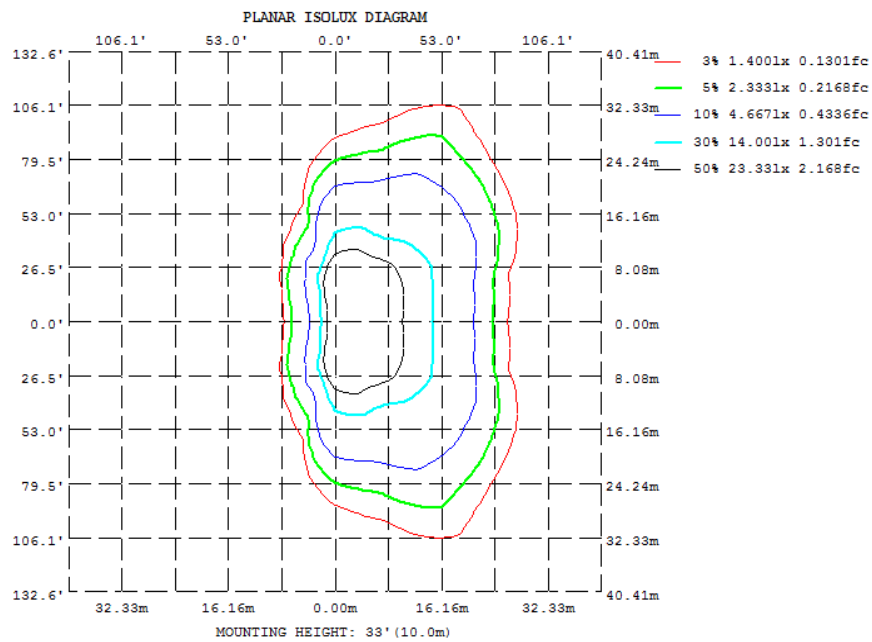

4.2 Goniophotometer Test


Zonal Lumen Summary

γ	C0	C45	C90	C135	C180	C225	C270	C315
10	377.3	376.7	344.5	253.4	184.7	253.4	344.5	376.7
20	366.2	441.0	462.5	109.3	60.97	109.3	462.5	441.0
30	391.8	558.9	656.0	77.08	44.11	77.08	656.0	558.9
40	602.6	719.2	738.6	76.15	21.77	76.15	738.6	719.2
50	716.4	913.5	633.3	42.90	12.92	42.90	633.3	913.5
60	746.1	999.3	621.3	22.92	6.527	22.92	621.3	999.3
70	267.4	926.4	347.1	9.313	2.612	9.313	347.1	926.4
80	16.67	123.0	58.40	3.273	1.142	3.273	58.40	123.0
90	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0
DEG	LUMINOUS INTENSITY: *10cd							

	Zonal (lm)		Total (lm)	Percent
0-10	308.21	0 - 10	308.21	1.58%
10-20	863.95	0 - 20	1172.16	6.00%
20-30	1544.46	0 - 30	2716.62	13.91%
30-40	2591.11	0 - 40	5307.73	27.19%
40-50	3480.80	0 - 50	8788.53	45.01%
50-60	4154.89	0 - 60	12943.42	66.29%
60-70	4210.50	0 - 70	17153.92	87.86%
70-80	2157.44	0 - 80	19311.36	98.91%
80-90	213.10	0 - 90	19524.46	100.00%
90-100	0.00	0 - 100	19524.46	100.00%
100-110	0.00	0 - 110	19524.46	100.00%
110-120	0.00	0 - 120	19524.46	100.00%
120-130	0.00	0 - 130	19524.46	100.00%
130-140	0.00	0 - 140	19524.46	100.00%
140-150	0.00	0 - 150	19524.46	100.00%
150-160	0.00	0 - 160	19524.46	100.00%
160-170	0.00	0 - 170	19524.46	100.00%
170-180	0.00	0 - 180	19524.46	100.00%


4.2 Goniophotometer Test

LCS/BUG

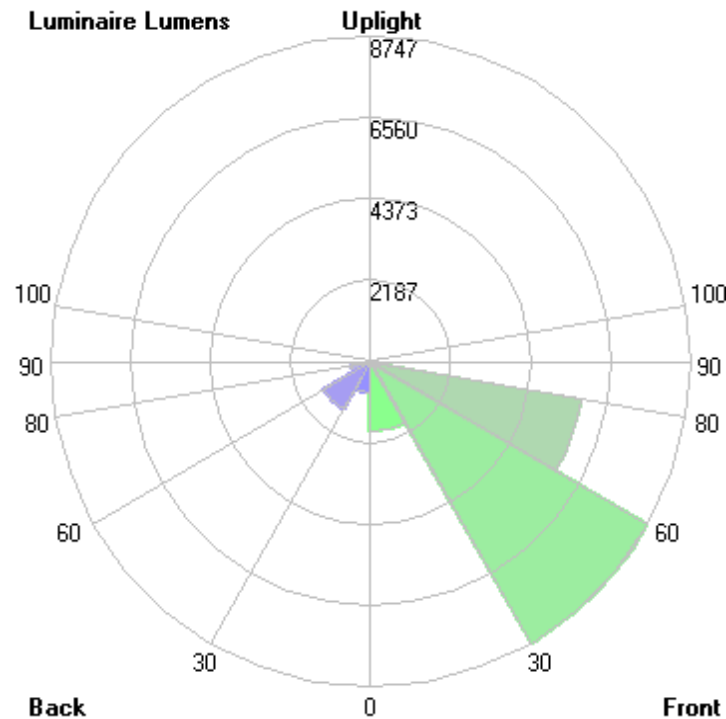


	Lumens	% Lamp	% Luminaire
FL - Front-Low (0-30)	1871.5	N.A.	9.6
FM - Front-Medium (30-60)	8746.6	N.A.	44.8
FH - Front-High (60-80)	5852.2	N.A.	30.0
FVH - Front-Very High (80-90)	194.4	N.A.	1.0
BL - Back-Low (0-30)	845.1	N.A.	4.3
BM - Back-Medium (30-60)	1480.2	N.A.	7.6
BH - Back-High (60-80)	515.7	N.A.	2.6
BVH - Back-Very High (80-90)	18.7	N.A.	0.1
UL - Uplight-Low (90-100)	0.0	N.A.	0.0
UH - Uplight-High (100-180)	0.0	N.A.	0.0
Total	19524.4	N.A.	100.0
BUG Rating	B2-U0-G3		

Coefficients of Utilization

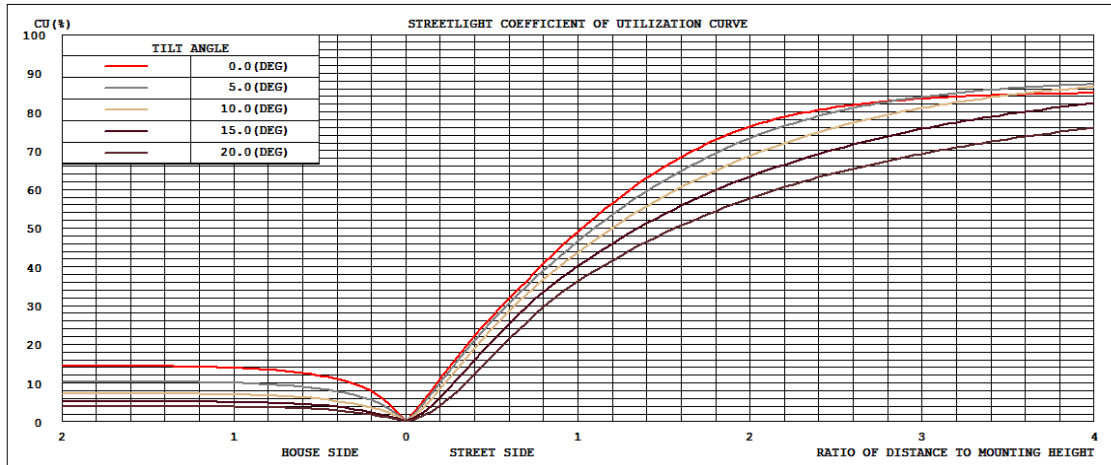

Isolines

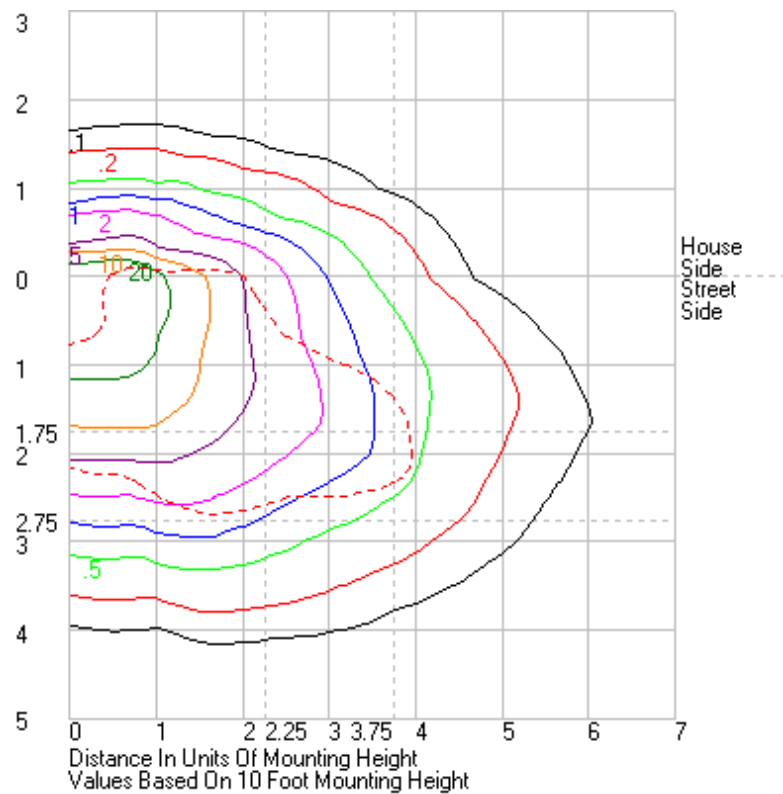

4.2 Goniophotometer Test

	0	15	30	45	60	75	90	105	120	135	150	165	180	195	210	225	240	255	270	285	300	315	330	345	360	
0	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	3269.6	
1	3317.75	3312.79	3307.42	3300.21	3291.15	3280.42	3268.77	3256.93	3246.16	3236.18	3227.46	3222.68	3224.71	3222.68	3227.46	3236.18	3246.16	3256.93	3268.77	3280.42	3291.15	3300.21	3307.42	3312.79	3317.75	
2	3368.78	3361.4	3353.6	3339.23	3321.37	3298.92	3275.26	3252.38	3229.72	3209.59	3191.71	3179.04	3177.89	3179.04	3191.71	3209.59	3229.72	3252.38	3275.26	3298.92	3321.37	3339.23	3353.6	3361.4	3368.78	
3	3430.69	3421.85	3409.45	3385.98	3358.85	3324.3	3288	3251.68	3215.53	3174.77	3138.36	3112.2	3105.85	3112.2	3138.36	3174.77	3215.53	3251.68	3288	3324.3	3358.85	3385.98	3409.45	3421.85	3430.69	
4	3487.67	3479.69	3464.19	3438.04	3399.44	3351.89	3302.48	3252.39	3196.59	3134.84	3074.32	3027.61	3007.2	3027.61	3074.32	3134.84	3196.59	3252.39	3302.48	3351.89	3399.44	3438.04	3464.19	3479.69	3487.67	
5	3543.53	3533.26	3521.19	3491.97	3445.48	3384.7	3319.22	3255.7	3176.85	3082.2	2980.2	2898.54	2870.23	2898.54	2980.2	3082.2	3176.85	3255.7	3319.22	3384.7	3445.48	3491.97	3521.19	3533.26	3543.53	
6	3594.93	3587.29	3575.2	3549.27	3494	3418.4	3337.92	3258.6	3151.47	3008.25	2849.52	2735.44	2686.91	2735.44	2849.52	3008.25	3151.47	3258.6	3337.92	3418.4	3494	3549.27	3575.2	3587.29	3594.93	
7	3641.12	3634.29	3627.56	3603.46	3546.23	3456.32	3359.02	3262.95	3121.06	2914.6	2708.12	2558.5	2494.88	2558.5	2708.12	2914.6	3121.06	3262.95	3359.02	3456.32	3546.23	3603.46	3627.56	3634.29	3641.12	
8	3693.64	3687.38	3682.14	3658.34	3599.06	3497.04	3383.16	3266.56	3079.77	2803.33	2534.87	2344.42	2273.35	2344.42	2534.87	2803.33	3079.77	3266.56	3383.16	3497.04	3599.06	3658.34	3682.14	3687.38	3693.64	
9	3738.49	3737.84	3735.85	3712.27	3650.46	3540.16	3410.69	3271.3	3022.57	2677.77	2351.84	2148.66	2060.37	2148.66	2351.84	2677.77	3022.57	3271.3	3410.69	3540.16	3650.46	3712.27	3735.85	3737.84	3738.49	
10	3773.26	3777.65	3790.77	3767.29	3706.23	3589.1	3445.36	3278.54	2959.97	2534.13	2177.42	1936.09	1847	1936.09	2177.42	2534.13	2959.97	3278.54	3445.36	3589.1	3706.23	3767.29	3790.77	3777.65	3773.26	
11	3799.07	3809.5	3840.09	3827.11	3762.89	3646.1	3489.18	3291.27	2886.45	2383.25	1979.58	1715.3	1610.31	1715.3	1979.58	2383.25	2886.45	3291.27	3489.18	3646.1	3762.89	3827.11	3840.09	3809.5	3799.07	
12	3814.18	3831.28	3877.51	3885.44	3827.64	3713.86	3544.1	3308.42	2866.94	2236.92	1798.7	1517.28	1412.06	1517.28	1798.7	2236.92	2866.94	3308.42	3544.1	3713.86	3827.64	3885.44	3877.51	3831.28	3814.18	
13	3824.84	3845.98	3909.4	3943.41	3903.24	3796.58	3617.78	3334.16	2723.5	2080.51	1604.31	1311.99	1213.82	1311.99	1604.31	2080.51	2723.5	3334.16	3617.78	3796.58	3903.24	3943.41	3909.4	3845.98	3824.84	
14	3824.95	3856.72	3935.21	3996.94	3989.36	3900.89	3713.74	3370.14	2630.94	1923.37	1426.41	1127.69	1029.88	1127.69	1426.41	1923.37	2630.94	3370.14	3713.74	3900.89	3989.36	3996.94	3935.21	3856.72	3824.95	
15	3805.51	3852.03	3959.13	4051.83	4090.12	4028.02	3832.6	3419.17	2548.81	1767.15	1253.87	973.38	896.28	973.38	1253.87	1767.15	2548.81	3419.17	3832.6	4028.02	4090.12	4051.83	3959.13	3852.03	3805.51	
16	3771.51	3829.64	3977.08	4110.26	4213.05	4179.53	3972.41	3485.84	2468.82	1610.34	1085.53	846.45	782.23	846.45	1085.53	1610.34	2468.82	3485.84	3972.41	4179.53	4213.05	4110.26	3977.08	3829.64	3771.51	
17	3743.63	3807.21	3983.52	4169.86	4355.99	4348.45	4131.06	3559.39	2395.81	1468.62	963.06	764.1	716.2	764.1	963.06	1468.62	2395.81	3559.39	4131.06	4348.45	4355.99	4169.86	3983.52	3807.21	3743.63	
18	3713.85	3785.23	3982.31	4242.57	4515.53	4535.36	4297.79	3640.22	2332.06	1327.42	862.18	708.08	671.67	708.08	862.18	1327.42	2332.06	3640.22	4297.79	4535.36	4515.53	4242.57	3982.31	3785.23	3713.85	
19	3684.71	3765.23	3982.98	4323.45	4681.71	4727.85	4463.88	3717.01	2252.51	1202.3	791.08	670.54	637.09	670.54	791.08	1202.3	2252.51	3717.01	4463.88	4727.85	4681.71	4323.45	3982.98	3765.23	3684.71	
20	3662.04	3749.16	3985.7	4409.52	4868.64	4919.24	4624.99	3789.7	2172.99	1093.38	748.45	642.58	609.72	642.58	748.45	1093.38	2172.99	3789.7	4409.52	4868.64	4919.24	4868.64	4409.52	3985.7	3749.16	3662.04
21	3633.08	3735.73	3994.07	4504.32	5059.79	5103.77	4779.83	3843.08	2087.65	1003.24	714.36	615.3	583.19	615.3	714.36	1003.24	2087.65	3843.08	4779.83	5103.77	5059.79	4504.32	3994.07	3735.73	3633.08	
22	3603.95	3720.25	4008.36	4606.95	5241.44	5281.2	4929.21	3886.73	1987.41	933.89	689.22	591.83	560.54	591.83	689.22	933.89	1987.41	3886.73	4929.21	5281.2	5241.44	4606.95	4008.36	3720.25	3603.95	
23	3574.74	3699.72	4033.15	4726.77	5419.38	5460.26	5090.44	3918.98	1882.84	884.22	667.59	569.89	540.22	569.89	667.59	884.22	1882.84	3918.98	5090.44	5460.26	5419.38	4726.77	4033.15	3699.72	3574.74	
24	3555.55	3684.61	4060.97	4852.21	5586.19	5647.31	5257.76	3950.51	1766.17	855.19	647.63	550.9	521.8	550.9	647.63	855.19	1766.17	3950.51	5257.76	5647.31	5586.19	4852.21	4060.97	3684.61	3555.55	
25	3535.25	3685.51	4088.75	4984.5	5758.32	5848.43	5446.1	3981.4	1654.36	834.37	630.58	536.13	507.1	536.13	630.58	834.37	1654.36	3981.4	4984.5	5758.32	5848.43	4984.5	4088.75	3685.51	3535.25	
26	3573.69	3699.41	4120.76	5116.1	5927.04	6081.97	5650.85	4016.52	1544.34	817.68	614.33	521.3	492.4	521.3	614.33	817.68	1544.34	4016.52	5650.85	6081.97	5927.04	5116.1	4120.76	3699.41	3573.69	
27	3620.55	3735.74	4164.82	5245.78	6107.63	6329.61	5868.49	4051.63	1439.42	804.27	602.39	509.18	478.71	509.18	602.39	804.27	1439.42	4051.63	5868.49	6329.61	6107.63	5245.78	4164.82	3735.74	3620.55	
28	3695.09	3801.22	4231.74	5373.86	6295.5	6595.49	6094.78	4085.55	1347.63	790.67	592.84	497.18	466.26	497.18	592.84	790.67	1347.63	4085.55	6094.78	6595.49	6295.5	5373.86	4231.74	3801.22	3695.09	
29	3805.54	3908.82	4311.33	5483.68	6518.26	6870.75	6327.92	4111.94	1262.73	780.09	584.24	485.34	453.36	485.34	584.24	780.09	1262.73	4111.94	6327.92	6870.75	6518.26	5483.68	4311.33	3908.82	3805.54	
30	3918.15	4039.53	4421.2	5589.05	6756.82	7161.02	6559.69	4125.48	1185.8	770.77	577.52	474.28	441.09	474.28	577.52	770.77	1185.8	4125.48	6559.69	7161.02	6756.82	5589.05	4421.2	4039.53	3918.15	
31	4076.27	4198.04	4557.6	5685.88	7002.49	7451.05	6774.64	4123.93	1133.06	761.49	570.91	461.26	428.74	461.26	570.91	761.49	1133.06	4123.93	6774.64	7451.05	7002.49	5685.88	4557.6	4198.04	4076.27	
32	4256.85	4386.1	4730.94	5778.64	7253.22	7728	6972.4	4101.22	1093.84	755.73	564.75	449.1	416.29	449.1	564.75	755.73	1093.84	4101.22	6972.4	7728	7253.22	5778.64	4730.94	4386.1	4256.85	
33	4453.24	4584.28	4924.48	5889.12	7506.55	7992.99	7146.43	4043.4	1075.03	751.18	558.33	436.7	404.99	436.7	558.33	751.18	1075.03	4043.4	7146.43	7992.99	7506.55	5889.12	4924.48	4584.28	4453.24	
34	4699.93	4813.34	5129.85	6009.71	7739.84	8231.96	7288.72	3953.42	1065.25	748.38	550.55	423.34	387.05	423.34	550.55	748.38	1065.25	3953.42	7288.72	8231.96	7739.84	6009.71	5129.85	4813.34	4699.93	
35	4929.26	5039.55	5352.79	6155	7964.27	8446.8	7400.2	3831.12	1059.75	748.52	544.35	407.85	365.33	407.85	544.35	748.52	1059.75	3831.12	7400.2	8446.8	7964.27	6155	5352.79	5039.55	4929.26	
36	5180.05	5292.18	5597.97	6326.98	8164.32	8627.3	7477.46	3686	1058.58	750.74	537.91	384.33	336.07	384.33	537.91	750.74	1058.58	3686	7477.46	8627.3	8164.32	6326.98	5597.97	5292.18	5180.05	
37	5414.93	5549.09	5847.73	6521.91	8329.25	8770.89	7511.09	3518.58	1057.75	753.83	529.65	355.69	302.49	355.69	529.65	753.83	1057.75	3518.58	7511.09	8770.89	8329.25	6521.91	5847.73	5549.09	5414.93	
38	5615.28	5775.11	6108.55	6734.39	8450.25	8873.1	7508.77	3324.48	1059.16	757.01	516.65	325.06	271.65	325.06	516.65	757.01	1059.16	3324.48	7508.77	8873.1	8450.25	6734.39	6108.55	5775.11	5615.28	
39	5835.42	6011.58	6377.96	6957.																						

Page 13 of 17

Page 14 of 17



161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

4.0 LM-79 Measurement and Test Results

4.3 THD and PF Test

Model No.	ALEDM3TY	Sample ID.	AT1
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the ANSI C82.77:2002.

The total harmonic distortion shall be measured to the 40th order.

The ambient temperature condition was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion were calculated.

Test Results

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	THD
120.07	60	1.223	146.9	1.000	3.59%
277.11	60	0.542	143.6	0.956	8.04%

5.0 Equipment Information

Test Equipment			
Equipment ID	Equipment Name	Last Calibration Date	Calibration Due Date
DLF107	Integrating Sphere System	2022/12/26	2023/12/25
DLF108	Auxiliary Lamp	2022/12/26	2023/12/25
DLF122	Measurement Standard Lamp Standard Lamp Type: 220 V, 0.4720 A, Tungsten, Omni-derectional	2022/12/26	2023/12/25
DLF116	AC Power Source	2022/12/26	2023/12/25
DLF113	Power Meter	2022/12/26	2023/12/25
DLF112	Temperature Recorder	2022/12/26	2023/12/25
DLF114	Temperature & Humidity Datalogger	2022/12/26	2023/12/25
DLF101	Goniophotometer	2022/12/26	2023/12/25
DLF125	Standard Lamp Standard Lamp Type: 76.58 V, 6.7875 A, Tungsten, Omni-derectional	2022/12/26	2023/12/25
DLF104	AC Power Source	2022/12/26	2023/12/25
DLF507	DC Power Source	2022/12/26	2023/12/25
DLF102	Power Meter	2022/12/26	2023/12/25
DLF111	Temperature & Humidity Datalogger	2022/12/26	2023/12/25
DLF119	Power Meter	2022/12/26	2023/12/25
DLF031	Temperature data logger	2022/12/26	2023/12/25
DLF022	Digital power meter	2022/12/26	2023/12/25
DLF003	Temperature & Humidity Datalogger	2022/12/26	2023/12/25

***** End of Test Report*****