



Photometric Test Report

Relevant Standards

- IES LM-79-2008
- ANSI C82.77:2017

Prepared For RAB Lighting Inc.

Room 6A33, No.1388, Wuzhong road, Shanghai, China

Xiao Xiang, 15921313292, Gary.Xiao@rabweb.com

Prepared By

Deliver Co., Ltd.

Block 11, 78 Keling Road, SSTP, Suzhou, China

0512-66801950, kevin.jia@szdeliver.com

Project Number

DLF2111115

Report Number

DLF2111115-11a

Test Date

2021/11/30

Issue Date

2021/12/3

Prepared By

Wangzun Zhu

Wangzun Zhu

Approved By

Kevin Jia

Kevin Jia

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Deliver Co., Ltd.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP.

1.0 Test Summary

DLC Technical Requirements v5.1

Outdoor - Pole/Arm-Mounted Area and Roadway Luminaires				
Requirement Category	Test Method	Requirements		Test value
Luminaire Output (lm) (Goniophotometer - Section 4.2)	IES LM-79-2008	1000		19991
Minimum Luminaire Efficacy (lm/W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Standard 105	Premium 120	136.2
Power (Input Wattage) (W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		146.8
Total Harmonic Distortion (A%) (THD & PF - section 4.3)	ANSI C82.77:2014	20.00%	120V	3.67%
		20.00%	277V	8.10%
Power Factor (THD & PF - section 4.3)	ANSI C82.77:2014	0.9	120V	1.000
		0.9	277V	0.957
Allowable CCTs* (K) (Integrating Sphere - Section 4.1)	IES LM-79-2008	7 step	3985±275	3936
		4 step	3985±154	
Minimum CRI (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥70		82
Minimum R9 (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥-40		5
Minimum Rf (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥70		84
Minimum Rg (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥89		95
Minimum IES Rcs,h1 (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	-18% ≤ IES Rcs,h1 ≤ +23%		-12%
Zonal Lumen Requirement (0°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	100%		100.00%
Zonal Lumen Requirement (80°-90°) (Goniophotometer - Section 4.2)	IES LM-79-2008	≤10%		0.29%
Input Voltage (V)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		120
(Goniophotometer - Section 4.2)		Non-Worst Case		277
Input Current (A)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		1.223
(Goniophotometer - Section 4.2)		Non-Worst Case		0.547
Power (Input Wattage - W)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Worst Case		146.8
(Goniophotometer - Section 4.2)		Non-Worst Case		145.0

2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2021/11/30	ALEDMATN	K1
2	Goniophotometer Test	2021/11/30	ALEDMATN	K1
3	THD and PF Test	2021/11/30	ALEDMATN	K1

Remark(If any)

- 1、 This report shall not be used by the client to claim product endorsement by NVLAP, NIST or any agency of the US government.
- 2、 The results reported herein have been performed in accordance with the laboratory's terms of accreditation. This report shall not be reproduced except in full without the written approval of the Laboratory. The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the product(s) has met the criteria for certification.


3.0 Production Description

Luminaire Description: ALEDMATN

Description: 150W/18,000 lm @ 4000K

Electrical Specification: 120V-277V,50/60HZ

Photos of Luminaire Characteristics

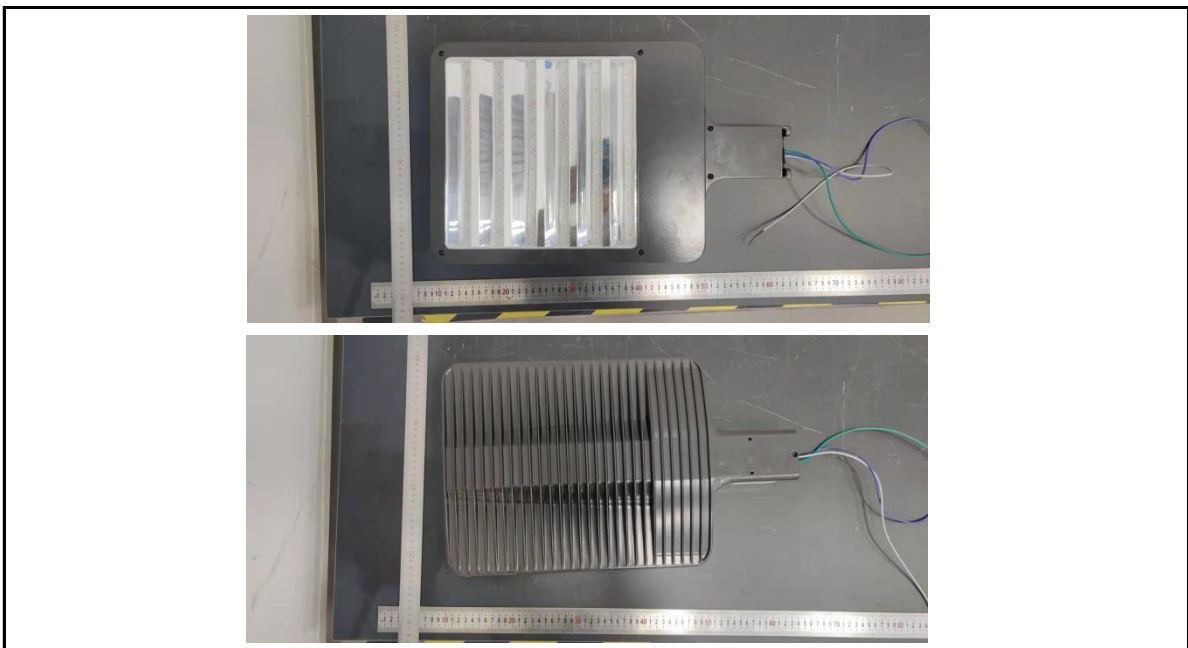

4.0 LM-79 Measurement and Test Results

4.1 Integrating Sphere Test

Model No.	ALEDMATN	Sample ID.	K1
Operate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The sample was measured using 4π geometry and operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

Test Result

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
120.00	60	1.220	146.3	1.000
276.94	60	0.543	144.0	0.957


Test Result

CCT (K)	CRI	R9	Duv
3936	82	5	0.00031

Rf	Rg	IES Rcs,h1
84	95	-12%

4.1 Integrating Sphere Test

Results

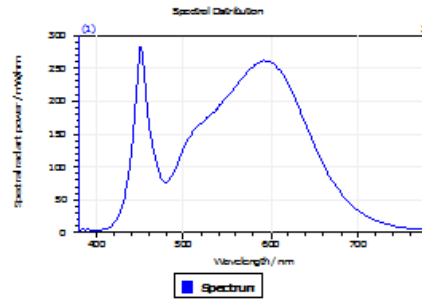

Spectral values


DominantWavelength	579.15 nm
Purity	0.290
PeakWavelength	451.15 nm
Radiant Power	45.34 W
Width50%	21.26 nm

Color Coordinates

Correlated Color Temperatur 3936 K







x: 0.3835 u: 0.2261 u': 0.2261
y: 0.3793 v: 0.3354 v': 0.5032

ResultsCRICRI01	80.2	ResultsCRICRI09	4.5
ResultsCRICRI02	89.4	ResultsCRICRI10	75.3
ResultsCRICRI03	95.3	ResultsCRICRI11	79.3
ResultsCRICRI04	80.5	ResultsCRICRI12	64.2
ResultsCRICRI05	80.8	ResultsCRICRI13	82.4
ResultsCRICRI06	85.8	ResultsCRICRI14	97.8
ResultsCRICRI07	84.7	ResultsCRICRI15	73.4
ResultsCRICRI08	62.0	ResultsCRICRI16	71.2
ResultsCRI	82.4		



PlanckDistance 3.1E-004

4.1 Integrating Sphere Test

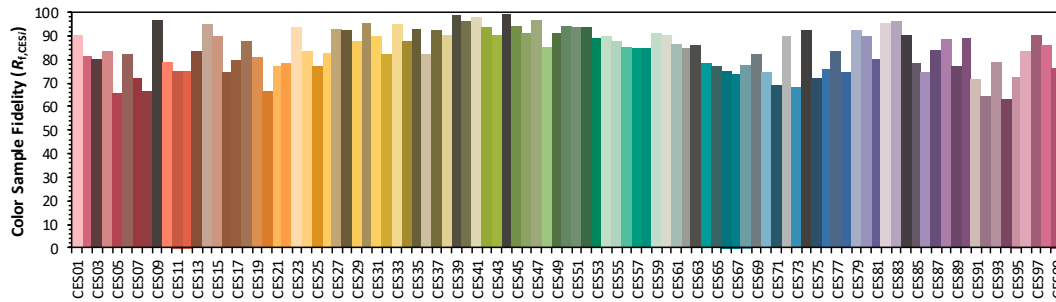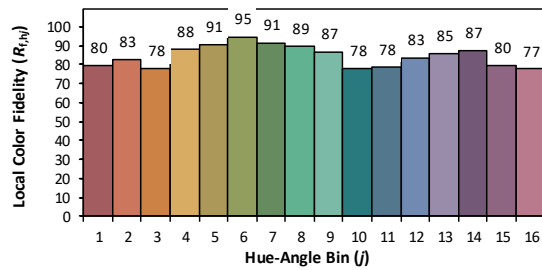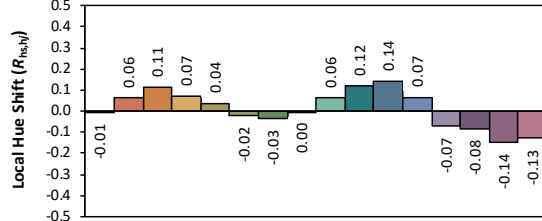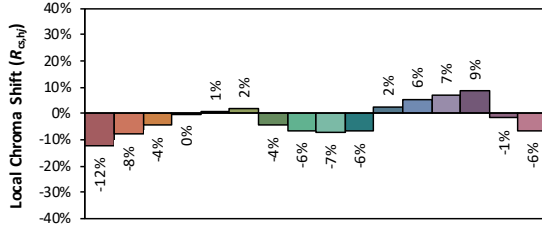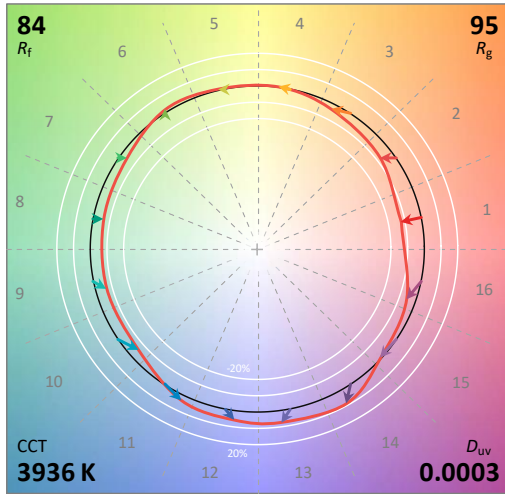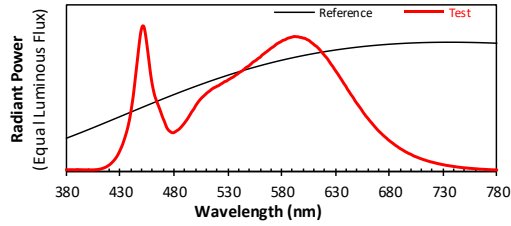

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.3835
 y 0.3793
 u' 0.2261
 v' 0.5032

CIE 13.3-1995 (CRI)	
R_a	83
R_g	6

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.0

4.0 LM-79 Measurement and Test Results

4.2 Goniophotometer Test

Model No.	ALEDMATN	Sample ID.	K1
Operate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	54.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using a type C goniophotometer and software.

The ambient temperature shall be maintained at 25° C ± 1° C, measured at a point not more than 1 m from the sample and at the same height as the sample.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ±0.2 percent under load.

The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 0.5° vertical intervals and 10° horizontal intervals.

Test Conditions

Condition	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
WORST CASE	120.06	60	1.223	146.8	1.000
NON-WROST CASE	277.01	60	0.547	145.0	0.957


Test Result

Flux (lm)	Field Angle(10%)		Beam Angle(50%)		Luminous Efficacy (lm/W)
	C0-180	C90-270	C0-180	C90-270	
19991	94.7	153.4	46.7	138.3	136.2


Zonal Lumen Requirement (0°-90°)	Zonal Lumen Requirement (80°-90°)	BUG rating
100.00%	0.29%	B3-U0-G2

4.2 Goniophotometer Test

Light Distribution Curve

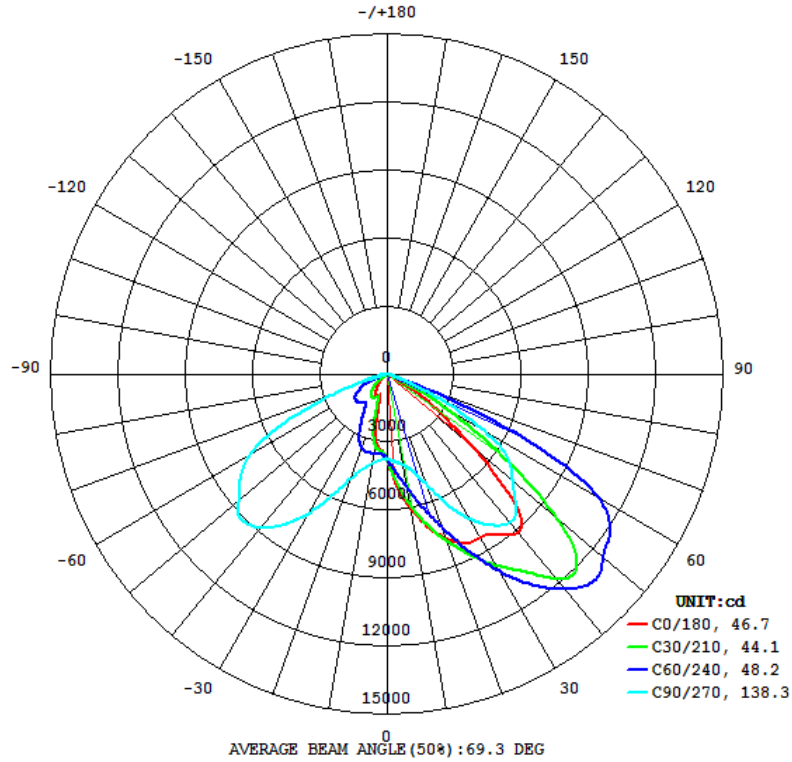

Isolux Plot

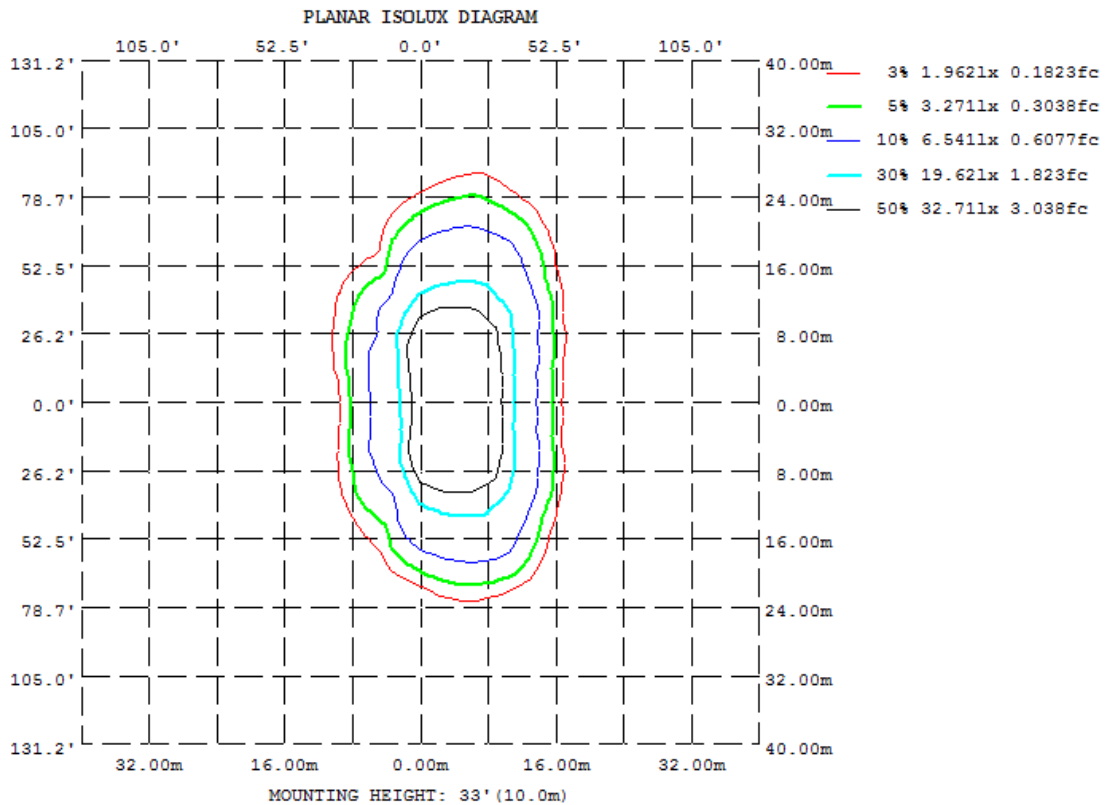

4.2 Goniophotometer Test


Zonal Lumen Summary

γ	C0	C45	C90	C135	C180	C225	C270	C315
10	595.4	557.8	407.1	339.9	294.4	342.2	400.6	549.8
20	771.7	759.9	517.2	179.5	96.21	217.2	491.9	740.4
30	831.2	1006	736.2	126.6	103.2	125.9	708.3	953.0
40	909.3	1261	852.5	147.4	65.22	149.1	885.4	1185
50	499.7	1413	736.0	104.0	24.10	126.3	863.8	1365
60	106.6	662.4	499.4	18.37	4.590	65.06	713.2	780.8
70	22.73	61.35	93.93	5.599	3.007	7.571	257.3	95.31
80	7.396	24.02	14.00	1.731	1.151	3.414	33.67	35.21
90	0	0	0	0	0	0	0	0
100	0	0	0	0	0	0	0	0
110	0	0	0	0	0	0	0	0
120	0	0	0	0	0	0	0	0
130	0	0	0	0	0	0	0	0
140	0	0	0	0	0	0	0	0
150	0	0	0	0	0	0	0	0
160	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0
DEG	LUMINOUS INTENSITY: *10cd							

	Zonal (lm)	Total (lm)	Percent
0-10	393.49	0 - 10	393.49 1.97%
10-20	1294.77	0 - 20	1688.26 8.44%
20-30	2454.23	0 - 30	4142.49 20.72%
30-40	3927.91	0 - 40	8070.40 40.37%
40-50	5014.69	0 - 50	13085.09 65.45%
50-60	4268.31	0 - 60	17353.40 86.80%
60-70	2152.38	0 - 70	19505.78 97.57%
70-80	428.52	0 - 80	19934.30 99.71%
80-90	57.14	0 - 90	19991.44 100.00%
90-100	0.00	0 - 100	19991.44 100.00%
100-110	0.00	0 - 110	19991.44 100.00%
110-120	0.00	0 - 120	19991.44 100.00%
120-130	0.00	0 - 130	19991.44 100.00%
130-140	0.00	0 - 140	19991.44 100.00%
140-150	0.00	0 - 150	19991.44 100.00%
150-160	0.00	0 - 160	19991.44 100.00%
160-170	0.00	0 - 170	19991.44 100.00%
170-180	0.00	0 - 180	19991.44 100.00%


4.2 Goniophotometer Test

LCS/BUG

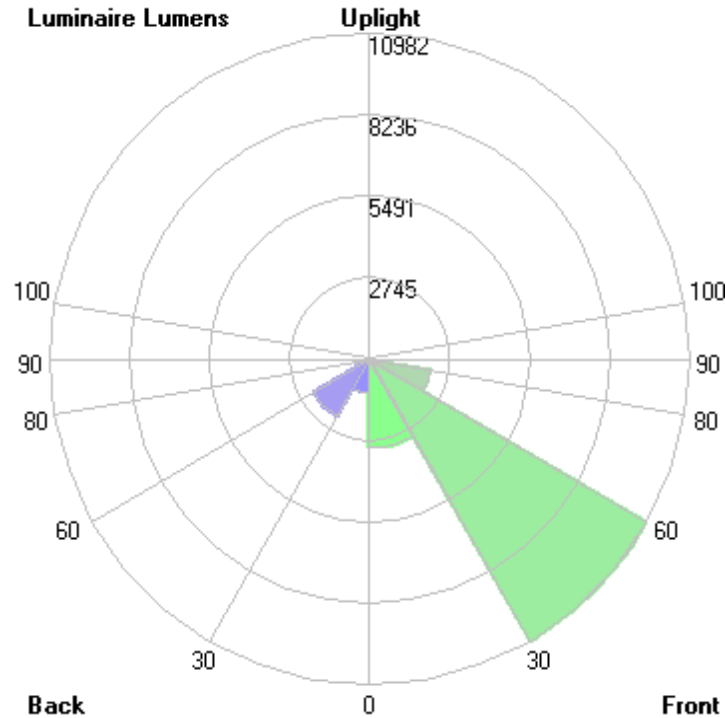


	Lumens	% Lamp	% Luminaire
FL - Front-Low (0-30)	3004.7	N.A.	15.0
FM - Front-Medium (30-60)	10981.5	N.A.	54.9
FH - Front-High (60-80)	2124.7	N.A.	10.6
FVH - Front-Very High (80-90)	45.9	N.A.	0.2
BL - Back-Low (0-30)	1137.8	N.A.	5.7
BM - Back-Medium (30-60)	2229.4	N.A.	11.2
BH - Back-High (60-80)	456.2	N.A.	2.3
BVH - Back-Very High (80-90)	11.2	N.A.	0.1
UL - Uplight-Low (90-100)	0.0	N.A.	0.0
UH - Uplight-High (100-180)	0.0	N.A.	0.0
Total	19991.4	N.A.	100.0
BUG Rating	B3-U0-G2		

Coefficients of Utilization

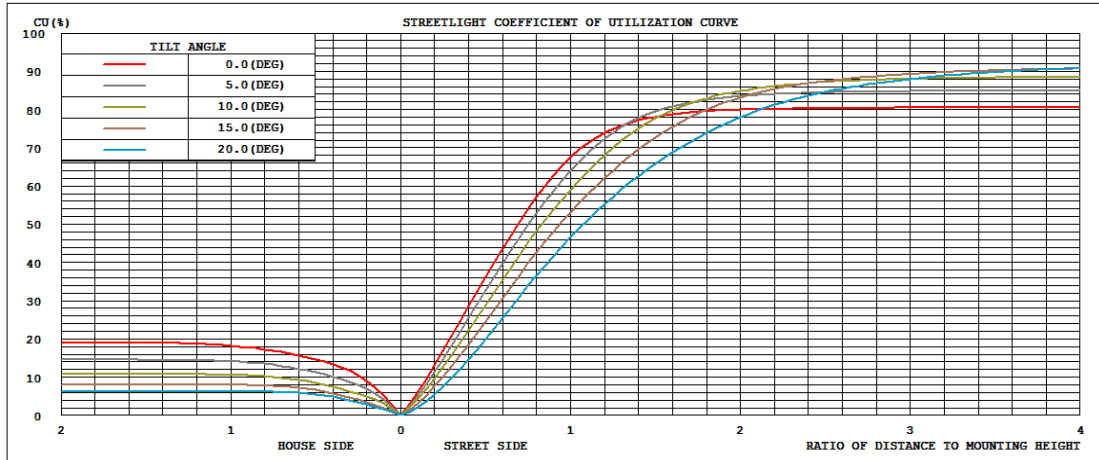

Isolines

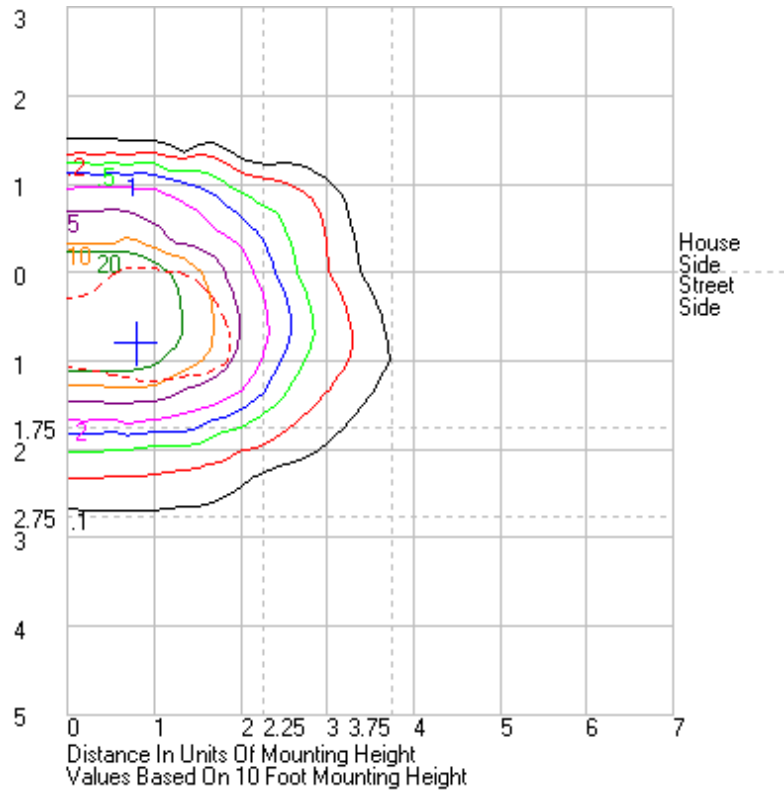



4.2 Goniophotometer Test

	0	15	30	45	60	75	90	105	120	135	150	165	180	195	210	225	240	255	270	285	300	315	330	345	360
0	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71	3756.71
1	3919.07	3918.43	3902.39	3876.01	3844.13	3810.19	3775.06	3739.58	3703.6	3673.91	3650.46	3636.14	3641.3	3642.58	3651.61	3667.04	3691.04	3718.14	3747.54	3780.07	3811.36	3843.14	3869.73	3888.18	3919.07
2	4111.83	4105.55	4074.46	4021.72	3950.86	3870.68	3797.84	3729.82	3669.04	3624.75	3595.43	3571.43	3570.87	3569.32	3578.04	3596.93	3631.73	3687.62	3748.72	3817.56	3898.1	3970.91	4030.28	4067.72	4111.83
3	4318.1	4309.85	4259.78	4174.98	4065.26	3937.47	3825.81	3724.34	3651.29	3597.39	3549.88	3514.46	3506.14	3506.97	3523.86	3554.31	3596.13	3666.87	3760.6	3874.36	3998.16	4109.7	4203.69	4264.02	4318.1
4	4549.72	4529.07	4456.69	4341.28	4185.78	4013.45	3853.59	3726.48	3642.08	3568.91	3505.22	3458.82	3444.69	3447.61	3471.67	3518.25	3578.11	3656.1	3780.36	3941.74	4111.79	4269.27	4387.95	4479.21	4549.72
5	4833.02	4802.25	4682.64	4514.53	4312.21	4088.32	3883.92	3733.4	3635.35	3540.95	3465.12	3411.09	3393.44	3396.63	3427.8	3487.83	3566.31	3654	3804.1	4011.85	4234.13	4426.6	4608.08	4733.79	4833.02
6	5104.47	5077.77	4946.66	4702.14	4441.2	4164.59	3915.79	3745.82	3624.01	3514.72	3430.86	3372.21	3352	3357.43	3394.43	3463.78	3557.92	3662.12	3836.69	4092.37	4362.72	4626.87	4864.65	5013.43	5104.47
7	5366.36	5343.29	5206.11	4929.68	4577.44	4248.78	3949.11	3759.87	3616.12	3490.99	3400.43	3332.64	3309.93	3322.96	3369.75	3446.69	3556.15	3678.78	3872.98	4178.15	4503.7	4851.18	5118.06	5265.66	5366.36
8	5571.49	5566.21	5445.09	5150.52	4718.68	4330.74	3986.93	3777.8	3608.21	3471.13	3357.78	3254.6	3227.55	3258.85	3347.83	3438.51	3557.3	3698.22	3913.96	4271.29	4660.93	5075.68	5339.48	5479.97	5571.49
9	5770.35	5765.22	5649.09	5376.11	4881.39	4420.22	4026.19	3793.69	3598.59	3445.8	3283.54	3145.48	3110.81	3165.15	3296.37	3432.13	3560.24	3719.46	3957.22	4369.45	4848.51	5297.9	5545.7	5668.44	5770.35
10	5953.69	5956.17	5836.12	5577.94	5066.63	4517.59	4071.3	3812.06	3593.97	3398.78	3175.23	2986.76	2944.33	3025.57	3220.55	3422.39	3563.33	3746.07	4005.54	4473.61	5039.53	5497.58	5726.52	5855.22	5953.69
11	6155.37	6154.1	6026.83	5765.86	5257.11	4623.9	4125.2	3836.07	3585.77	3328.91	3033.1	2795.51	2744.02	2852.86	3113.46	3388.19	3570.75	3774.37	4059.2	4584.22	5230.37	5685.07	5916.69	6045.17	6155.37
12	6339.88	6351.3	6212.79	5945.89	5447.34	4740.39	4183.41	3864.18	3580.93	3234.1	2851.85	2561.32	2501.81	2640.59	2966.56	3336.07	3578.95	3806.7	4117.68	4696.73	5424.39	5866.66	6103.91	6237.13	6339.88
13	6535.71	6549.89	6417.63	6125.35	5638.63	4866.44	4254.34	3905.32	3565.43	3116.73	2649.25	2303.6	2233.7	2398.86	2794.75	3260.38	3589.22	3839.99	4182.21	4821.81	5605.67	6051.68	6301.86	6423.21	6535.71
14	6736.72	6756.66	6613.21	6311.1	5833.95	5002.9	4332.22	3950.38	3538.61	2967.92	2404.89	2026.19	1956.23	2140.6	2590.17	3155.72	3595.62	3877.83	4252.92	4963.14	5791.81	6242.35	6496.41	6623.99	6736.72
15	6925.53	6964.12	6826.03	6507.47	6025.58	5155.98	4429.06	4006.65	3505.41	2804.67	2160.6	1754.14	1688.32	1876.72	2366.96	3031.12	3589.9	3920.28	4327.28	5108.33	5960.95	6418.11	6698.65	6818.77	6925.53
16	7107.11	7161.7	7036.67	6711.57	6234.97	5333.88	4548.19	4073.68	3452.3	2614.84	1897.62	1498.07	1474.05	1627.31	2130.26	2884.92	3577.12	3971.8	4421.25	5277.01	6138.93	6593.87	6908.73	7004.64	7107.11
17	7269.37	7345.6	7244.52	6921.84	6443.69	5530.73	4668.89	4142.24	3391.81	2416.12	1654.8	1272.62	1259.78	1422.61	1897.72	2724.52	3554.44	4031.88	4520.88	5454.52	6318.04	6780.7	7112.43	7175.55	7269.37
18	7432.9	7524.82	7447.51	7146.15	6679.4	5771.05	4826.63	4223.06	3308.68	2208.48	1425.31	1119.71	1091.35	1218.76	1673.25	2546.2	3521.34	4101.78	4638.27	5647.28	6492.64	6987.64	7300.33	7343.17	7432.9
19	7574.14	7689.75	7634.04	7364.85	6916.93	6021.58	4990.88	4299.85	3219.76	1996.95	1245.5	1016.42	999.36	1094.92	1483.7	2362.37	3477.64	4183.62	4771.43	5854.23	6668.06	7198.26	7489.46	7496.15	7574.14
20	7716.75	7851.35	7830.12	7599.17	7173.64	6304.03	5171.95	4377.25	3109.24	1795.23	1123.54	966.19	962.08	1021.33	1317.08	2172.2	3426.5	4275.06	4918.52	6076.26	6877.45	7404.28	7666.81	7641.13	7716.75
21	7844.37	8013.58	8012.78	7837.37	7452.5	6611.92	5385.81	4459.92	2991.8	1596	1044.51	961.2	965.19	993.36	1178.76	1986.17	3366.75	4365.72	5092.85	6324.26	7097.89	7605.04	7830.68	7777.57	7844.37
22	7959.15	8164.32	8197.69	8066.08	7717.57	6904.56	5587.91	4530.01	2858.24	1436.55	1013.69	983.59	990.93	1000.63	1106.36	1806.61	3294.7	4464.72	5275.04	6577.62	7344.66	7804.55	7990.61	7903.76	7959.15
23	8047.7	8305.4	8388.9	8310.07	8004.82	7226.6	5835.58	4612.68	2716.73	1306.54	1018.29	1015.24	1022.4	1024.05	1071.56	1636.93	3204.39	4564.86	5480.2	6856.03	7586.29	8001.79	8157.17	8018.74	8047.7
24	8142.79	8428.88	8582.98	8548.3	8278.78	7522.63	6078.41	4683.68	2567.12	1223.7	1044.9	1050.66	1059.18	1055.21	1065.51	1495.16	3102.4	4660.13	5698.26	7134.9	7850.86	8197.49	8311.3	8112.37	8142.79
25	8225.98	8559.9	8778.54	8783.92	8560.03	7814.72	6313.68	4746.55	2404.22	1172.48	1081.39	1083.53	1086.53	1090.05	1084.28	1382.48	2986	4761.94	5921.69	7419.2	8109.51	8399.87	8465.96	8219.07	8225.98
26	8275.71	8677.1	8971.67	9027.44	8863.13	8120.73	6570.77	4816.54	2247.99	1151.26	1119.06	1103.37	1097.58	1118.52	1113.1	1308	2859.17	4862.29	6159.52	7713.2	8378.8	8614.06	8610.88	8311.08	8275.71
27	8294.65	8764.2	9162.74	9266.37	9143.21	8393.18	6777.03	4862.28	2078.45	1155.55	1154.8	1107.13	1093.56	1131.65	1146.02	1262.92	2723.56	4964.9	6393.17	7991.38	8657.26	8831.55	8762.25	8367.42	8294.65
28	8297.24	8842.06	9379.37	9537.63	9447.03	8685.4	6992.71	4903.54	1931.27	1187.71	1185.95	1098.97	1079.26	1113.17	1182.21	1242.46	2582.47	5067.51	6628.46	8272.92	8920.17	9060.59	8911.85	8398.71	8297.24
29	8294.96	8908.99	9571.08	9792.65	9732.34	8955	7190.78	4920.77	1798.42	1225.45	1201.75	1085.48	1059.29	1122.84	1216.46	1240.18	2444.81	5150.67	6859.79	8539.87	9193.11	9295.93	9049.37	8425.35	8294.96
30	8311.77	8974.05	9751.72	10058.6	10019.2	9220.93	7362.42	4906.44	1685.81	1266.23	1206.2	1067.2	1032.27	1108.93	1236.28	1258.63	2301.82	5229.43	7082.57	8793.33	9468.61	9529.7	9169.27	8459.88	8311.77
31	8326.6	9059.11	9916.14	10332.5	10310.5	9486.59	7550.61	4879.61	1605.39	1307.39	1204.69	1045.05	1003.87	1091.05	1246.93	1286.81	2159.18	5291.48	7301.66	9057.68	9735.7	9765.23	9268.83	8518.87	8326.6
32	8377.97	9134.95	10082.4	10595.3	10569.8	9722.06	7706.53	4827.55	1549.58	1344.97	1199.6	1023.84	972.89	1067.87	1249.1	1317.2	2024.45	5343.13	7507.8	9308.67	10011.6	10004.1	9396.96	8573.75	8377.97
33	8457.65	9257.79	10266.8	10880.3	10842.1	9964.7	7871.32	4756.51	1519.9	1382.18	1192.25	999.82	942.17	1042.98	1246.21	1349.16	1907.27	5380.01	7707.46	9564.77	10265.8	10249.4	9532.77	8679.62	8457.65
34	8557.5	9386.47	10445.9	11138.5	11092.4	10184.5	8023.6	4676.39	1506.59	1407.08	1180.53	978.05	911.89	1017.32	1238.28	1383.8	1806.99	5395.82	7906.08	9826.07	10538.8	10480.4	9681.38	8810.77	8557.5
35	8669.75	9524.21	10626.6	11388.9	11329.2	10387.1	8148.65	4566.64	1516.44	1428.95	1164.02	954.73	881.19	992.2	1224.51	1417.14	1729.59	5402.41	8090.13	10075.5	10806.2	10704.2	9832.9	8959.85	8669.75
36	8788.76	9661.48	10839.8	11640.6	11579.3	10582.7	8274.19	4445.46	1544.82	1447.65	1148.4	928.82	848.1	965.8	1207.46	1442.6	1679.31	5390.92	8272.69	10328.4	11069.9	10920.1	10034.6	9119.8	8788.76
37	8905.16	9783.38	11076.5	11870.1	11796.6	10747.9	8368.71	4301.02	1577.91	1462.07	1130.8	897.41	808.78	936.62	1186.17	1460.16	1646.3	5363.26	8438.45	10553.4	11332	11149.4	10244.2	9270.34	8905.16
38	9009.89	9877.34	11319.2	12118.2	12008.7	10894.4	8441.04	4139.72	1622.61	1475.94	1109.56	856.68	762.82	902.4	1166.98	1472.4	1632.39	5322.64	8595.02	10772.1	11573.5	11374.5	1045		



161	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
162	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
163	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
164	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
165	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
166	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
167	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
168	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
169	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
170	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
171	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
172	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
173	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
174	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
175	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
176	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
177	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
178	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
179	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
180	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

4.0 LM-79 Measurement and Test Results

4.3 THD and PF Test

Model No.	ALEDMATN	Sample ID.	K1
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the ANSI C82.77:2002.
 The total harmonic distortion shall be measured to the 40th order.
 The ambient temperature condition was maintained at 25° C ± 1° C. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion were calculated.

Test Results

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	THD
120.00	60	1.220	146.3	1.000	3.67%
276.94	60	0.543	144.0	0.957	8.10%

5.0 Equipment Information

Test Equipment			
Equipment ID	Equipment Name	Last Calibration Date	Calibration Due Date
DLF107	Integrating Sphere System	2020/12/26	2021/12/25
DLF108	Auxiliary Lamp	2020/12/26	2021/12/25
DLF122	Measurement Standard Lamp Standard Lamp Type: 220 V, 0.4720 A, Tungsten, Omni-derectional	2020/12/26	2021/12/25
DLF116	AC Power Source	2020/12/26	2021/12/25
DLF113	Power Meter	2020/12/26	2021/12/25
DLF112	Temperature Recorder	2020/12/26	2021/12/25
DLF114	Temperature & Humidity Datalogger	2020/12/26	2021/12/25
DLF101	Goniophotometer	2020/12/26	2021/12/25
DLF125	Standard Lamp Standard Lamp Type: 76.58 V, 6.7875 A, Tungsten, Omni-derectional	2020/12/26	2021/12/25
DLF104	AC Power Source	2020/12/26	2021/12/25
DLF507	DC Power Source	2020/12/26	2021/12/25
DLF102	Power Meter	2020/12/26	2021/12/25
DLF111	Temperature & Humidity Datalogger	2020/12/26	2021/12/25
DLF119	Power Meter	2020/12/26	2021/12/25
DLF031	Temperature data logger	2020/12/26	2021/12/25
DLF022	Digital power meter	2020/12/26	2021/12/25
DLF003	Temperature & Humidity Datalogger	2020/12/26	2021/12/25

***** End of Test Report*****