

LM-79-08 Test Report
For
RAB LIGHTING INC

(Brand Name: N/A)

170 Ludlow Ave, PO BOX 970, Northvale, NJ 07647-2305 USA

Model name(s):
CRLEDFA-8R-22S-9CCT-UNV-WS

Report Type: Testing and Report According to IES LM-79-2008

**Type of
Luminaire:** Downlights

Report Date: 2023-02-14


Prepared By:

Test & Report By:



Engineer: Sun Fangfang

Review By:



Manager: Huang Qichong

1.1 Rated Values:	
Rated Voltage / Frequency	120V-277Vac, 60 Hz
Nominal Power	11.0 W /16.0 W/22.0 W
Rated Initial Lamp Lumen	1000 lm/1500 lm/2000 lm
Declared CCT	3000K/3500K/4000K/5000K

1.2 Test Specifications:

Test item	<ol style="list-style-type: none"> 1. Total Luminous Flux 2. Luminous Distribution Intensity 3. Luminous Efficacy 4. Correlated Color Temperature 5. Color Rendering Index 6. Chromaticity Coordinate 7. Electrical Parameters
Reference Standard	<ol style="list-style-type: none"> 1. IES LM-79-2008 Electrical and Photometric Measurements of Solid-State Lighting Products 2. ANSI C78.377-2015 Specifications for the Chromaticity of Solid State Lighting Products 3. CIE 13.3-1995 Method of Measuring and Specifying Colour Rendering Properties of Light Sources 4. CIE 15-2004 Technical Report Colorimetry 5. IESNA LM-16-93 Practical Guide to Colorimetry of Light Source 6. IESNA TM-16-05 Technical Memorandum on Light Emitting Diode (LED) Sources and Systems
Reference Work Instruction	QD25

1.3 Test Methods

1) Photometric and Light Distribution Measurement – Goniophotometer Method:

Photometric parameters were measured using the goniophotometer and software. The ambient temperature shall be maintained at 25°C ±1°C, measured at a point not more than 1 m from the sample and at the same height as the sample. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1°vertical intervals and 22.5°horizontal intervals.

2) Chromaticity Measurement – Sphere-Spectroradiometer Method:

Chromaticity parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25°C ±1°C. The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral power distribution taken at 5 nm intervals over the range of 380 to 780 nm.

3) Electrical Measurements:

Electrical parameters were measured using power meters incorporated in goniophotometer or sphere-spectroradiometer system. The ambient temperature surrounding the sample was maintained at 25°C ±1°C. The sample was operated at 120 or rated Volts AC, 60Hz. It was stabilized before measurement was made. Voltage, frequency, current, power, power factor and total harmonic distortion were measured by and read from the power meter.

2.1.1 Electrical, Photometric and Chromaticity Measurements

Test date	2023-02-14	Test Ambient:	25.3 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	CRLEDFA-8R-22S-9CCT-UNV-WS	3000K	

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
202302140002	120.0	60	0.181	21.60	0.997

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120	R1	95	R9	64
Frequency (Hz)	60	R2	98	R10	95
CCT (K)	3047	R3	98	R11	96
Duv	-0.0025	R4	94	R12	84
Chromaticity (x, y)	x=0.4301 y=0.3956	R5	95	R13	96
Chromaticity (u', v')	u'=0.2498 v'=0.5170	R6	96	R14	99
Color Rendering Index (CRI)	94.1	R7	92	R15	91
R9	64	R8	83	--	--

Photometric Measurement – Goniophotometer Method:


Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	2154.8
Luminous Efficacy (lm/W)	99.76
Beam Angle (°)	88.1
Center Beam Candle Power (cd)	1147

Parameter	Result
Test Voltage (V)	277.0
Frequency (Hz)	60
Total Luminous (lm)	2141.0
Luminous Efficacy (lm/W)	98.78

Spectral Power Distribution & Chromaticity Diagram

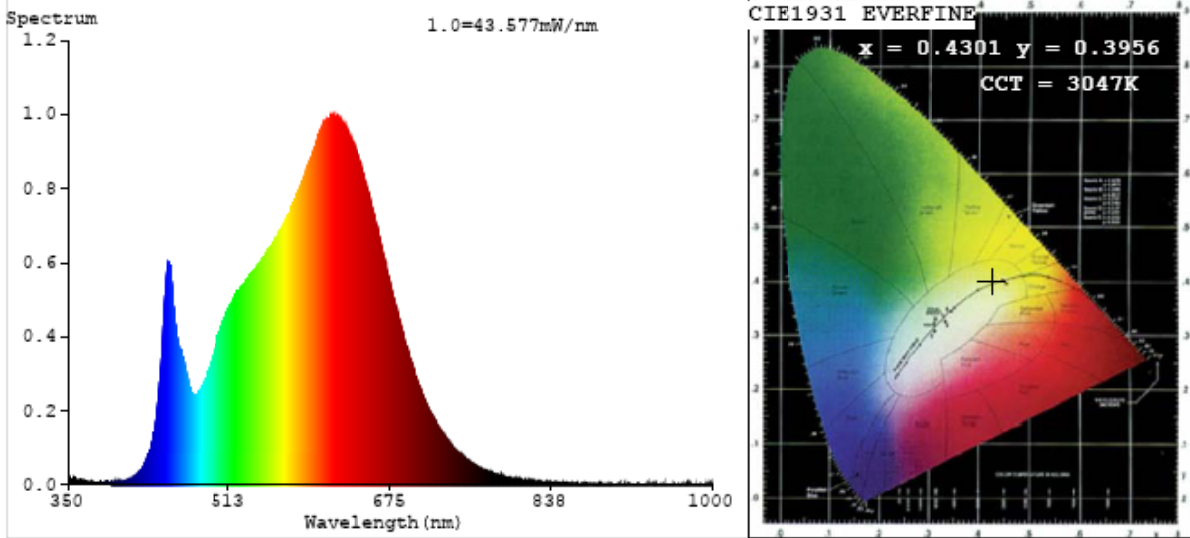

TM30




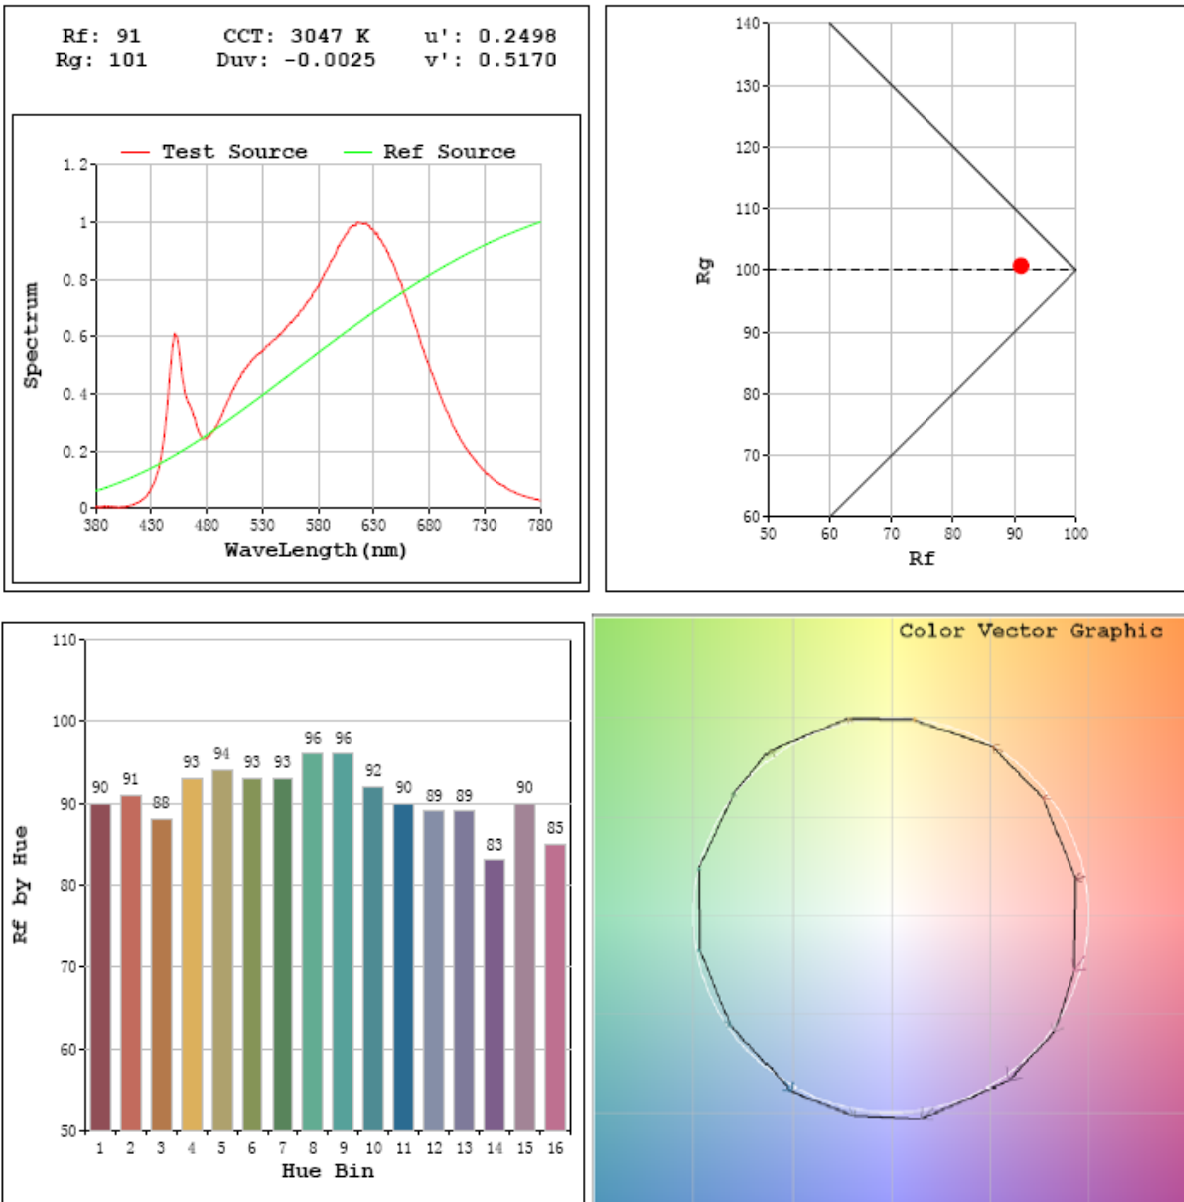


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	826.4	38.3%
0-40	1296.5	60.2%
0-60	1998.1	92.7%
60-90	156.8	7.3%
70-100	51.4	2.4%
90-120	0.0	0.0%
0-90	2154.8	100.0%
90-180	0.0	0.0%
0-180	2154.8	100.0%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	107.2	5.0%	90-100	0.0	0.0%
10-20	295.9	13.7%	100-110	0.0	0.0%
20-30	423.3	19.6%	110-120	0.0	0.0%
30-40	470.2	21.8%	120-130	0.0	0.0%
40-50	424.7	19.7%	130-140	0.0	0.0%
50-60	276.9	12.8%	140-150	0.0	0.0%
60-70	105.3	4.9%	150-160	0.0	0.0%
70-80	40.3	1.9%	160-170	0.0	0.0%
80-90	11.1	0.5%	170-180	0.0	0.0%

Photometric Data

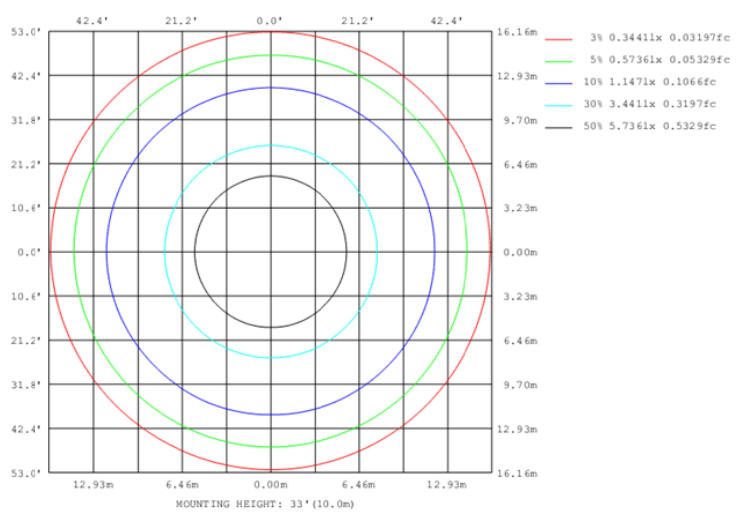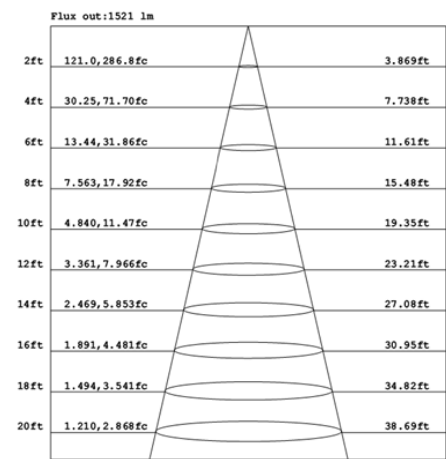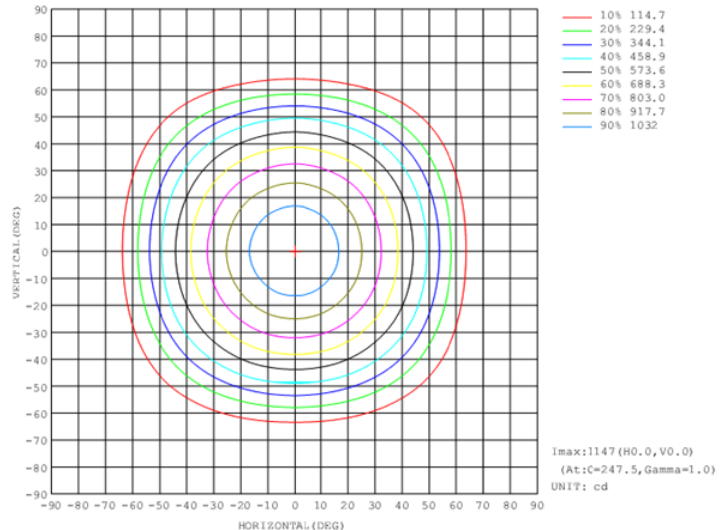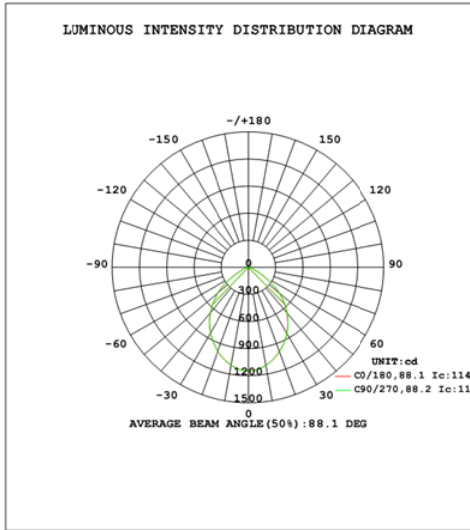

2.1.2 Electrical, Photometric and Chromaticity Measurements

Test date	2023-02-14	Test Ambient:	25.3 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	CRLEDFA-8R-22S-9CCT-UNV-WS	3500K	

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
202302140002	120.0	60	0.179	21.40	0.997

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120	R1	98	R9	78
Frequency (Hz)	60	R2	99	R10	99
CCT (K)	3573	R3	98	R11	97
Duv	-0.0034	R4	96	R12	78
Chromaticity (x, y)	x=0.3980 y=0.3795	R5	97	R13	99
Chromaticity (u', v')	u'=0.2356 v'=0.5054	R6	95	R14	100
Color Rendering Index (CRI)	95.4	R7	93	R15	96
R9	78	R8	89	--	--

Photometric Measurement – Goniophotometer Method:





Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	2260.7
Luminous Efficacy (lm/W)	105.64
Beam Angle (°)	88.2
Center Beam Candle Power (cd)	1201

Parameter	Result
Test Voltage (V)	277.0
Frequency (Hz)	60
Total Luminous (lm)	2246.0
Luminous Efficacy (lm/W)	104.66

Spectral Power Distribution & Chromaticity Diagram

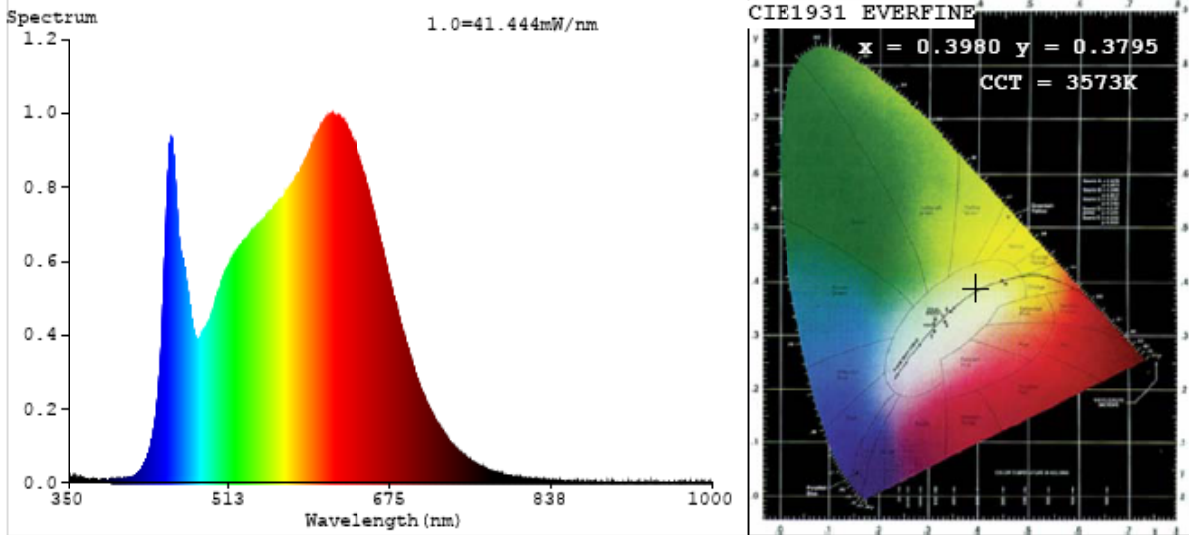

TM30

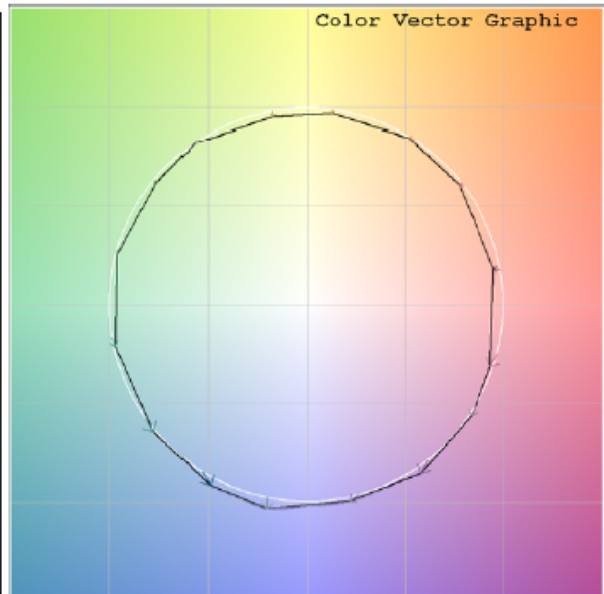
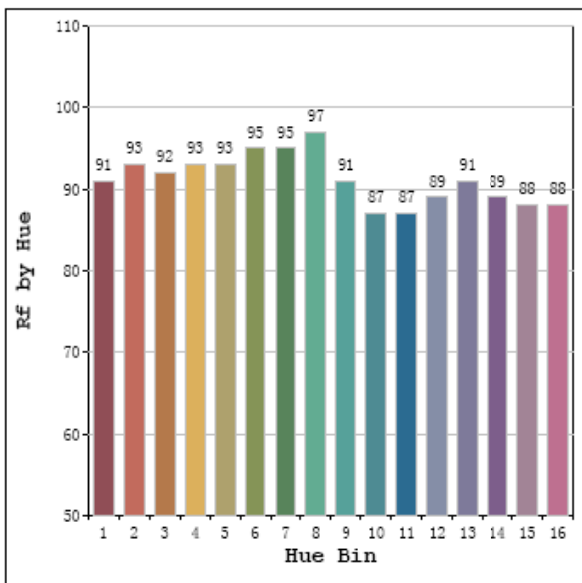
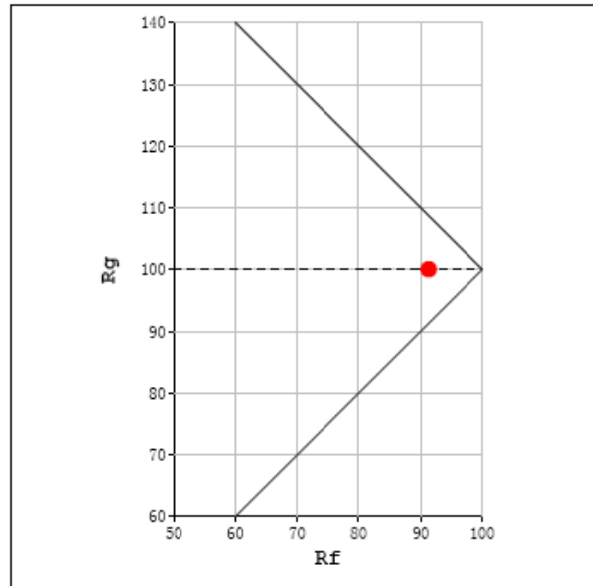
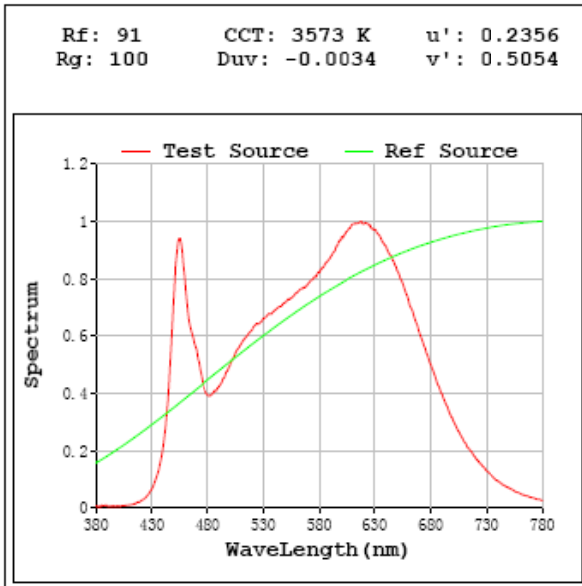


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	866.3	38.3%
0-40	1359.4	60.1%
0-60	2095.9	92.7%
60-90	164.7	7.3%
70-100	54.0	2.4%
90-120	0.0	0.0%
0-90	2260.7	100.0%
90-180	0.0	0.0%
0-180	2260.7	100.0%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	112.4	5.0%	90-100	0.0	0.0%
10-20	310.1	13.7%	100-110	0.0	0.0%
20-30	443.8	19.6%	110-120	0.0	0.0%
30-40	493.1	21.8%	120-130	0.0	0.0%
40-50	445.6	19.7%	130-140	0.0	0.0%
50-60	290.9	12.9%	140-150	0.0	0.0%
60-70	110.8	4.9%	150-160	0.0	0.0%
70-80	42.3	1.9%	160-170	0.0	0.0%
80-90	11.6	0.5%	170-180	0.0	0.0%

Photometric Data

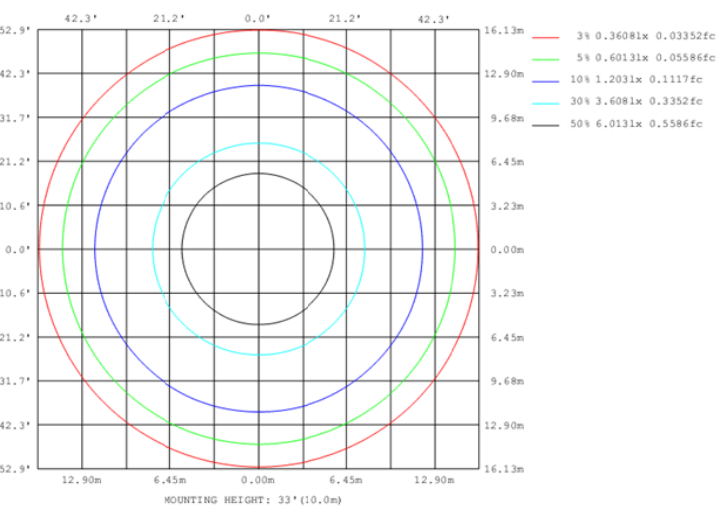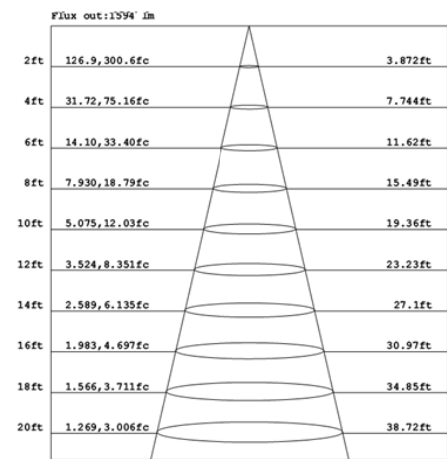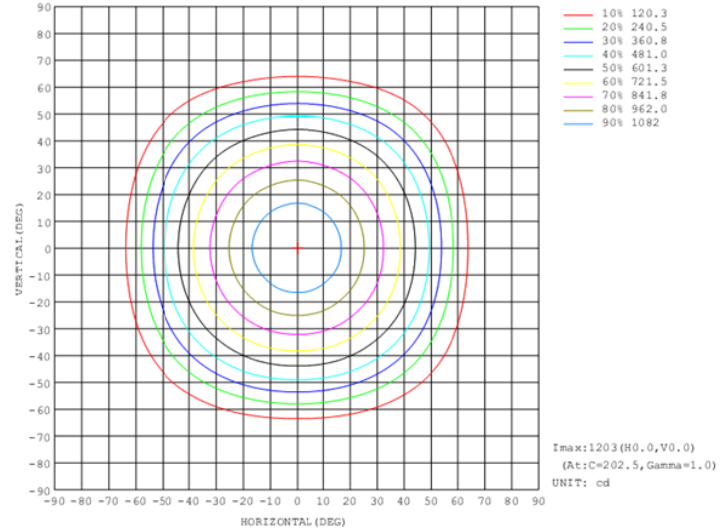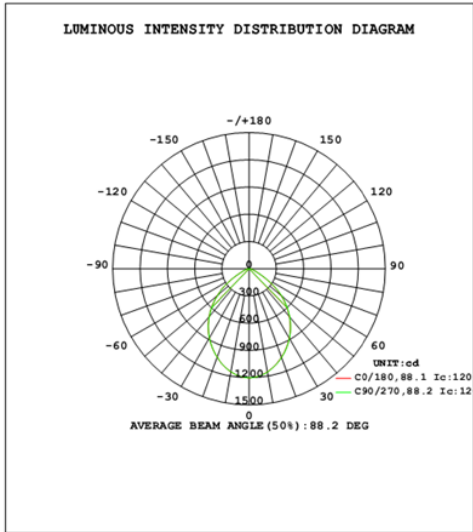

Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

2.1.3 Electrical, Photometric and Chromaticity Measurements

Test date	2023-02-14	Test Ambient:	25.3 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	CRLEDFA-8R-22S-9CCT-UNV-WS	4000K	

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
202302140002	120.0	60	0.177	21.20	0.997

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120	R1	98	R9	82
Frequency (Hz)	60	R2	99	R10	99
CCT (K)	4109	R3	98	R11	96
Duv	-0.0018	R4	94	R12	73
Chromaticity (x, y)	x=0.3746 y=0.3692	R5	95	R13	99
Chromaticity (u', v')	u'=0.2242 v'=0.4973	R6	95	R14	100
Color Rendering Index (CRI)	95.4	R7	93	R15	96
R9	82	R8	91	--	--

Photometric Measurement – Goniophotometer Method:

Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	2277.5
Luminous Efficacy (lm/W)	107.43
Beam Angle (°)	88.2
Center Beam Candle Power (cd)	1210





Parameter	Result
Test Voltage (V)	277.0
Frequency (Hz)	60
Total Luminous (lm)	2274.0
Luminous Efficacy (lm/W)	106.79

Spectral Power Distribution & Chromaticity Diagram

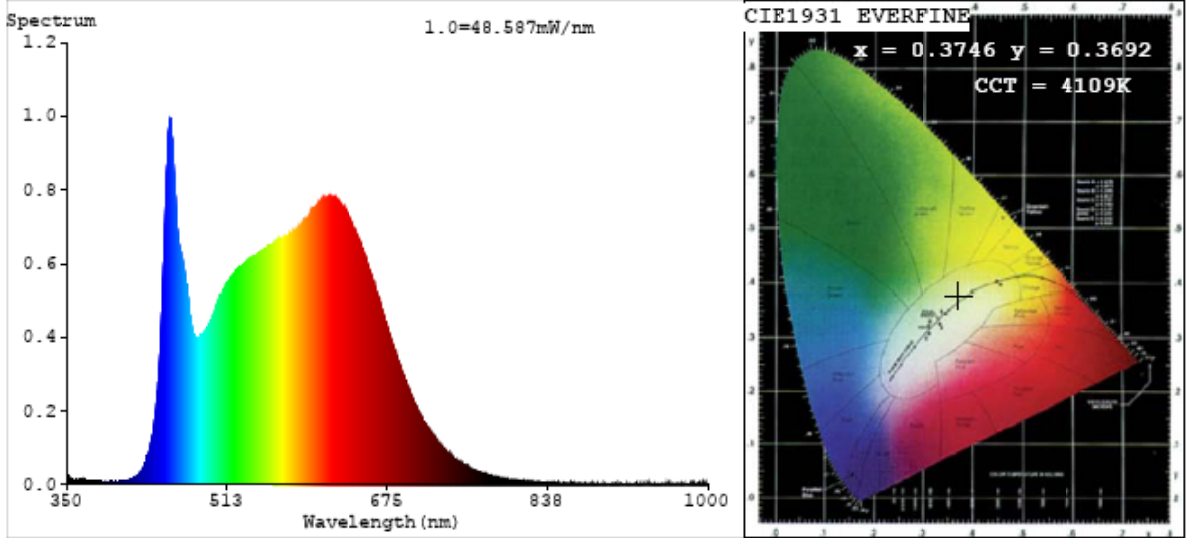

TM30

Rf: 91 CCT: 4109 K u' : 0.2242
 Rg: 99 Duv: -0.0018 v' : 0.4973

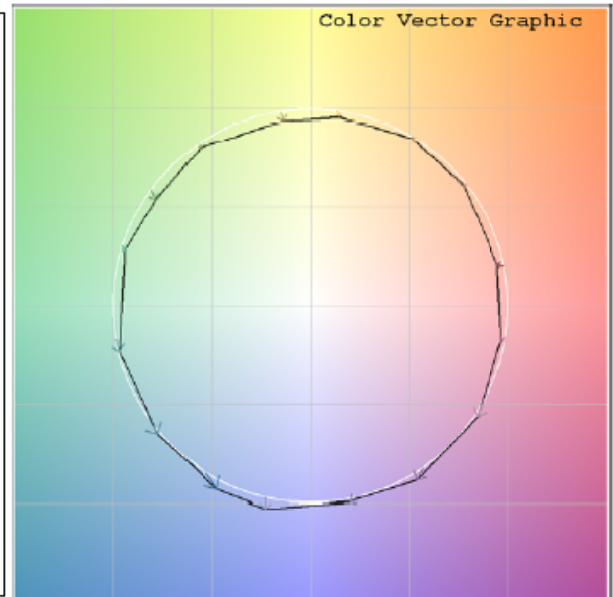
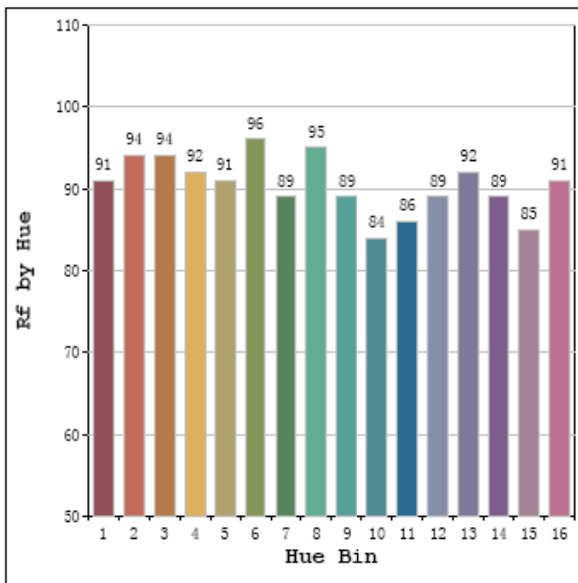
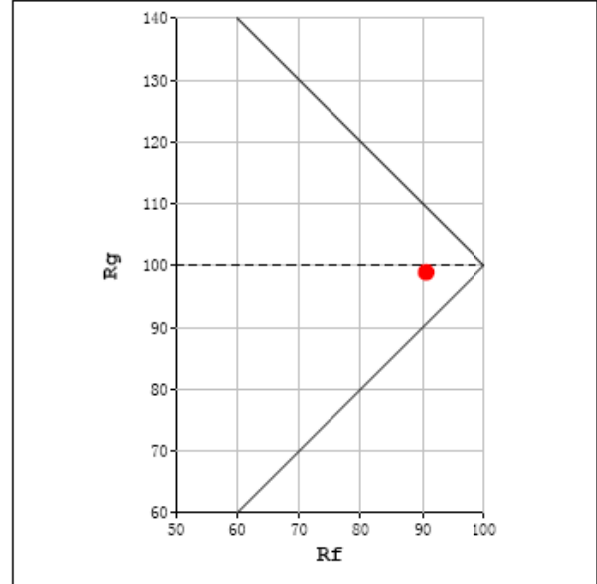
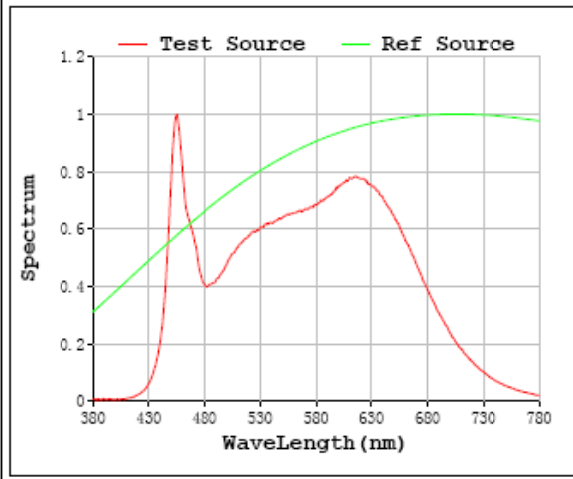


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	872.3	38.3%
0-40	1369.0	60.1%
0-60	2111.4	92.7%
60-90	166.2	7.3%
70-100	54.4	2.4%
90-120	0.0	0.0%
0-90	2277.5	100.0%
90-180	0.0	0.0%
0-180	2277.5	100.0%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	113.1	5.0%	90-100	0.0	0.0%
10-20	312.3	13.7%	100-110	0.0	0.0%
20-30	446.9	19.6%	110-120	0.0	0.0%
30-40	496.7	21.8%	120-130	0.0	0.0%
40-50	449.0	19.7%	130-140	0.0	0.0%
50-60	293.4	12.9%	140-150	0.0	0.0%
60-70	111.8	4.9%	150-160	0.0	0.0%
70-80	42.7	1.9%	160-170	0.0	0.0%
80-90	11.7	0.5%	170-180	0.0	0.0%

Photometric Data

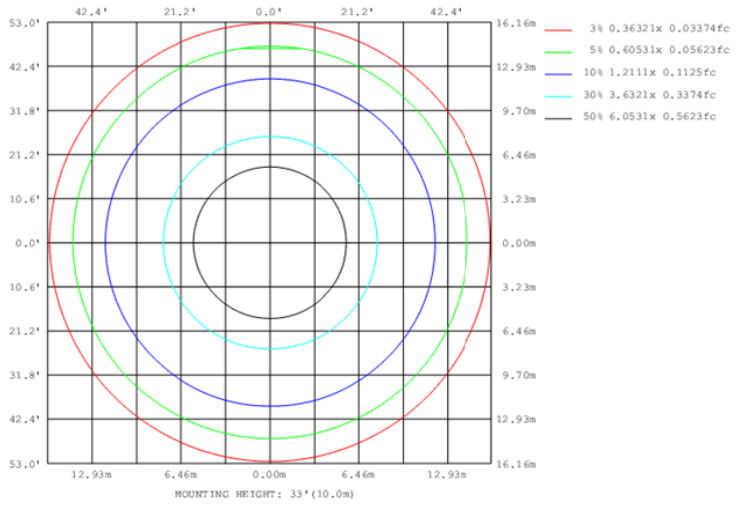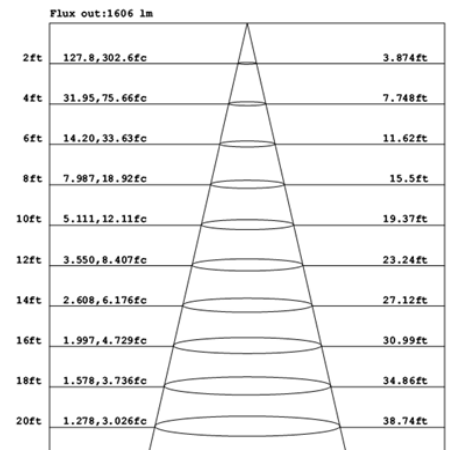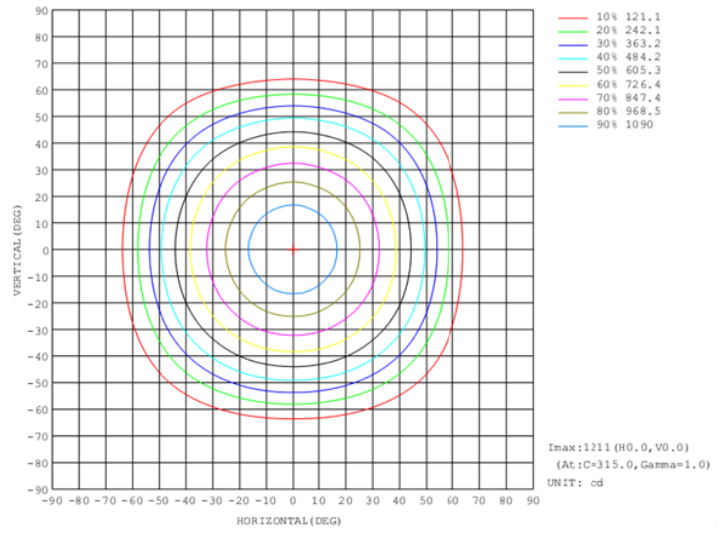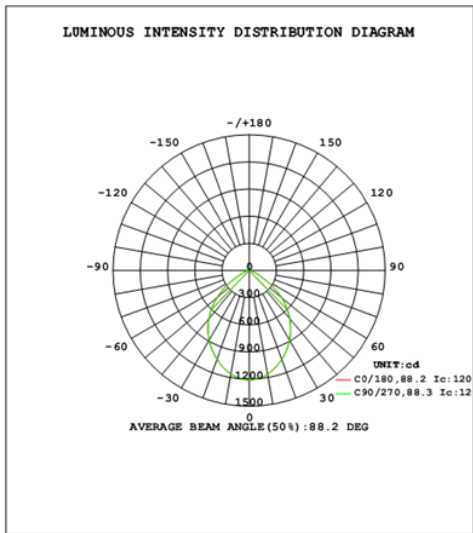

2.1.4 Electrical, Photometric and Chromaticity Measurements

Test date	2023-02-14	Test Ambient:	25.3 °C
Test Orientation	As intended	Stabilization Time (min)	90
Model Number	CRLEDFA-8R-22S-9CCT-UNV-WS	5000K	

Electrical Measurement:

Sample No.	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
202302140002	120.0	60	0.180	21.50	0.997

Chromaticity Measurement - Sphere-Spectroradiometer Method:


Parameter	Result	Special Color Rendering Indices			
Test Voltage (V)	120	R1	95	R9	74
Frequency (Hz)	60	R2	99	R10	95
CCT (K)	5030	R3	98	R11	94
Duv	0.0032	R4	92	R12	72
Chromaticity (x, y)	x=0.3448 y=0.3577	R5	94	R13	97
Chromaticity (u', v')	u'=0.2089 v'=0.4876	R6	95	R14	100
Color Rendering Index (CRI)	94.4	R7	93	R15	93
R9	74	R8	88	--	--

Photometric Measurement – Goniophotometer Method:


Parameter	Result
Test Voltage (V)	120.0
Frequency (Hz)	60
Total Luminous (lm)	2183.1
Luminous Efficacy (lm/W)	101.54
Beam Angle (°)	88.3
Center Beam Candle Power (cd)	1158

Parameter	Result
Test Voltage (V)	277.0
Frequency (Hz)	60
Total Luminous (lm)	2180.0
Luminous Efficacy (lm/W)	101.35

Spectral Power Distribution & Chromaticity Diagram

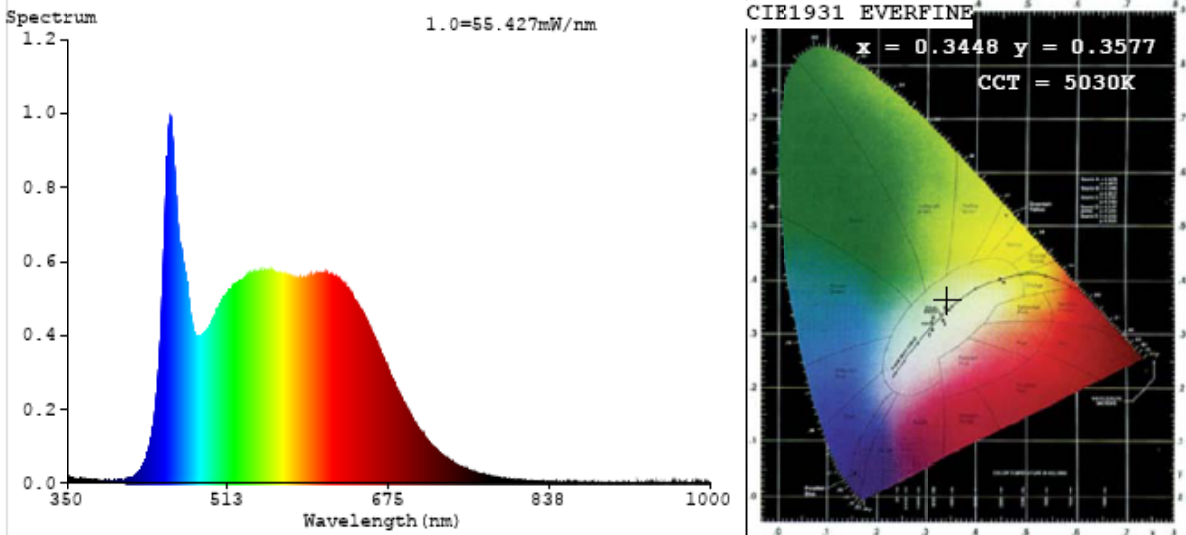

TM30




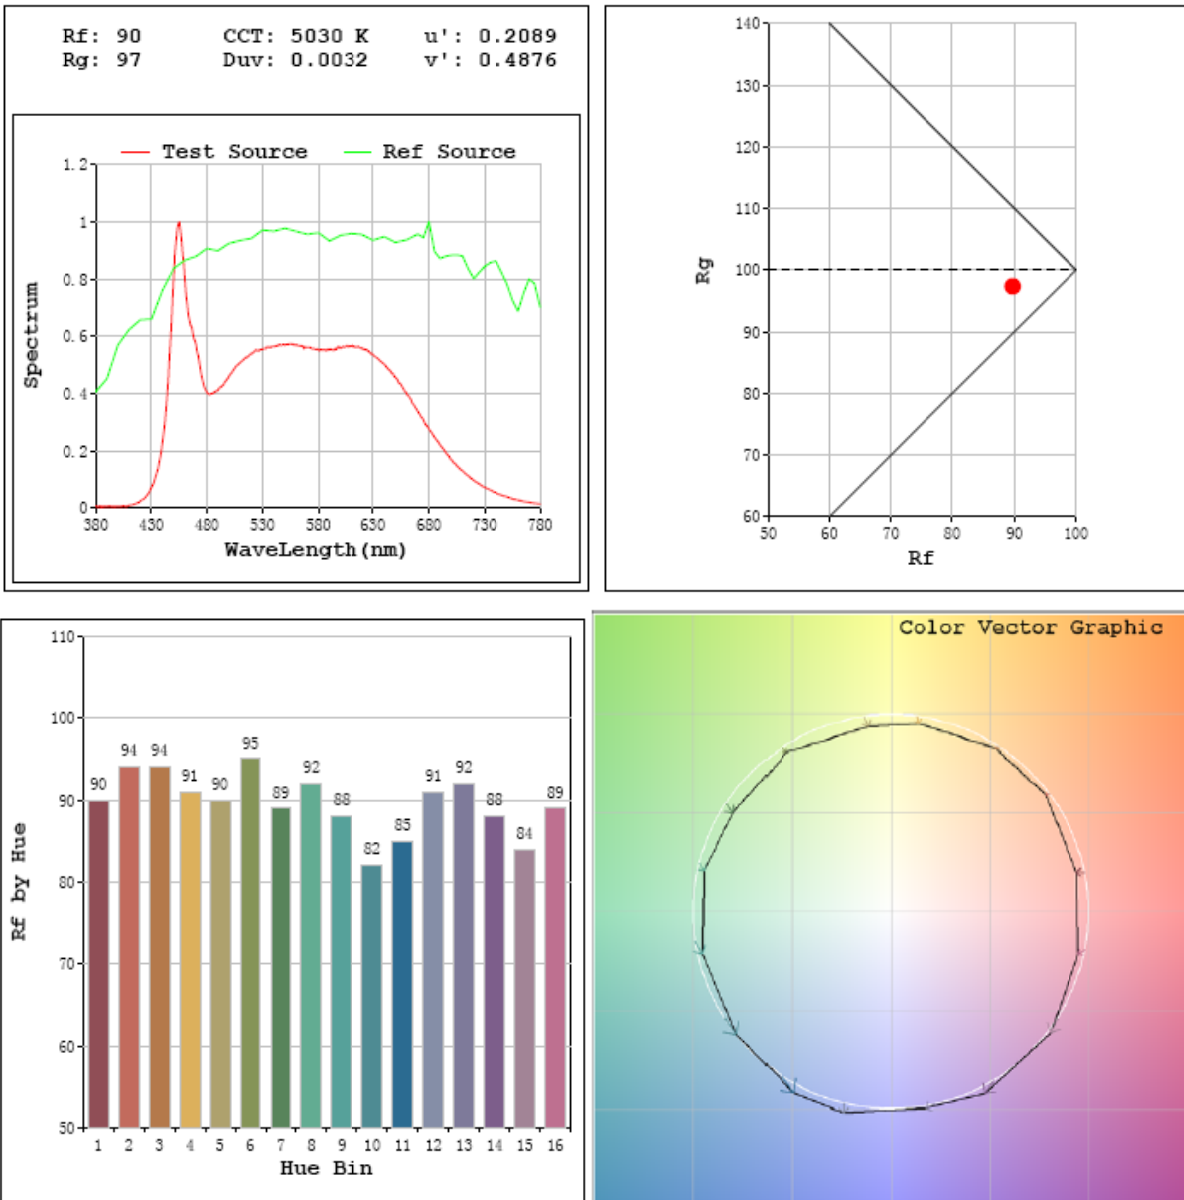


Zonal Lumen Tabulation

Zonal Lumen Summary		
Zone	Lumens	% Luminaire
0-30	835.6	38.3%
0-40	1311.5	60.1%
0-60	2023.6	92.7%
60-90	159.5	7.3%
70-100	52.1	2.4%
90-120	0.0	0.0%
0-90	2183.1	100.0%
90-180	0.0	0.0%
0-180	2183.1	100.0%

Lumens Per Zone					
Zone	Lumens	% Total	Zone	Lumens	% Total
0-10	108.3	5.0%	90-100	0.0	0.0%
10-20	299.1	13.7%	100-110	0.0	0.0%
20-30	428.2	19.6%	110-120	0.0	0.0%
30-40	476.0	21.8%	120-130	0.0	0.0%
40-50	430.5	19.7%	130-140	0.0	0.0%
50-60	281.6	12.9%	140-150	0.0	0.0%
60-70	107.4	4.9%	150-160	0.0	0.0%
70-80	40.9	1.9%	160-170	0.0	0.0%
80-90	11.2	0.5%	170-180	0.0	0.0%

Photometric Data

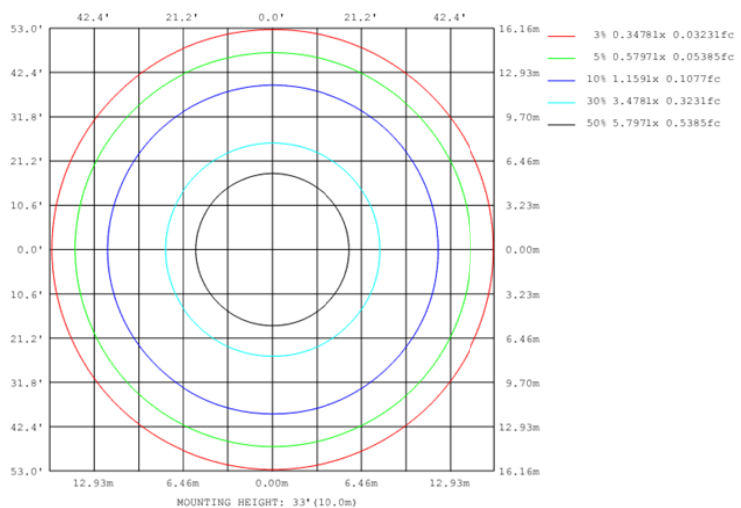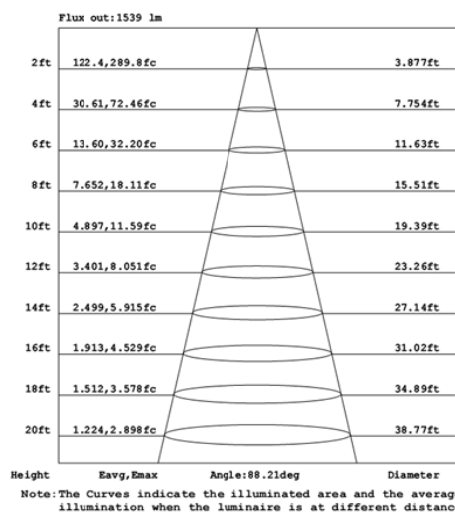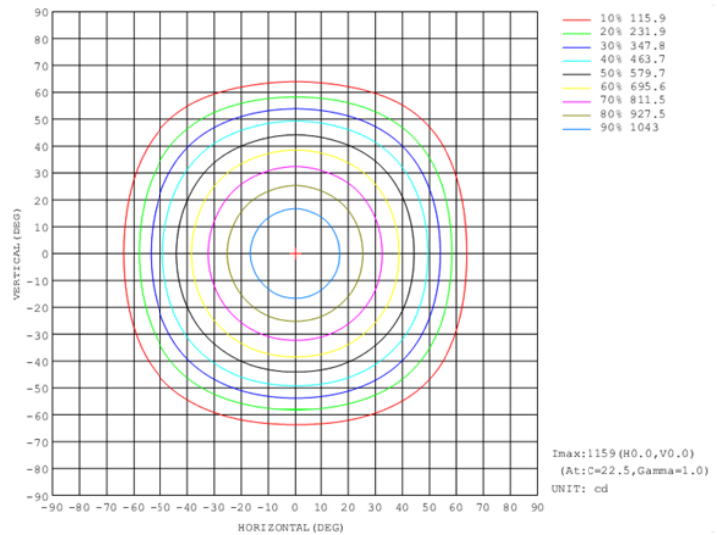
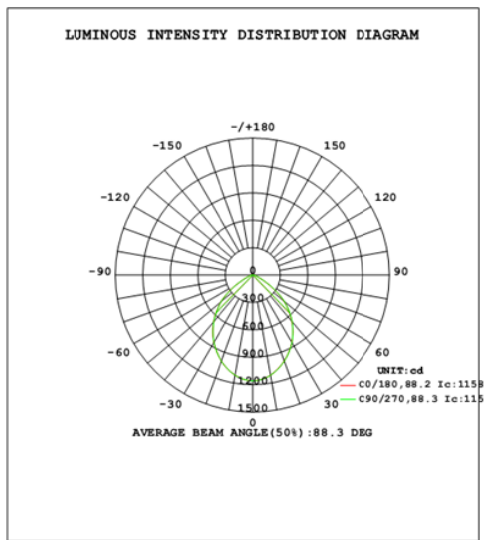


Sample No.	Wattage and CCT setting	Test Voltage(V)	Flux(lm)	P(W)	Luminous Efficacy lm/W
CRLEDFA-8R-22S-9CCT-UNV-WS	11W-3000K setting	120.0	1122.0	10.32	108.77
		277.0	1147.0	11.00	104.34
	11W-3500K setting	120.0	1155.0	10.30	112.14
		277.0	1177.0	10.95	107.50
	11W-4000K setting	120.0	1162.0	10.25	113.40
		277.0	1185.0	10.91	108.67
	11W-5000K setting	120.0	1146.0	10.31	111.19
		277.0	1167.0	10.95	106.54

Sample No.	Wattage and CCT setting	Test Voltage(V)	Flux(lm)	P(W)	Luminous Efficacy lm/W
CRLEDFA-8R-22S-9CCT-UNV-WS	16W-3000K setting	120.0	1590.0	15.08	105.44
		277.0	1592.0	15.49	102.80
	16W-3500K setting	120.0	1645.0	14.95	109.97
		277.0	1650.0	15.40	107.15
	16W-4000K setting	120.0	1654.0	14.84	111.48
		277.0	1657.0	15.28	108.46
	16W-5000K setting	120.0	1600.0	14.91	107.33
		277.0	1613.0	15.39	104.78

Sample No.	Wattage and CCT setting	Test Voltage(V)	Flux(lm)	P(W)	Luminous Efficacy lm/W
CRLEDFA-8R-22S-9CCT-UNV-WS	22W-3000K setting	120.0	2151.0	21.55	99.79
		277.0	2141.0	21.68	98.78
	22W-3500K setting	120.0	2260.0	21.36	105.80
		277.0	2246.0	21.46	104.66
	22W-4000K setting	120.0	2279.0	21.16	107.73
		277.0	2274.0	21.30	106.79
	22W-5000K setting	120.0	2194.0	21.43	102.39
		277.0	2180.0	21.51	101.35

3. Product Photo

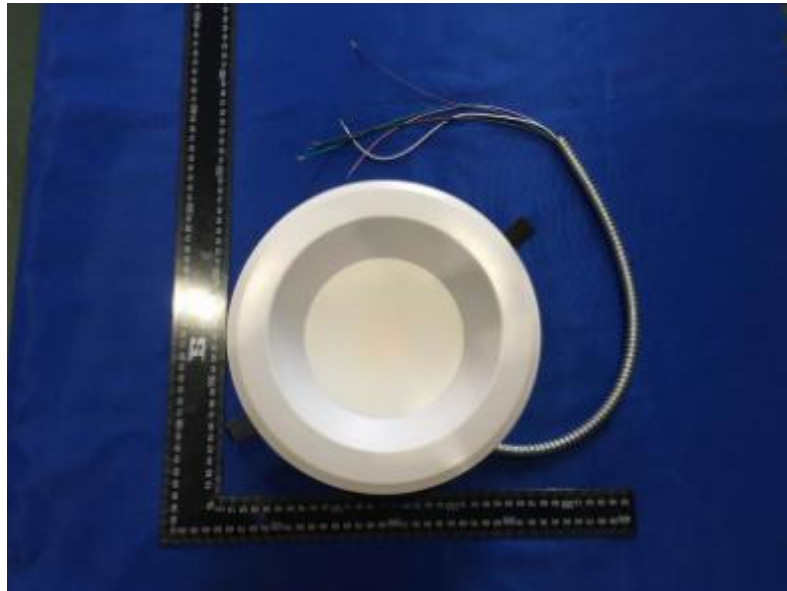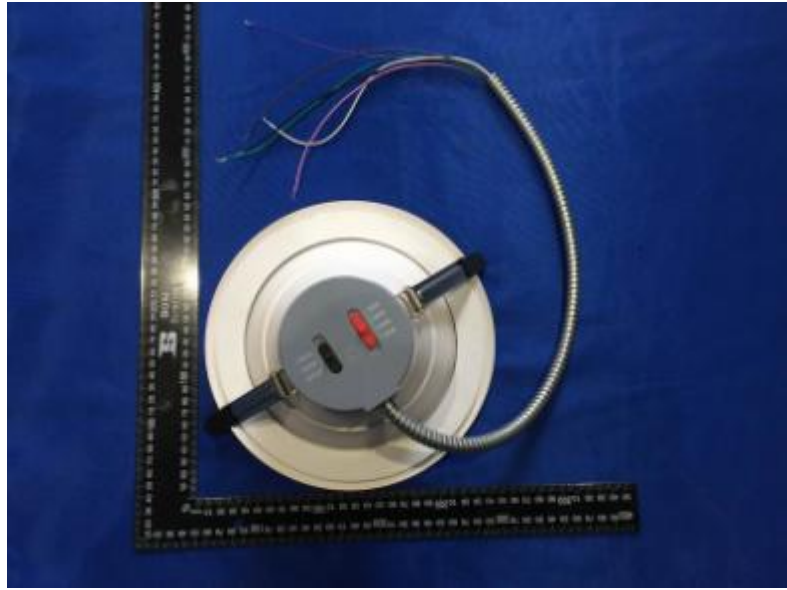

******* END OF REPORT *******