

Photometric Test Report

Relevant Standards

- ☒ IES LM-79-2008
- ☒ ANSI C82.77:2017

Prepared For

RAB Lighting Inc.

Room 6A33, No.1388, Wuzhong road, Shanghai, China

Xiao Xiang, 15921313292, Gary.Xiao@rabweb.com

Prepared By

Deliver Co., Ltd.

Block 11, 78 Keling Road, SSTP, Suzhou, China

0512-66801950, kevin.jia@szdeliver.com

Project Number

DLF2305110

Report Number

DLF2305110-13a


Test Date

2023/5/24

Issue Date


2023/5/25

Prepared By



Wangzun Zhu

Approved By



Kevin Jia

The results contained in this report pertain only to the tested sample.

This report shall not be reproduced, except in full, without written approval of Deliver Co., Ltd.

This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP.

1.0 Test Summary

DLC Technical Requirements v5.1

Indoor - Linear Ambient - Direct Linear Ambient Luminaires				
Requirement Category	Test Method	Requirements		Test value
Luminaire Output (lm) (Goniophotometer - Section 4.2)	IES LM-79-2008	750		6191
Lumen/ft (Goniophotometer - Section 4.2)	IES LM-79-2008	≥375		1548
Minimum Luminaire Efficacy (lm/W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Standard 115	Premium 130	141.7
Power (Input Wattage) (W) (Goniophotometer - Section 4.2)	IES LM-79-2008	Wrost Case		43.7
Total Harmonic Distortion (A%) (THD & PF - section 4.3)	ANSI C82.77:2014	20.00%	120V	5.82%
		20.00%	277V	9.99%
Power Factor (THD & PF - section 4.3)	ANSI C82.77:2014	0.9	120V	0.997
		0.9	277V	0.962
Allowable CCTs* (K) (Integrating Sphere - Section 4.1)	IES LM-79-2008	7 step	3985±275	4040
		4 step	3985±154	
Minimum CRI (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥80		85
Minimum R9 (Integrating Sphere - Section 4.1)	IES LM-79-2008 CIE 13.3-1995	≥0		15
Minimum Rf (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥70		85
Minimum Rg (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	≥89		95
Minimum IES Rcs,h1 (Integrating Sphere - Section 4.1)	ANSI/IES TM-30-18	-12%≤IES Rcs,h1≤+23%		-11%
Zonal Lumen Requirement (0°-60°) (Goniophotometer - Section 4.2)	IES LM-79-2008	≥40%		72.74%
Corrected UGR (X=4H, Y=8H, 70/50/20%) (Goniophotometer - Section 4.2)	CIE 190-2010	<22		23.8
Input Voltage (V)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Wrost Case		120
(Goniophotometer - Section 4.2)		Non-Wrost Case		277
Input Current (A)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Wrost Case		0.365
(Goniophotometer - Section 4.2)		Non-Wrost Case		0.154
Power (Input Wattage - W)				
(Goniophotometer - Section 4.2)	IES LM-79-2008	Wrost Case		43.7
(Goniophotometer - Section 4.2)		Non-Wrost Case		41.1

2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2023/5/24	CW4/44W/4000K	M1
2	Goniophotometer Test	2023/5/24	CW4/44W/4000K	M1
3	THD and PF Test	2023/5/24	CW4/44W/4000K	M1

Remark(If any)

1、 This report shall not be used by the client to claim product endorsement by NVLAP, NIST or any agency of the US government.


2、 The results reported herein have been performed in accordance with the laboratory's terms of accreditation. This report shall not be reproduced except in full without the written approval of the Laboratory. The results in this report apply to the test sample(s) mentioned above at the time of the testing period only and are not to be used to indicate applicability to other similar products. This report does not imply that the product(s) has met the criteria for certification.

3.0 Production Description

Luminaire Description: CW4/44W/4000K

Electrical Specification: 120V-277V,50/60HZ

Photos of Luminaire Characteristics

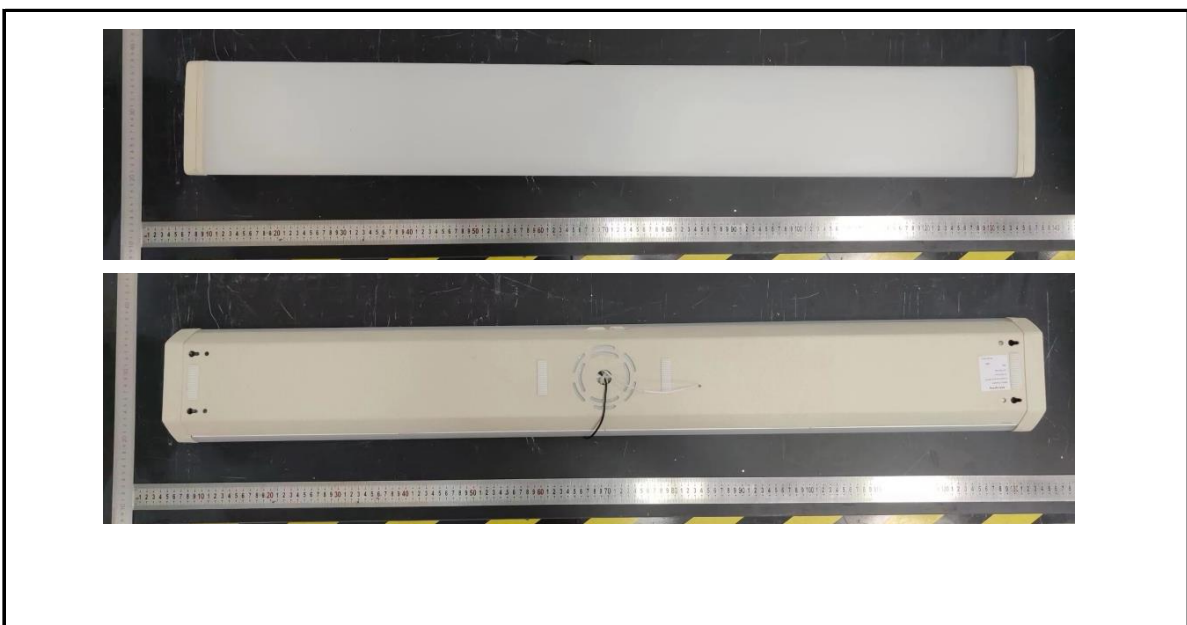

4.0 LM-79 Measurement and Test Results

4.1 Integrating Sphere Test

Model No.	CW4/44W/4000K	Sample ID.	M1
Operate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The sample was measured using 4π geometry and operated at rated voltage and was stabilized before measurement. Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780 nm.

Test Result

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
119.97	60	0.369	44.1	0.997
277.01	60	0.156	41.5	0.962


Test Result

CCT (K)	CRI	R9	Duv
4040	85	15	0.0022

Rf	Rg	IES Rcs,h1
85	95	-11%

4.1 Integrating Sphere Test

Results

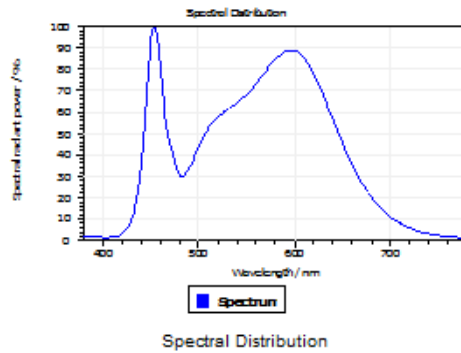

Spectral values


DominantWavelength 580.25 nm
Purity 0.243
PeakWavelength 453.80 nm
Radiant Power 16.69 W
Width50%:

Color Coordinates

Correlated Color Temperal 4040 K
x: 0.3773 u: 0.2256 u': 0.2256
y: 0.3702 v: 0.3321 v': 0.4982

CRI01	84.3	CRI09	15.4
CRI02	93.1	CRI10	83.0
CRI03	95.4	CRI11	82.0
CRI04	82.4	CRI12	66.1
CRI05	84.2	CRI13	87.0
CRI06	89.4	CRI14	98.3
CRI07	84.7	CRI15	78.3
CRI08	65.4	CRI16	74.5

ResultsCRI 84.9

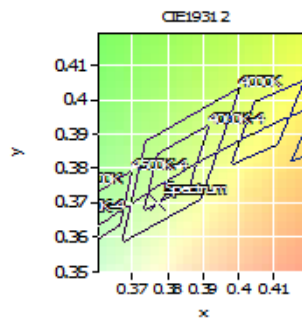

PlankDistance 2.2E-003

4.1 Integrating Sphere Test


IES TM-30-18 Color Rendition Report

Source: DLF2305110-13a

Manufacturer: RAB Lighting Inc.

Date: 2023/5/24

Model: CW4/44W/4000K

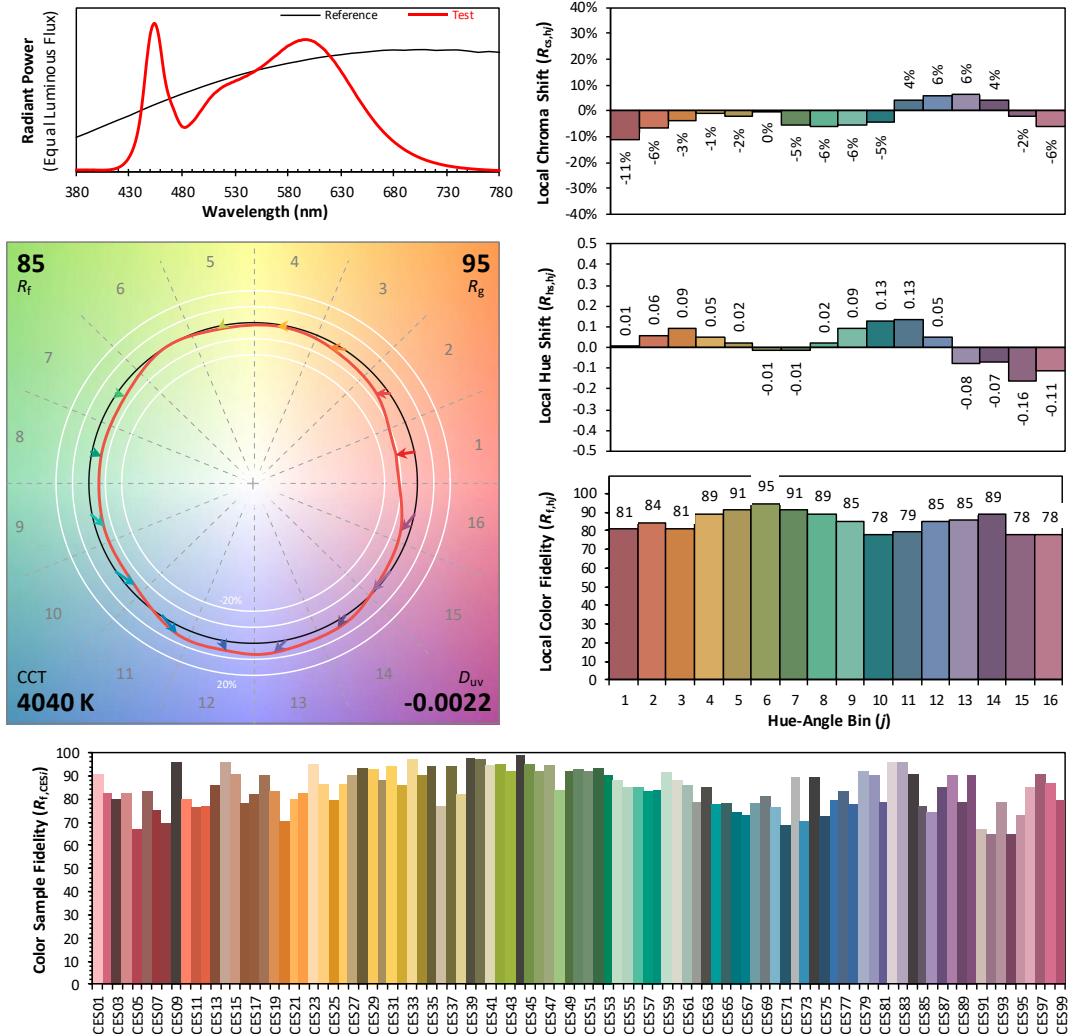

Notes: This is a recommended method for displaying IES TM-30-18 information.

x 0.3773
 y 0.3702
 u' 0.2256
 v' 0.4982

CIE 13.3-1995
(CRI)

R_a 86

R_g 21

4.1 Integrating Sphere Test

Spectral Distribution over Visible Wavelength							
WL (nm)	Radiant (Watts/nm)	WL (nm)	Radiant (Watts/nm)	WL (nm)	Radiant (Watts/nm)	WL (nm)	Radiant (Watts/nm)
380	1.47E-03	485	3.26E-02	590	9.41E-02	695	1.38E-02
385	1.42E-03	490	3.60E-02	595	9.48E-02	700	1.18E-02
390	1.42E-03	495	4.09E-02	600	9.45E-02	705	1.01E-02
395	1.42E-03	500	4.62E-02	605	9.33E-02	710	8.58E-03
400	1.26E-03	505	5.15E-02	610	9.05E-02	715	7.31E-03
405	1.27E-03	510	5.58E-02	615	8.73E-02	720	6.26E-03
410	1.42E-03	515	5.90E-02	620	8.28E-02	725	5.30E-03
415	1.95E-03	520	6.16E-02	625	7.80E-02	730	4.51E-03
420	3.18E-03	525	6.34E-02	630	7.24E-02	735	3.87E-03
425	5.73E-03	530	6.51E-02	635	6.66E-02	740	3.28E-03
430	1.06E-02	535	6.67E-02	640	6.06E-02	745	2.80E-03
435	1.94E-02	540	6.85E-02	645	5.44E-02	750	2.43E-03
440	3.66E-02	545	7.05E-02	650	4.88E-02	755	2.08E-03
445	6.82E-02	550	7.27E-02	655	4.32E-02	760	1.80E-03
450	9.87E-02	555	7.52E-02	660	3.80E-02	765	1.56E-03
455	1.06E-01	560	7.81E-02	665	3.32E-02	770	1.33E-03
460	8.70E-02	565	8.13E-02	670	2.89E-02	775	1.15E-03
465	6.20E-02	570	8.42E-02	675	2.52E-02	780	9.90E-04
470	4.88E-02	575	8.74E-02	680	2.18E-02		
475	3.91E-02	580	9.03E-02	685	1.88E-02		
480	3.26E-02	585	9.23E-02	690	1.61E-02		

4.0 LM-79 Measurement and Test Results

4.2 Goniophotometer Test

Model No.	CW4/44W/4000K	Sample ID.	M1
Opreate time (Min.)	90	Stabilization time (Min.)	45
Temperature (°C)	25.3	Humidity (%RH)	54.0

Test Method

The samples were tested according to the IES LM-79-2008.

Photometric paramters were measured using a type C goniophotometer and software.

The ambient temperature shall be maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$, measured at a point not more than 1 m from the sample and at the same height as the sample.

The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.

The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 0.5° vertical intervals and 10° horizontal intervals.

Test Conditions

Condition	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
WROST CASE	120.03	60	0.365	43.7	0.997
NON-WROST CASE	277.00	60	0.154	41.1	0.962


Test Result

Flux (lm)	Field Angle(10%)		Beam Angle(50%)		Luminous Efficacy (lm/W)
	C0-180	C90-270	C0-180	C90-270	
6191	169.3	162.5	110.7	119.0	141.7


Zonal Lumen Requirement (0° - 60°)	UGR (X=4H, Y=8H, 70/50/20%)	Length(ft)	Lumen/ft
72.74%	23.8	4.00	1548

4.2 Goniophotometer Test

Light Distrubtion Curve

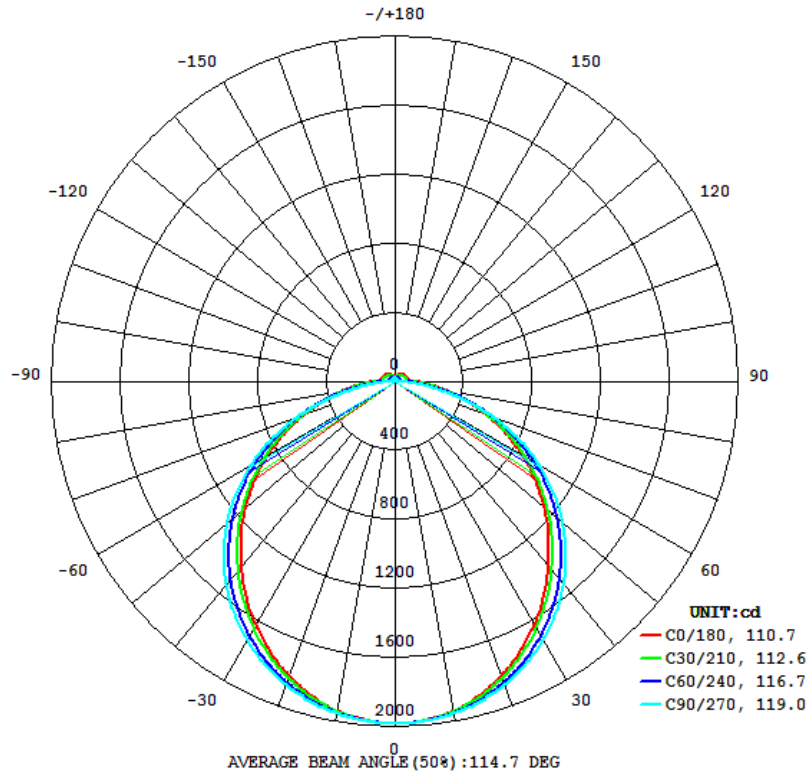

Isolux Plot

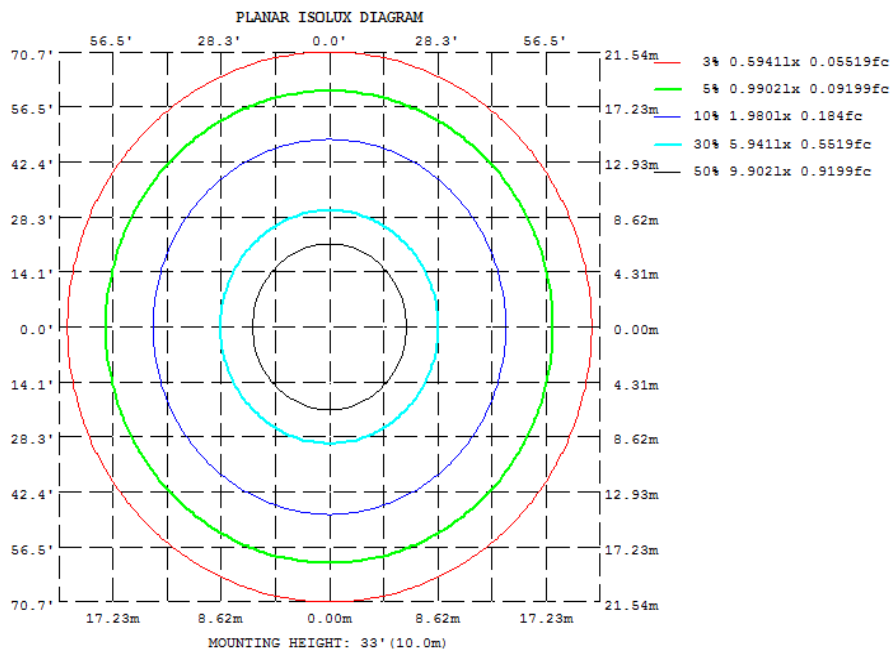

4.2 Goniophotometer Test

Zonal Lumen Summary

γ	C0	C45	C90	C135	C180	C225	C270	C315
10	1938	1945	1953	1945	1938	1945	1953	1945
20	1814	1840	1869	1840	1814	1840	1869	1840
30	1626	1674	1729	1674	1626	1674	1729	1674
40	1395	1456	1532	1456	1395	1456	1532	1456
50	1138	1202	1279	1202	1138	1202	1279	1202
60	858.6	909.8	973.6	909.8	858.6	909.8	973.6	909.8
70	574.8	596.9	616.5	596.9	574.8	596.9	616.5	596.9
80	306.0	289.9	240.8	289.9	306.0	289.9	240.8	289.9
90	114.2	76.92	0.9703	76.92	114.2	76.92	0.9703	76.92
100	91.15	61.43	2.469	61.43	91.15	61.43	2.469	61.43
110	84.11	58.22	8.703	58.22	84.11	58.22	8.703	58.22
120	77.43	54.36	15.67	54.36	77.43	54.36	15.67	54.36
130	68.76	49.63	22.10	49.63	68.76	49.63	22.10	49.63
140	59.14	45.04	27.41	45.04	59.14	45.04	27.41	45.04
150	50.17	40.98	29.91	40.98	50.17	40.98	29.91	40.98
160	42.28	36.10	28.16	36.10	42.28	36.10	28.16	36.10
170	36.78	30.45	25.22	30.45	36.78	30.45	25.22	30.45
180	24.17	27.19	28.35	27.19	24.17	27.19	28.35	27.19
DEG	LUMINOUS INTENSITY:cd							

UGR Table - Corrected

UGR Table - Corrected										
Reflectances										
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20
Room Size										
UGR Viewed Crosswise										
X=2H Y=2H	19.2	20.7	19.6	21.1	21.6	18.9	20.4	19.3	20.8	21.3
3H	20.9	22.3	21.3	22.7	23.2	20.8	22.2	21.3	22.6	23.1
4H	21.5	22.8	21.9	23.2	23.7	21.6	22.9	22.1	23.4	23.9
6H	21.8	23.1	22.3	23.5	24.0	22.3	23.5	22.8	24.0	24.5
8H	21.9	23.1	22.4	23.6	24.1	22.6	23.8	23.1	24.2	24.8
12H	21.9	23.1	22.4	23.5	24.1	22.8	24.0	23.4	24.5	25.0
UGR Viewed Endwise										
4H 2H	19.7	21.1	20.2	21.5	22.0	19.5	20.8	20.0	21.3	21.8
3H	21.7	22.8	22.2	23.3	23.8	21.6	22.8	22.1	23.3	23.8
4H	22.4	23.4	22.9	23.9	24.5	22.6	23.6	23.1	24.1	24.6
6H	22.9	23.8	23.4	24.3	24.9	23.4	24.3	23.9	24.8	25.4
8H	23.0	23.8	23.5	24.4	24.9	23.8	24.6	24.3	25.1	25.7
12H	23.0	23.8	23.6	24.4	24.9	24.1	24.8	24.6	25.4	26.0
UGR Viewed Endwise										
8H 4H	22.7	23.5	23.2	24.1	24.7	22.9	23.7	23.4	24.2	24.8
6H	23.3	24.0	23.9	24.6	25.2	23.8	24.5	24.4	25.1	25.7
8H	23.5	24.1	24.1	24.7	25.3	24.3	24.9	24.8	25.5	26.1
12H	23.6	24.1	24.2	24.7	25.4	24.7	25.3	25.3	25.8	26.5
UGR Viewed Endwise										
12H 4H	22.8	23.5	23.3	24.1	24.7	22.9	23.6	23.4	24.2	24.8
6H	23.4	24.0	24.0	24.6	25.2	23.9	24.5	24.5	25.1	25.7
8H	23.6	24.2	24.2	24.7	25.4	24.4	24.9	25.0	25.5	26.2
Maximum UGR = 26.5										

4.2 Goniophotometer Test

ZONAL LUMEN SUMMARY

	Zonal (lm)		Total (lm)	Percent
0-10	187.34	0 - 10	187.34	3.03%
10-20	536.48	0 - 20	723.82	11.69%
20-30	813.72	0 - 30	1537.54	24.83%
30-40	984.65	0 - 40	2522.19	40.74%
40-50	1031.46	0 - 50	3553.65	57.40%
50-60	950.04	0 - 60	4503.69	72.74%
60-70	747.45	0 - 70	5251.14	84.82%
70-80	460.27	0 - 80	5711.41	92.25%
80-90	172.08	0 - 90	5883.49	95.03%
90-100	63.54	0 - 100	5947.03	96.06%
100-110	56.91	0 - 110	6003.94	96.97%
110-120	51.43	0 - 120	6055.37	97.81%
120-130	44.05	0 - 130	6099.42	98.52%
130-140	35.43	0 - 140	6134.85	99.09%
140-150	26.48	0 - 150	6161.33	99.52%
150-160	17.69	0 - 160	6179.02	99.80%
160-170	9.46	0 - 170	6188.48	99.96%
170-180	2.75	0 - 180	6191.23	100.00%

4.2 Goniophotometer Test


COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Coefficients Of Utilization - Zonal Cavity Method

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
R/W	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	118	118	118	118	115	115	115	115	108	108	108	103	103	103	97	97	97	95
1	107	102	98	93	104	99	95	91	94	91	88	89	87	84	85	83	81	78
2	97	89	81	76	94	86	80	74	82	76	72	78	73	69	74	70	67	65
3	88	77	69	62	85	76	68	62	72	65	60	68	63	58	65	61	57	54
4	81	68	60	53	78	67	58	52	64	56	51	61	55	50	58	53	48	46
5	74	61	52	45	72	60	51	45	57	49	44	54	48	43	52	46	42	40
6	68	55	46	39	66	54	45	39	51	44	38	49	43	37	47	41	37	35
7	63	50	41	35	61	49	40	34	47	39	34	45	38	33	43	37	33	30
8	59	45	37	31	57	44	36	31	43	35	30	41	34	30	39	34	29	27
9	55	42	33	28	53	41	33	27	39	32	27	38	31	27	36	31	26	24
10	52	38	30	25	50	38	30	25	36	29	25	35	29	24	34	28	24	22

CONE OF LIGHT DIAGRAM

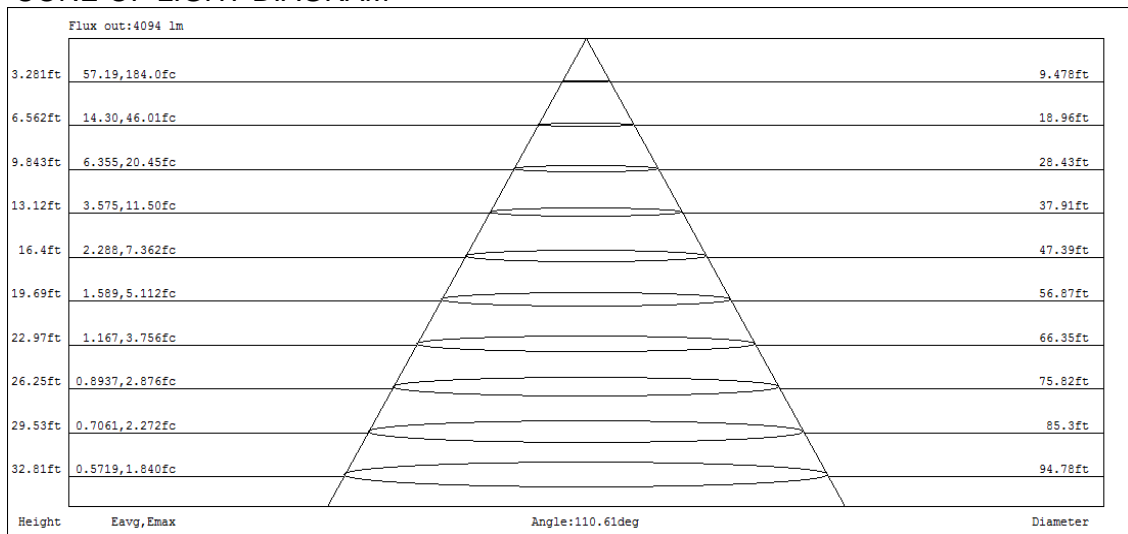

4.0 LM-79 Measurement and Test Results

4.3 THD and PF Test

Model No.	CW4/44W/4000K	Sample ID.	M1
Temperature (°C)	25.3	Humidity (%RH)	56.0

Test Method

The samples were tested according to the ANSI C82.77:2002.

The total harmonic distortion shall be measured to the 40th order.

The ambient temperature condition was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion were calculated.

Test Results

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	THD
119.97	60	0.369	44.1	0.997	5.82%
277.01	60	0.156	41.5	0.962	9.99%

5.0 Equipment Information

Test Equipment			
Equipment ID	Equipment Name	Last Calibration Date	Calibration Due Date
DLF107	Integrating Sphere System	2022/12/24	2023/12/23
DLF108	Auxiliary Lamp	2022/12/24	2023/12/23
DLF122	Measurement Standard Lamp Standard Lamp Type: 220 V, 0.4720 A, Tungsten, Omni-directional	2022/12/24	2023/12/23
DLF116	AC Power Source	2022/12/16	2023/12/15
DLF516	Power Meter	2022/12/16	2023/12/15
DLF112	Temperature Recorder	2022/12/28	2023/12/27
DLF114	Temperature & Humidity Datalogger	2022/12/28	2023/12/27
DLF101	Goniophotometer	2022/12/24	2023/12/23
DLF511	AC Power Source	2022/12/16	2023/12/15
DLF512	AC Power Source	2022/12/16	2023/12/15
DLF513	AC Power Source	2022/12/16	2023/12/15
DLF507	DC Power Source	2022/12/16	2023/12/15
DLF111	Temperature & Humidity Datalogger	2022/12/28	2023/12/27
DLF119	Power Meter	2022/12/16	2023/12/15
DLF031	Temperature data logger	2022/6/22	2023/6/21
DLF073	Power Analyzer	2022/6/22	2023/6/21
DLF003	Temperature & Humidity Datalogger	2022/6/22	2023/6/21

***** End of Test Report*****