

Photometric Test Report

Relevant Standards

- ☒ IES LM-79-2008
- ☒ ANSI C82.77-2017

Prepared For

RAB Lighting Inc.

Prepared By

Dongguan New Testing Centre Co., Ltd.

Prepare by:

Alan Wang

Engineer: Alan Wang

Date: 2024-03-13

Review by:

Vincent Yuan

Technical Lead: Vincent Yuan

Issue Date: 2024-03-13

Revised Date: N/A

1.0 Test Summary

DLC Technical Requirements V5.1

Integrated Retrofit Kits for 1x4 Luminaires				
Requirement Category	Test Method	Requirements		Test Value
Luminaire Output (lm) (Goniophotometer – Section 4.2)	IES LM-79-2008	1500		3894
Minimum Luminaire Efficacy (lm/W) (Goniophotometer – Section 4.2)	IES LM-79-2008	Standard	Premium	140.1
		110	125	
Power (Input Wattage) (W) (Goniophotometer – Section 4.2)	IES LM-79-2008	Worst Case		27.8
Total Harmonic Distortion (A%) (THD & PF – Section 4.3)	ANSI C82.77:2014	20.00%	120V	17.07
			277V	10.35
Power Factor (THD & PF – Section 4.3)	ANSI C82.77:2014	0.9	120V	0.995
			277V	0.892
Allowable CCTs* (K) (Integrating Sphere – Section 4.1)	IES LM-79-2008	7 steps	3985±275	4250
		4 steps	3985±154	
Minimum CRI (Integrating Sphere – Section 4.1)	IES LM-79-2008 CIE13.3-1995	≥80		84.8
Minimum R9 (Integrating Sphere – Section 4.1)	IES LM-79-2008 CIE13.3-1995	≥0		17
Minimum Rf (Integrating Sphere – Section 4.1)	ANSI/IES TM-30-18	≥70		84
Minimum Rg (Integrating Sphere – Section 4.1)	ANSI/IES TM-30-18	≥89		95
IES Rcs,h1 (Integrating Sphere – Section 4.1)	ANSI/IES TM-30-18	-12%≤IES Rcs,h1≤+23%		-11%
Zonal Lumen Requirement (0°-60°) (Goniophotometer – Section 4.2)	IES LM-79-2008	≥75%		77.4%
Discomfort Glare (UGR) (Goniophotometer – Section 4.2)	IES LM-79-2008	Standard	Premium	21.8
		N/A	<22	
Spacing Criterion (Goniophotometer – Section 4.2)	IES LM-79-2008	0°-180°	1.0-2.0	1.28
		90°-270°	1.0-2.0	1.28
Input Voltage (V)				
(Goniophotometer – Section 4.2)	IES LM-79-2008	Worst Cast		120.0
(Goniophotometer – Section 4.2)		Non-Worst Case		277.0
Input Current (A)				
(Goniophotometer – Section 4.2)	IES LM-79-2008	Worst Case		0.233
(Goniophotometer – Section 4.2)		Non-Worst Case		0.111
Power (Input Wattage – W)				
(Goniophotometer – Section 4.2)	IES LM-79-2008	Worst Case		27.8
(Goniophotometer – Section 4.2)		Non-Worst Case		27.5

2.0 Test List

Test Item	Test	Test Date	Model Number	Sample No.
1	Integrating Sphere Test	2024-03-12	RPLED1X4 @30W4000K	240306004-S1
2	Goniophotometer Test	2024-03-12	RPLED1X4 @30W4000K	240306004-S1
3	THD and PF Test	2024-03-12	RPLED1X4 @30W4000K	240306004-S1

Remark (If any)


1. The results contained in this report pertain only to the tested samples.
2. Test Troffer is Lithonia GT8 lensed 1x4.
3. This report shall not be reproduced, no limited part or full, without approval of Dongguan New Testing Centre Co., Ltd.
4. This report does not imply product certification, approval, or endorsement by NVLAP, or any agency of the Federal Government.

3.0 Product Description

Luminaire Description: Model No. RPLED1X4 @30W4000K, color tunable from 3500K, 4000K and 5000K.

Electrical Specification: 120-277Vac, 50/60Hz

Photos of Luminaire Characteristics

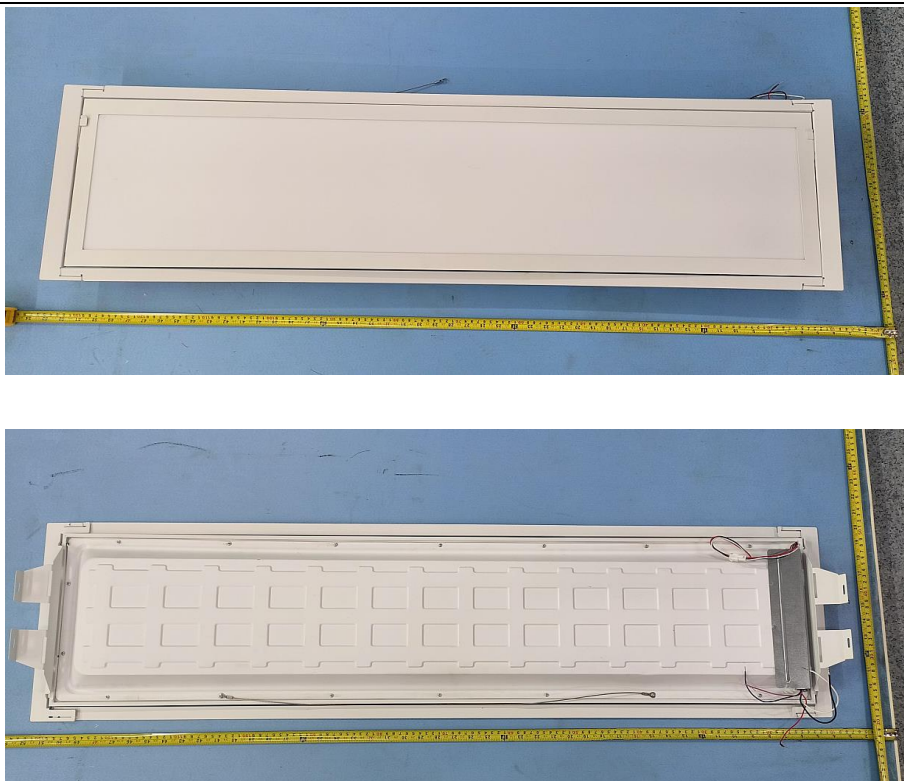

4.0 LM-79 Measurement and Test Results

4.1 Integrating Sphere Test

Model No.	RPLED1X4 @30W4000K	Sample ID	240306004-S1
Operate time (Min.)	10	Stabilization time (Min.)	60
Temperature (°C)	25.4	Humidity (%RH)	41.0


Test Method
<p>The Samples were tested according to the IES LM-79-2008.</p> <p>Photometric parameters were measured using an integrating sphere, a spectroradiometer and software. The ambient temperature condition inside the sphere was maintained at 25±1°C.</p> <p>The sample measurements were made using a spectroradiometer connected by a fiber optic cable and detector through the detector port of the integrating sphere.</p> <p>The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ±0.2 percent under load.</p> <p>The sample was measured using 4π geometry and operated at rated voltage and was stabilized before measurement.</p> <p>Chromaticity coordinates, correlated color temperature and color rendering index were calculated from the spectral radiant flux measurements taken at 1 nm intervals over the range of 380 to 780nm.</p>

Test Result

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
120.0	60	0.233	27.8	0.995
277.0	60	0.111	27.5	0.892

CCT (K)	CRI	R9	Duv	Rf	Rg	IES Rcs,h1
4250	84.8	17	-0.0003	84	95	-11%

4.1 Integrating Sphere Test

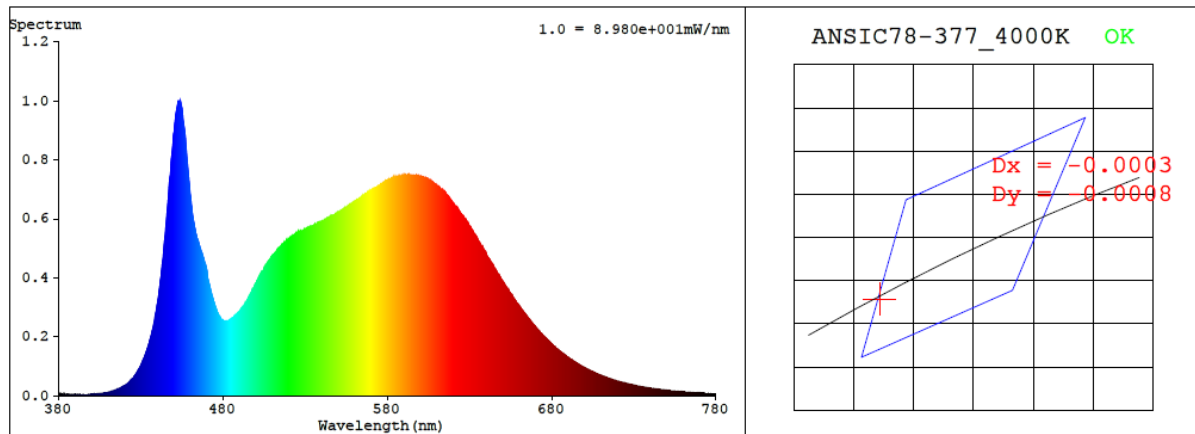

Colorimetric Parameters

Chromaticity Coordinate: $x = 0.3698$ $y = 0.3692$ / $u' = 0.2211$ $v' = 0.4966$ ($duv = -3.06e-04$)

CCT= 4250K Prcp WL: Ld=578.3nm Purity=21.8%

Peak WL: Lp=454nm FWHM: =22.3nm Ratio:R=17.9% G=78.0% B=4.1%

Render Index: Ra = 84.8 AvgR = 78.7 TM30:Rf=84 Rg=95

EEL: 0.09560 A++ Highest

R1 =84	R2 =91	R3 =95	R4 =83	R5 =83	R6 =87	R7 =87
R8 =68	R9 =17	R10=78	R11=82	R12=61	R13=86	R14=98 R15=78

4.1 Integrating Sphere Test







ANSI/IES TM-30-18 Color Rendition Report

Source: 1 CIE F1

Manufacturer: RAB Lighting Inc.

Date: 2024/3/13

Model: RPLED1X4 @30W4000K

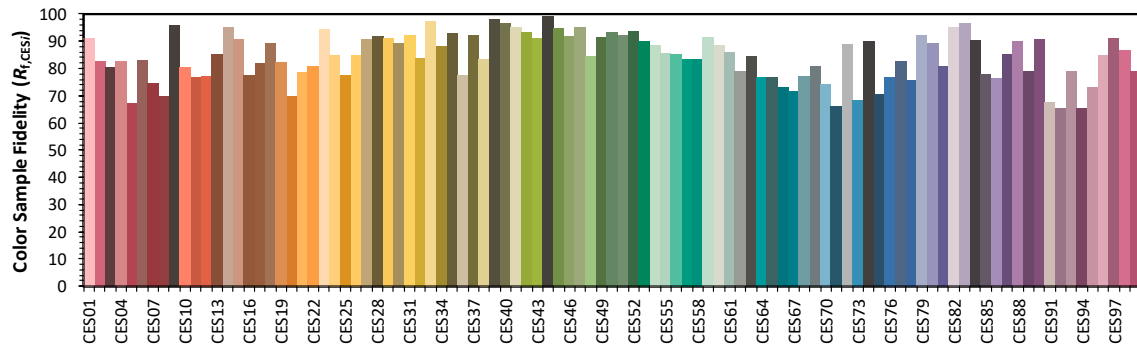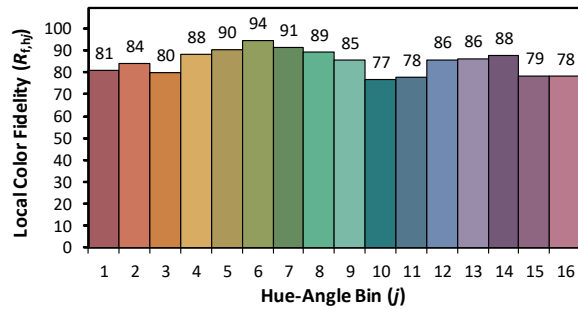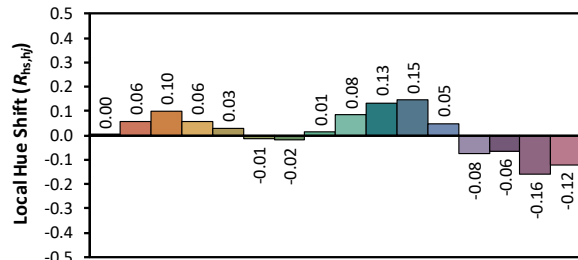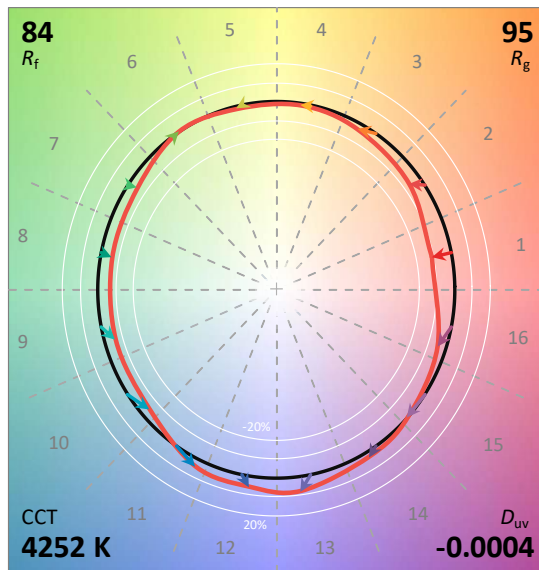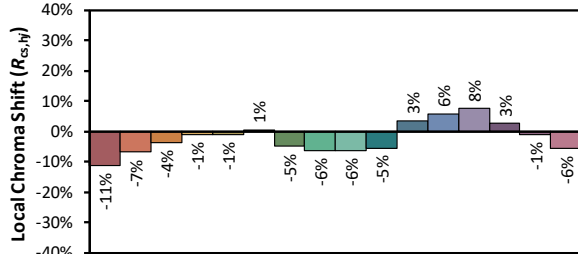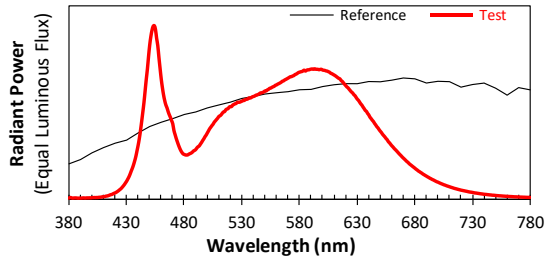

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.3698
 y 0.3691
 u' 0.2211
 v' 0.4966

CIE 13.3-1995
(CRI)
 R_a 85
 R_9 18

4.1 Integrating Sphere Test

Spectral Distribution over Visible Wavelength											
WL (nm)	Radiant (W/nm)	WL (nm)	Radiant (W/nm)	WL (nm)	Radiant (W/nm)	WL (nm)	Radiant (W/nm)	WL (nm)	Radiant (W/nm)	WL (nm)	Radiant (W/nm)
380	3.50E-06	447	6.88E-04	514	5.01E-04	581	7.33E-04	648	4.09E-04	715	5.86E-05
381	6.90E-06	448	7.48E-04	515	5.03E-04	582	7.35E-04	649	3.99E-04	716	5.68E-05
382	5.70E-06	449	8.22E-04	516	5.14E-04	583	7.38E-04	650	3.90E-04	717	5.49E-05
383	3.40E-06	450	8.88E-04	517	5.18E-04	584	7.43E-04	651	3.82E-04	718	5.31E-05
384	4.10E-06	451	9.37E-04	518	5.21E-04	585	7.37E-04	652	3.72E-04	719	5.14E-05
385	4.60E-06	452	9.73E-04	519	5.30E-04	586	7.42E-04	653	3.64E-04	720	4.96E-05
386	4.60E-06	453	9.96E-04	520	5.32E-04	587	7.44E-04	654	3.57E-04	721	4.82E-05
387	3.90E-06	454	9.99E-04	521	5.32E-04	588	7.44E-04	655	3.48E-04	722	4.68E-05
388	3.10E-06	455	9.78E-04	522	5.41E-04	589	7.47E-04	656	3.40E-04	723	4.54E-05
389	3.80E-06	456	9.27E-04	523	5.44E-04	590	7.49E-04	657	3.29E-04	724	4.39E-05
390	3.60E-06	457	8.84E-04	524	5.48E-04	591	7.49E-04	658	3.23E-04	725	4.27E-05
391	3.80E-06	458	8.17E-04	525	5.50E-04	592	7.48E-04	659	3.14E-04	726	4.10E-05
392	4.60E-06	459	7.53E-04	526	5.57E-04	593	7.51E-04	660	3.06E-04	727	3.95E-05
393	4.60E-06	460	6.92E-04	527	5.57E-04	594	7.48E-04	661	2.99E-04	728	3.83E-05
394	3.80E-06	461	6.42E-04	528	5.58E-04	595	7.48E-04	662	2.91E-04	729	3.75E-05
395	4.60E-06	462	6.00E-04	529	5.61E-04	596	7.47E-04	663	2.84E-04	730	3.62E-05
396	4.80E-06	463	5.67E-04	530	5.64E-04	597	7.45E-04	664	2.77E-04	731	3.49E-05
397	4.80E-06	464	5.42E-04	531	5.68E-04	598	7.47E-04	665	2.70E-04	732	3.34E-05
398	5.20E-06	465	5.25E-04	532	5.68E-04	599	7.47E-04	666	2.62E-04	733	3.28E-05
399	5.00E-06	466	5.03E-04	533	5.73E-04	600	7.43E-04	667	2.55E-04	734	3.17E-05
400	6.00E-06	467	4.85E-04	534	5.74E-04	601	7.42E-04	668	2.49E-04	735	3.07E-05
401	6.30E-06	468	4.69E-04	535	5.76E-04	602	7.41E-04	669	2.41E-04	736	2.96E-05
402	6.90E-06	469	4.51E-04	536	5.82E-04	603	7.38E-04	670	2.35E-04	737	2.86E-05
403	6.60E-06	470	4.33E-04	537	5.82E-04	604	7.37E-04	671	2.28E-04	738	2.77E-05
404	7.10E-06	471	3.95E-04	538	5.84E-04	605	7.34E-04	672	2.22E-04	739	2.68E-05
405	7.10E-06	472	3.71E-04	539	5.89E-04	606	7.31E-04	673	2.15E-04	740	2.57E-05
406	8.30E-06	473	3.48E-04	540	5.91E-04	607	7.25E-04	674	2.10E-04	741	2.51E-05
407	8.60E-06	474	3.28E-04	541	5.93E-04	608	7.22E-04	675	2.03E-04	742	2.46E-05
408	9.60E-06	475	3.09E-04	542	5.97E-04	609	7.18E-04	676	1.97E-04	743	2.36E-05
409	1.09E-05	476	2.92E-04	543	6.00E-04	610	7.14E-04	677	1.92E-04	744	2.29E-05
410	1.16E-05	477	2.78E-04	544	6.02E-04	611	7.10E-04	678	1.87E-04	745	2.21E-05
411	1.27E-05	478	2.67E-04	545	6.06E-04	612	7.05E-04	679	1.82E-04	746	2.16E-05
412	1.48E-05	479	2.59E-04	546	6.11E-04	613	7.00E-04	680	1.76E-04	747	2.05E-05
413	1.58E-05	480	2.56E-04	547	6.12E-04	614	6.95E-04	681	1.71E-04	748	2.02E-05
414	1.75E-05	481	2.53E-04	548	6.14E-04	615	6.92E-04	682	1.66E-04	749	1.96E-05
415	2.01E-05	482	2.52E-04	549	6.17E-04	616	6.83E-04	683	1.60E-04	750	1.89E-05
416	2.29E-05	483	2.53E-04	550	6.23E-04	617	6.78E-04	684	1.56E-04	751	1.81E-05
417	2.44E-05	484	2.58E-04	551	6.22E-04	618	6.70E-04	685	1.52E-04	752	1.77E-05
418	2.75E-05	485	2.61E-04	552	6.29E-04	619	6.61E-04	686	1.48E-04	753	1.69E-05
419	3.11E-05	486	2.64E-04	553	6.32E-04	620	6.54E-04	687	1.42E-04	754	1.66E-05
420	3.37E-05	487	2.69E-04	554	6.38E-04	621	6.46E-04	688	1.39E-04	755	1.61E-05
421	3.72E-05	488	2.76E-04	555	6.39E-04	622	6.41E-04	689	1.34E-04	756	1.55E-05
422	4.17E-05	489	2.79E-04	556	6.43E-04	623	6.32E-04	690	1.31E-04	757	1.50E-05
423	4.66E-05	490	2.85E-04	557	6.47E-04	624	6.24E-04	691	1.26E-04	758	1.46E-05
424	5.23E-05	491	2.94E-04	558	6.50E-04	625	6.17E-04	692	1.23E-04	759	1.40E-05
425	5.76E-05	492	3.01E-04	559	6.55E-04	626	6.11E-04	693	1.19E-04	760	1.35E-05
426	6.49E-05	493	3.06E-04	560	6.58E-04	627	6.02E-04	694	1.15E-04	761	1.34E-05
427	7.28E-05	494	3.16E-04	561	6.62E-04	628	5.96E-04	695	1.11E-04	762	1.28E-05
428	8.13E-05	495	3.25E-04	562	6.65E-04	629	5.86E-04	696	1.09E-04	763	1.25E-05
429	9.13E-05	496	3.37E-04	563	6.69E-04	630	5.76E-04	697	1.05E-04	764	1.22E-05
430	1.01E-04	497	3.47E-04	564	6.73E-04	631	5.69E-04	698	1.01E-04	765	1.17E-05
431	1.14E-04	498	3.59E-04	565	6.78E-04	632	5.59E-04	699	9.79E-05	766	1.12E-05
432	1.26E-04	499	3.68E-04	566	6.80E-04	633	5.48E-04	700	9.57E-05	767	1.09E-05
433	1.42E-04	500	3.80E-04	567	6.86E-04	634	5.41E-04	701	9.24E-05	768	1.08E-05
434	1.60E-04	501	3.92E-04	568	6.89E-04	635	5.30E-04	702	8.94E-05	769	1.03E-05
435	1.77E-04	502	4.04E-04	569	6.93E-04	636	5.20E-04	703	8.65E-05	770	1.01E-05
436	1.96E-04	503	4.13E-04	570	6.97E-04	637	5.10E-04	704	8.39E-05	771	9.60E-06
437	2.19E-04	504	4.23E-04	571	7.01E-04	638	5.04E-04	705	8.09E-05	772	9.40E-06
438	2.45E-04	505	4.31E-04	572	7.05E-04	639	4.93E-04	706	7.88E-05	773	9.20E-06
439	2.77E-04	506	4.42E-04	573	7.05E-04	640	4.84E-04	707	7.61E-05	774	8.80E-06
440	3.10E-04	507	4.50E-04	574	7.09E-04	641	4.71E-04	708	7.36E-05	775	8.70E-06
441	3.48E-04	508	4.58E-04	575	7.11E-04	642	4.63E-04	709	7.15E-05	776	8.30E-06
442	3.94E-04	509	4.66E-04	576	7.17E-04	643	4.54E-04	710	6.92E-05	777	8.00E-06
443	4.44E-04	510	4.75E-04	577	7.20E-04	644	4.46E-04	711	6.68E-05	778	7.80E-06
444	4.98E-04	511	4.79E-04	578	7.24E-04	645	4.35E-04	712	6.48E-05	779	7.80E-06
445	5.54E-04	512	4.85E-04	579	7.29E-04	646	4.26E-04	713	6.26E-05	780	7.80E-06
446	6.21E-04	513	4.94E-04	580	7.31E-04	647	4.16E-04	714	6.02E-05	N/A	N/A

4.0 LM-79 Measurement and Test Results

4.2 Goniophotometer Test

Model No.	RPLED1X4 @30W4000K	Sample ID	240306004-S1
Operate time (Min.)	30	Stabilization time (Min.)	60
Temperature (°C)	25.0	Humidity (%RH)	42.4

Test Method
<p>The Samples were tested according to the IES LM-79-2008.</p> <p>Photometric parameters were measured using a type C goniophotometer and software.</p> <p>The ambient temperature shall be maintained at $25 \pm 1^{\circ}\text{C}$, measured at a point not more than 1 m from the sample and at the same height as the sample.</p> <p>The voltage of an AC power supply (RMS voltage) or DC power supply (instantaneous voltage) applied to the device under test shall be regulated to within ± 0.2 percent under load.</p> <p>The samples were operated at rated voltage and was stabilized before measurement. Luminous flux, luminaire efficacy, zonal lumen were calculated from the software taken at 1.0° vertical intervals and 15° horizontal intervals.</p>

Test Conditions

Condition	Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor
WORST CASE	120.0	60	0.233	27.8	0.995
NON-WORST CASE	277.0	60	0.111	27.5	0.892

Test Result


Flux (lm)	Field Angle (10%)		Beam Angle (50%)		Luminous Efficacy (lm/W)	Zonal Lumen Requirement
	C0-180	C90-270	C0-180	C90-270		(0° - 60°)
3894	165.4	165.0	114.6	114.5	140.1	77.4%

UGR		Spacing Criterion	
Crosswise	Endwise	(0° - 180°)	(90° - 270°)
21.8	21.7	1.28	1.28


4.2 Goniophotometer Test

Lighting Distribution Curve

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

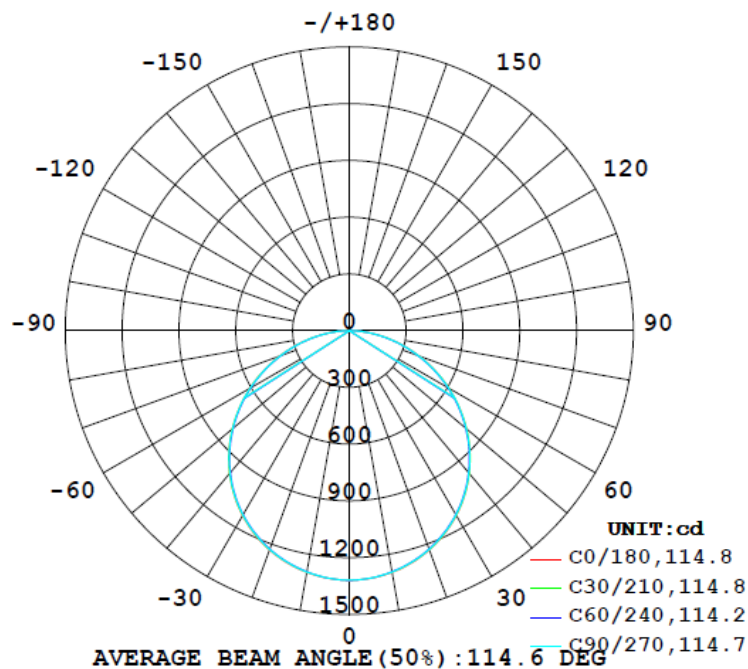

Isolux Plot

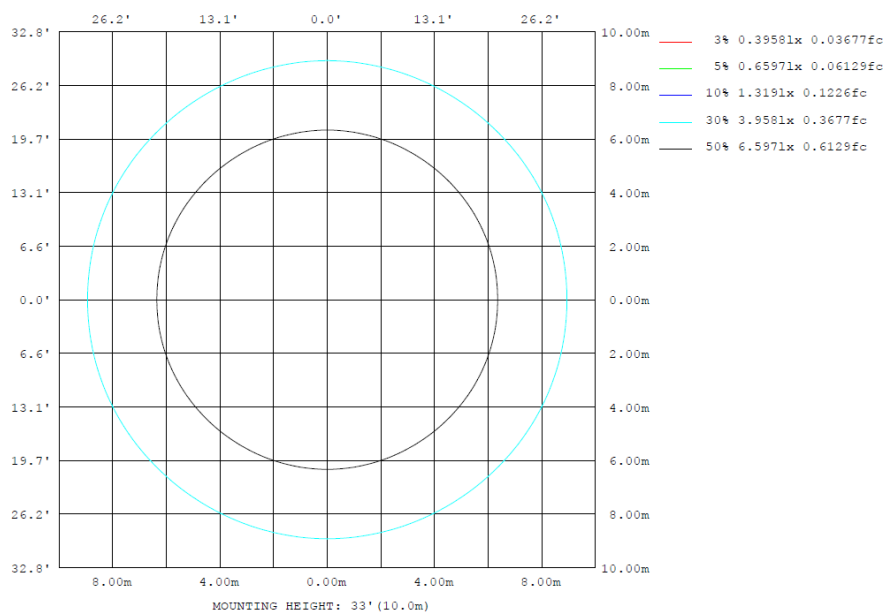

4.2 Goniophotometer Test

Zonal Lumen Summary

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1297	1294	1295	1294	1297	1294	1295	1294	0- 10	124.7	124.7	3.2,3.2
20	1234	1229	1231	1229	1234	1229	1231	1229	10- 20	357.9	482.6	12.4,12.4
30	1128	1124	1125	1124	1128	1124	1125	1124	20- 30	545.2	1028	26.4,26.4
40	983.7	980.9	982.0	980.9	983.7	980.9	982.0	980.9	30- 40	662.0	1690	43.4,43.4
50	806.5	803.5	805.1	803.5	806.5	803.5	805.1	803.5	40- 50	691.9	2382	61.2,61.2
60	606.0	600.8	603.4	600.8	606.0	600.8	603.4	600.8	50- 60	631.1	3013	77.4,77.4
70	391.8	386.2	388.4	386.2	391.8	386.2	388.4	386.2	60- 70	490.8	3504	90,90
80	182.5	177.6	178.2	177.6	182.5	177.6	178.2	177.6	70- 80	297.6	3801	97.6,97.6
90	0	0	0	0	0	0	0	0	80- 90	92.24	3894	100,100
100	0	0	0	0	0	0	0	0	90-100	0	3894	100,100
110	0	0	0	0	0	0	0	0	100-110	0	3894	100,100
120	0	0	0	0	0	0	0	0	110-120	0	3894	100,100
130	0	0	0	0	0	0	0	0	120-130	0	3894	100,100
140	0	0	0	0	0	0	0	0	130-140	0	3894	100,100
150	0	0	0	0	0	0	0	0	140-150	0	3894	100,100
160	0	0	0	0	0	0	0	0	150-160	0	3894	100,100
170	0	0	0	0	0	0	0	0	160-170	0	3894	100,100
180	0	0	0	0	0	0	0	0	170-180	0	3894	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Zonal (lm)		Total (lm)		Percent
0-10	124.71	0-10	124.71	3.20%
10-20	357.89	0-20	482.60	12.39%
20-30	545.22	0-30	1027.82	26.40%
30-40	662.00	0-40	1689.82	43.40%
40-50	691.94	0-50	2381.76	61.17%
50-60	631.13	0-60	3012.89	77.38%
60-70	490.80	0-70	3503.69	89.99%
70-80	297.63	0-80	3801.32	97.63%
80-90	92.24	0-90	3893.56	100.00%
90-100	0.00	0-100	3893.56	100.00%
100-110	0.00	0-110	3893.56	100.00%
110-120	0.00	0-120	3893.56	100.00%
120-130	0.00	0-130	3893.56	100.00%
130-140	0.00	0-140	3893.56	100.00%
140-150	0.00	0-150	3893.56	100.00%
150-160	0.00	0-160	3893.56	100.00%
160-170	0.00	0-170	3893.56	100.00%
170-180	0.00	0-180	3893.56	100.00%

4.2 Goniophotometer Test

UGR – Uncorrected Table:

UGR TABLE - UNCORRECTED

Reflectances										
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20
Room Size										
X=2H	Y=2H	12.4	14.1	12.8	14.4	14.7	12.3	14.0	12.7	14.3
	3H	14.3	15.8	14.7	16.1	16.5	14.2	15.7	14.6	16.1
	4H	15.1	16.5	15.5	16.8	17.2	15.0	16.4	15.4	16.7
	6H	15.7	17.0	16.1	17.3	17.7	15.6	16.9	16.0	17.2
	8H	15.9	17.1	16.3	17.5	17.9	15.8	17.0	16.2	17.4
	12H	16.0	17.2	16.5	17.6	18.1	15.9	17.1	16.4	17.5
UGR Viewed Crosswise										
UGR Viewed Endwise										
4H	2H	13.0	14.5	13.4	14.8	15.2	13.0	14.4	13.4	14.8
	3H	15.2	16.4	15.6	16.8	17.2	15.1	16.3	15.5	16.7
	4H	16.1	17.2	16.5	17.6	18.0	16.0	17.1	16.5	17.5
	6H	16.8	17.8	17.3	18.2	18.7	16.7	17.7	17.2	18.1
	8H	17.1	18.0	17.6	18.4	18.9	17.0	17.9	17.5	18.3
	12H	17.3	18.1	17.8	18.6	19.1	17.2	18.0	17.7	18.5
8H	4H	16.4	17.3	16.9	17.8	18.2	16.4	17.3	16.8	17.7
	6H	17.3	18.1	17.8	18.5	19.0	17.2	18.0	17.7	18.5
	8H	17.7	18.3	18.2	18.9	19.3	17.6	18.2	18.1	18.7
	12H	18.0	18.6	18.5	19.1	19.6	17.9	18.5	18.4	18.9
12H	4H	16.5	17.3	17.0	17.8	18.2	16.4	17.2	16.9	17.7
	6H	17.4	18.1	17.9	18.5	19.1	17.3	18.0	17.8	18.5
	8H	17.8	18.4	18.3	18.9	19.5	17.7	18.3	18.2	18.8

Maximum UGR = 19.6

UGR – Corrected Table:

UGR TABLE - CORRECTED

Reflectances										
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20
Room Size										
X=2H	Y=2H	17.1	18.8	17.5	19.1	19.4	17.0	18.7	17.4	19.0
	3H	19.0	20.5	19.4	20.8	21.2	18.9	20.4	19.3	20.8
	4H	19.8	21.2	20.2	21.5	21.9	19.7	21.1	20.1	21.4
	6H	20.4	21.7	20.8	22.0	22.4	20.3	21.6	20.7	21.9
	8H	20.6	21.8	21.0	22.2	22.6	20.5	21.7	20.9	22.1
	12H	20.7	21.9	21.2	22.3	22.8	20.6	21.8	21.1	22.2
UGR Viewed Crosswise										
UGR Viewed Endwise										
4H	2H	17.7	19.2	18.1	19.5	19.9	17.7	19.1	18.1	19.5
	3H	19.9	21.1	20.3	21.5	21.9	19.8	21.0	20.2	21.4
	4H	20.8	21.9	21.2	22.3	22.7	20.7	21.8	21.2	22.2
	6H	21.5	22.5	22.0	22.9	23.4	21.4	22.4	21.9	22.8
	8H	21.8	22.7	22.3	23.1	23.6	21.7	22.6	22.2	23.0
	12H	22.0	22.8	22.5	23.3	23.8	21.9	22.7	22.4	23.2
8H	4H	21.1	22.0	21.6	22.5	22.9	21.1	22.0	21.5	22.4
	6H	22.0	22.8	22.5	23.2	23.7	21.9	22.7	22.4	23.2
	8H	22.4	23.0	22.9	23.6	24.0	22.3	22.9	22.8	23.4
	12H	22.7	23.3	23.2	23.8	24.3	22.6	23.2	23.1	23.6
12H	4H	21.2	22.0	21.7	22.5	22.9	21.1	21.9	21.6	22.4
	6H	22.1	22.8	22.6	23.2	23.8	22.0	22.7	22.5	23.2
	8H	22.5	23.1	23.0	23.6	24.2	22.4	23.0	22.9	23.5

Maximum UGR = 24.3

4.2 Goniophotometer Test

Luminous Distribution Intensity Data

[illegible][illegible]

4.0 LM-79 Measurement and Test Results

4.3 THD and PF Test

Model No.	RPLED1X4 @30W4000K	Sample ID	240306004-S1
Temperature (°C)	25.4	Humidity (%RH)	41.0

Test Method
<p>The samples were tested according to the ANSI C82.77:2014</p> <p>The total harmonic distortion shall be measured to the 40th order.</p> <p>The ambient temperature shall be maintained at $25 \pm 1^{\circ}\text{C}$. The sample measurements were made using a digital power meter and power supply. The sample was operated at rated voltage and was stabilized before measurement. The total harmonic distortion was calculated.</p>

Test Results

Voltage (Vac)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	iTHD(%)
120.0	60	0.233	27.8	0.995	17.07
277.0	60	0.111	27.5	0.892	10.35

5.0 Equipment List:

Equipment ID	Equipment Name	Last Cal.	Due Cal.
NTC-F01-001	Goniophotometer System	2023-11-08	2024-11-07
NTC-F01-006	2.0 meter Integrating Sphere	2023-11-08	2024-11-07
NTC-F01-012	Standard Lamp	2023-11-02	2024-11-01
NTC-F01-013	Standard Lamp	2023-11-02	2024-11-01
NTC-F01-031	Digital Power Meter	2023-08-25	2024-08-24
NTC-F01-019	Temperature & Humidity Meter	2023-11-06	2024-11-05

*****End of Report*****